




OIL ANALYSIS REPORT

Sample Rating Trend

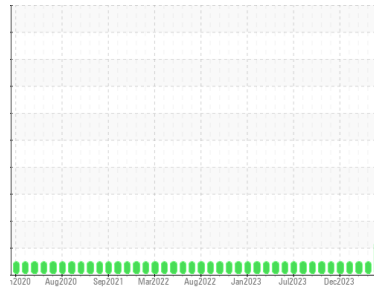

VISUAL METAL



Area

NOC PUMP ROOM

Machine Id

DDE-7501B (S/N NOC FIREWATER PUMP)

Component

Diesel Engine

Fluid

CHEVRON DELO 400 MULTIGRADE 15W40 (12 GAL)

DIAGNOSIS

Recommendation

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

Moderate concentration of visible metal present. All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		HLC0003184	HLC0003147	HLC0003130
Sample Date	Client Info		05 Apr 2024	08 Mar 2024	09 Feb 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	5	6	5
Chromium	ppm	ASTM D5185m >20	<1	<1	0
Nickel	ppm	ASTM D5185m >4	<1	1	0
Titanium	ppm	ASTM D5185m	1	2	<1
Silver	ppm	ASTM D5185m >3	<1	0	0
Aluminum	ppm	ASTM D5185m >20	1	2	<1
Lead	ppm	ASTM D5185m >40	1	2	<1
Copper	ppm	ASTM D5185m >330	1	2	1
Tin	ppm	ASTM D5185m >15	<1	2	<1
Vanadium	ppm	ASTM D5185m	<1	<1	<1
Cadmium	ppm	ASTM D5185m	<1	1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 151	120	113	107
Barium	ppm	ASTM D5185m 0.4	0	0	0
Molybdenum	ppm	ASTM D5185m 250	11	10	2
Manganese	ppm	ASTM D5185m	<1	1	<1
Magnesium	ppm	ASTM D5185m 0	744	596	669
Calcium	ppm	ASTM D5185m 2046	1735	1414	1450
Phosphorus	ppm	ASTM D5185m 1043	859	713	734
Zinc	ppm	ASTM D5185m 943	967	773	828
Sulfur	ppm	ASTM D5185m 5012	4499	3016	3623

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	6	6	4
Sodium	ppm	ASTM D5185m	6	4	2
Potassium	ppm	ASTM D5185m >20	4	4	2

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	6.1	6.2	6.2
Sulfation	Abs/.1mm	*ASTM D7415 >30	17.7	18.1	17.5


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	12.2	12.4	12.2
Base Number (BN)	mg KOH/g	ASTM D2896 12.5	11.02	8.3	10.42




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

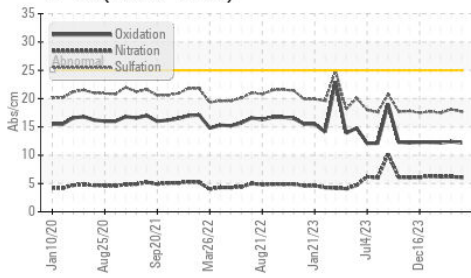

Base Number

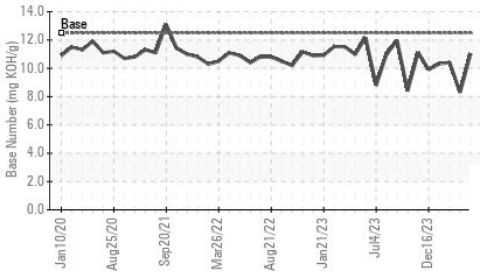

Viscosity @ 100°C

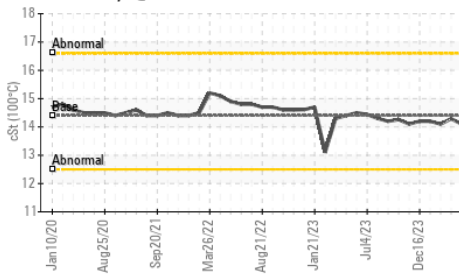


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	▲ MODER	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.1	14.29

GRAPHS


Ferrous Alloys

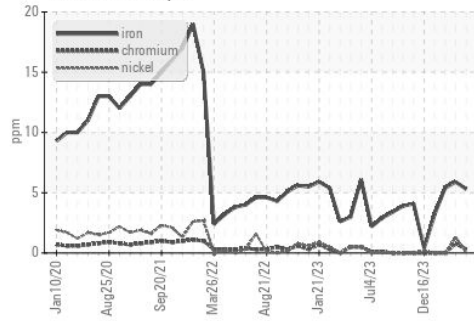


Non-ferrous Metals

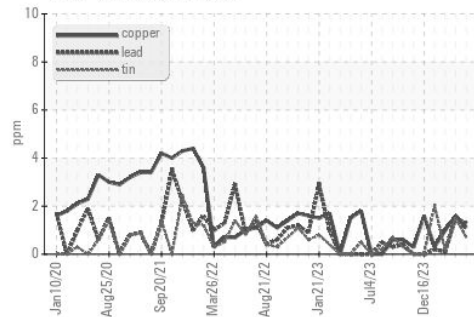

Viscosity @ 100°C

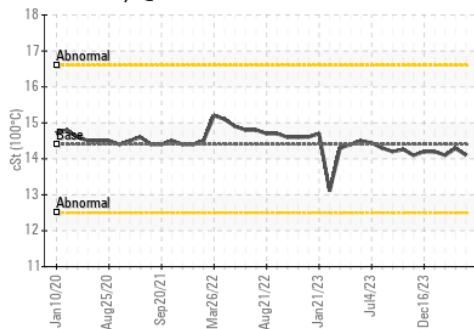

Base Number

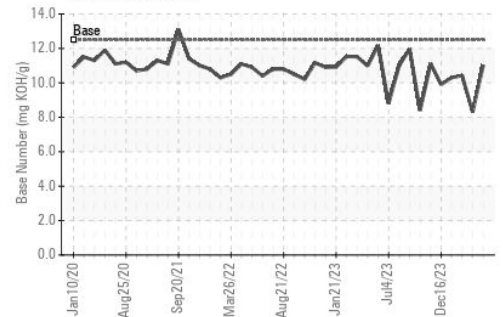

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : HLC0003184
 Lab Number : 06182065
 Unique Number : 11033391
 Test Package : IND 2

Received : 16 May 2024
 Tested : 21 May 2024
 Diagnosed : 21 May 2024 - Jonathan Hester

HILCORP NORTHSTAR FACILITY

PRUDHOE BAY, AK
 US 99734
 Contact: PERRY NEEL
 pneel@hilcorp.com
 T: (907)670-3514
 F: (907)659-5377

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)