



# OIL ANALYSIS REPORT

## Sample Rating Trend



## VISCOSITY



Machine Id  
**SA BROWNSVILLE ORU**  
 Component  
**Bearing**  
 Fluid  
**PRIMUS R&O 220 (330 GAL)**

### DIAGNOSIS

#### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil.

#### ● Fluid Condition

The oil viscosity is lower than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PH0001523</b>	---	---
Sample Date	Client Info		<b>17 Apr 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>2	<b>NEG</b>	---	---

WEAR METALS	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---


ADDITIVES	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>2</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>19</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>65</b>	---	---
Zinc	ppm	ASTM D5185m		<b>37</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>6986</b>	---	---

CONTAMINANTS	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>▲ 12967</b>	---	---
Particles >6µm	ASTM D7647	>640	<b>▲ 2566</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>▲ 90</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>▲ 25</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>2</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>▲ 21/19/14</b>	---	---





FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.10</b>	---	---

Particle Filter (Magn: 200 x)

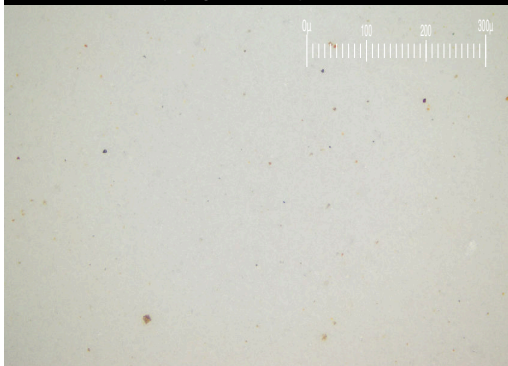



# OIL ANALYSIS REPORT

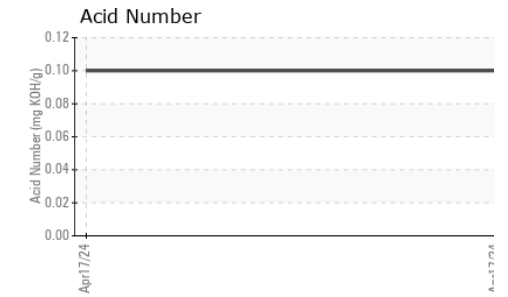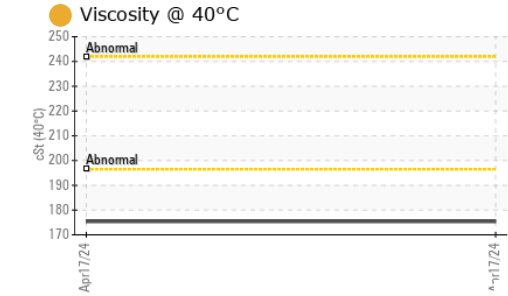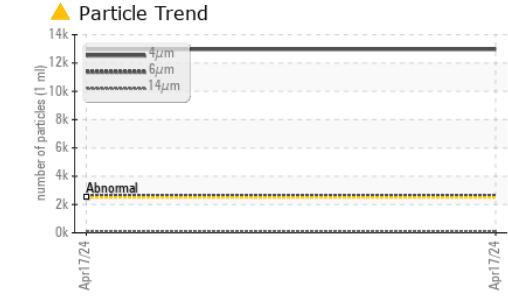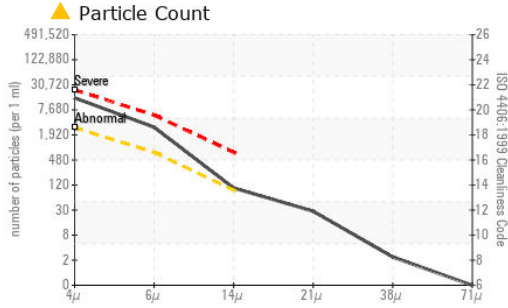

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PH0001523      **Received** : 17 May 2024  
**Lab Number** : **06182777**      **Tested** : 29 May 2024  
**Unique Number** : 11034103      **Diagnosed** : 29 May 2024 - Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: PrtFilter )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.






Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<span style="color: orange;">●</span> 175.4	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image
PrtFilter				no image	no image

## GRAPHS

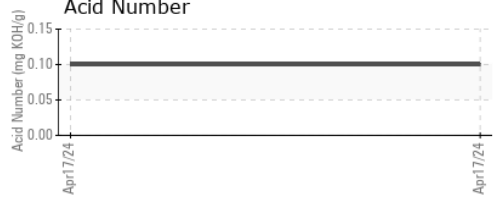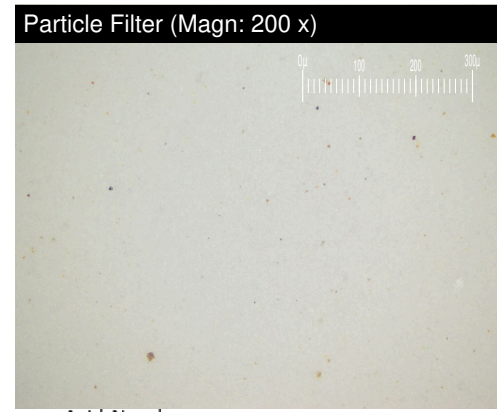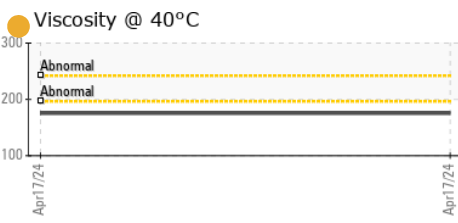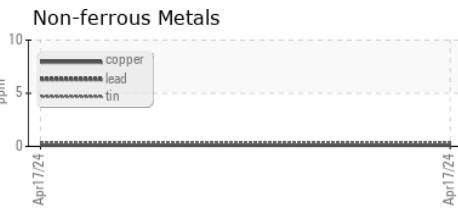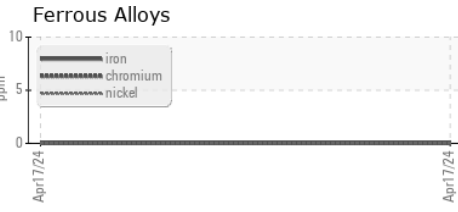

**HYDRADYNE LLC**  
 15050 FAA BLVD  
 FORT WORTH, TX  
 US 76155  
 Contact: REX WOODWARD  
 rwoodward@hydradynellc.com  
 T:  
 F: