

Machine Id
AC 62009 - COMP 1 (S/N 1001)
 Component
Air Compressor
 Fluid
TULCO LUBSOIL SYN FG COMPRESSOR 46 (45 GAL)

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		TO40000357	TO40000349	TO50000251
Sample Date	Client Info		10 May 2024	21 Mar 2024	22 Sep 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >4	<1	0	0
Nickel	ppm	ASTM D5185m >4	0	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	<1
Aluminum	ppm	ASTM D5185m >10	<1	1	0
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >40	5	7	5
Tin	ppm	ASTM D5185m >5	<1	<1	0
Antimony	ppm	ASTM D5185m	---	---	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	0	1	0
Calcium	ppm	ASTM D5185m	0	<1	0
Phosphorus	ppm	ASTM D5185m 325	127	104	53
Zinc	ppm	ASTM D5185m	22	46	49
Sulfur	ppm	ASTM D5185m	0	0	64


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	0
Sodium	ppm	ASTM D5185m	<1	1	0
Potassium	ppm	ASTM D5185m >20	0	2	<1
Water	%	ASTM D6304 >0.6	0.005	0.002	0.003
ppm Water	ppm	ASTM D6304 >6000	52	19	35.7

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		69712	---	10360
Particles >6µm	ASTM D7647 >1300		▲ 19423	---	1212
Particles >14µm	ASTM D7647 >80		▲ 972	---	47
Particles >21µm	ASTM D7647 >20		▲ 219	---	13
Particles >38µm	ASTM D7647 >4		▲ 7	---	0
Particles >71µm	ASTM D7647 >3		1	---	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	---	21/17/13


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.8	0.55	0.70	0.230

OIL ANALYSIS REPORT


▲ Particle Trend

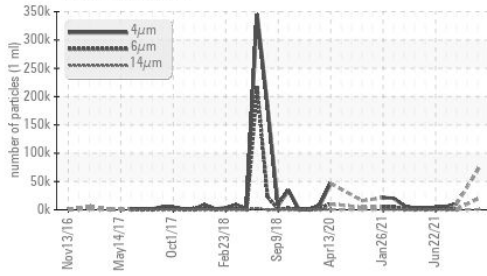


Water (KF)

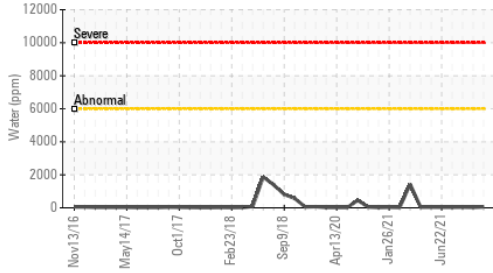


Viscosity @ 100°C

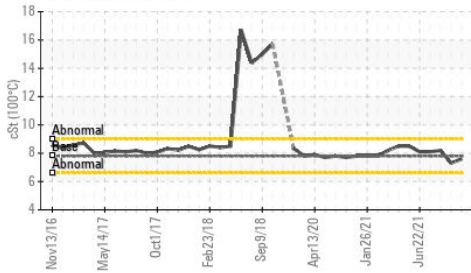

Water (KF)

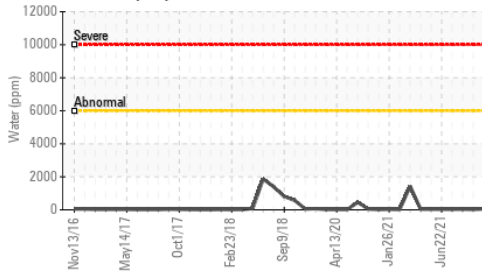

Viscosity @ 100°C

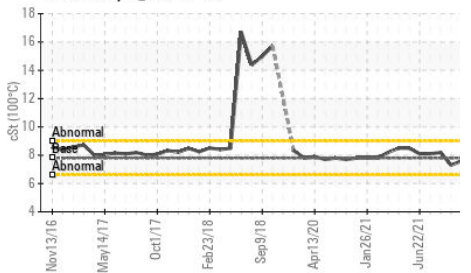


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.8	44.0	43.0
Visc @ 100°C	cSt	ASTM D445	7.8	7.6	7.3
Viscosity Index (VI)	Scale	ASTM D2270	146	140	133

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

Bottom

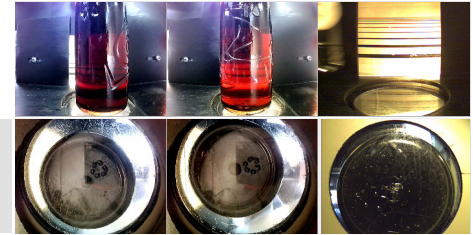


GRAPHS


Ferrous Alloys

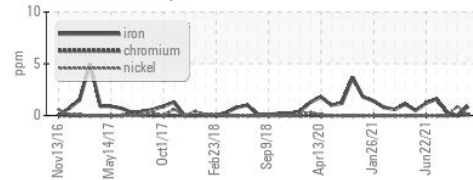


Non-ferrous Metals

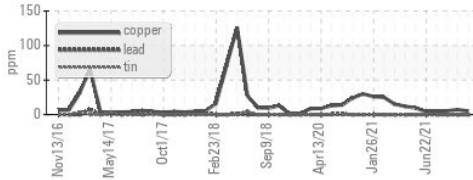


Viscosity @ 40°C

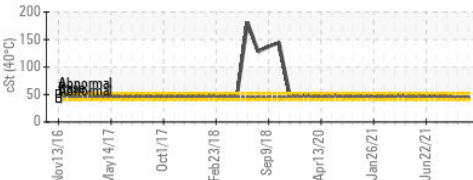

▲ Particle Count

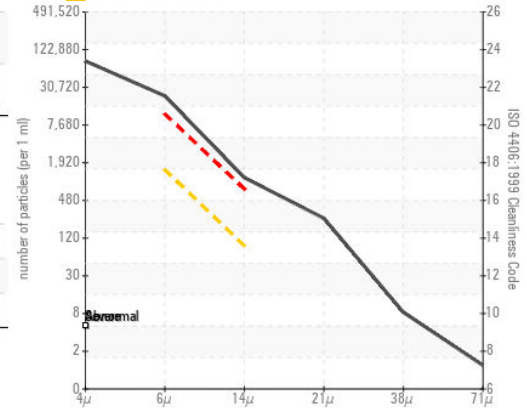

Acid Number

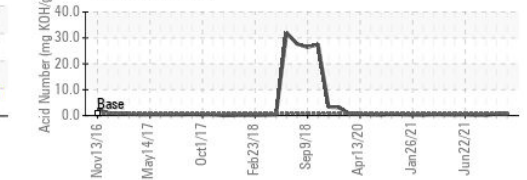

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO40000357
Lab Number : **06182802**
Unique Number : 11034128
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

Received : 17 May 2024
Tested : 22 May 2024
Diagnosed : 22 May 2024 - Don Baldrige

FRESH EXPRESS - MORROW
 1361 SOUTHERN ROAD
 MORROW, GA
 US 30260

Contact: FERNANDO VILLASENOR
 fvillasenor@freshexpress.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (678)422-4080

F: x: