




# OIL ANALYSIS REPORT

Sample Rating Trend

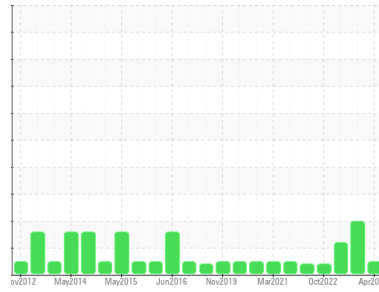

**NORMAL**



Area  
**ROTH ROCK [200005321]**  
 Machine Id  
**10WEA81550 (S/N 793000000439)**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**CASTROL OPTIGEAR SYNTHETIC A ISO 320 (500 LTR)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>NX016950</b>	NX012221	NX012220
Sample Date	Client Info		<b>16 Apr 2024</b>	06 Oct 2023	11 Apr 2023
Machine Age	mths	Client Info	<b>0</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>80	<b>18</b>	22	18	
Iron	ppm	ASTM D5185m	>150	<b>35</b>	61	70
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	1
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>4</b>	5	<1
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	2	<1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<b>0</b>	8	0
Barium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	1150	<b>928</b>	422	502
Manganese	ppm	ASTM D5185m		<b>1</b>	2	2
Magnesium	ppm	ASTM D5185m	1800	<b>1968</b>	1539	1585
Calcium	ppm	ASTM D5185m	20	<b>17</b>	13	12
Phosphorus	ppm	ASTM D5185m	1450	<b>1419</b>	1098	1149
Zinc	ppm	ASTM D5185m	1650	<b>1569</b>	1230	1280
Sulfur	ppm	ASTM D5185m	4900	<b>7169</b>	4820	5622

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>12</b>	8	9
Sodium	ppm	ASTM D5185m	>20	<b>5</b>	24	23
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	3
Water	%	ASTM D6304	>0.1	<b>0.024</b>	0.102	0.067
ppm Water	ppm	ASTM D6304	>1000	<b>244</b>	1020	674.1

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>3500</b>	3616	---
Particles >6µm	ASTM D7647	>2500	<b>583</b>	336	---
Particles >14µm	ASTM D7647	>320	<b>26</b>	21	---
Particles >21µm	ASTM D7647	>80	<b>5</b>	7	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/18/15	<b>19/16/12</b>	19/16/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	3.3	<b>2.62</b>	2.52	1.47




# OIL ANALYSIS REPORT

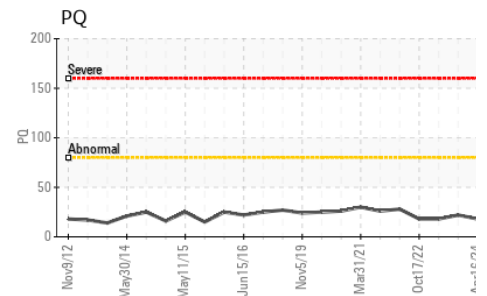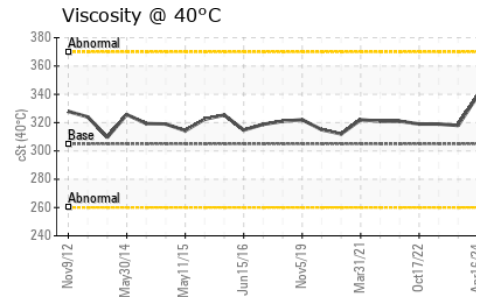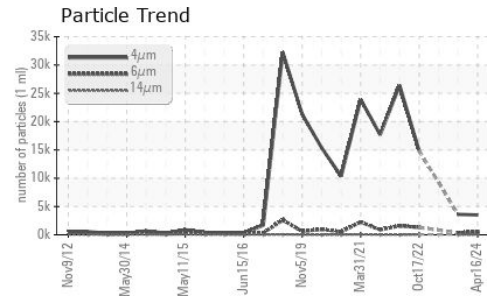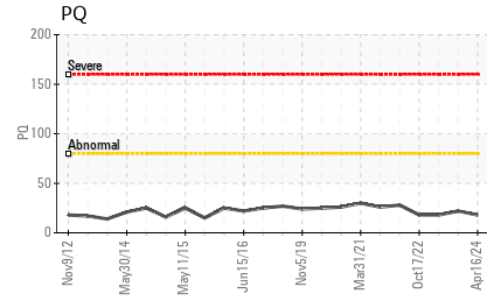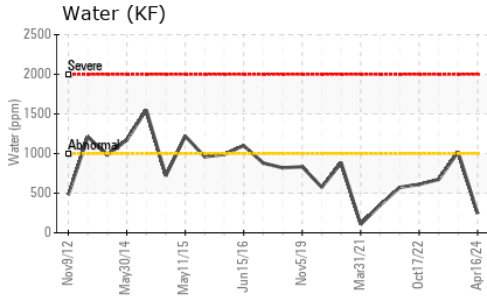






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ HEAVY
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	305	339	318

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

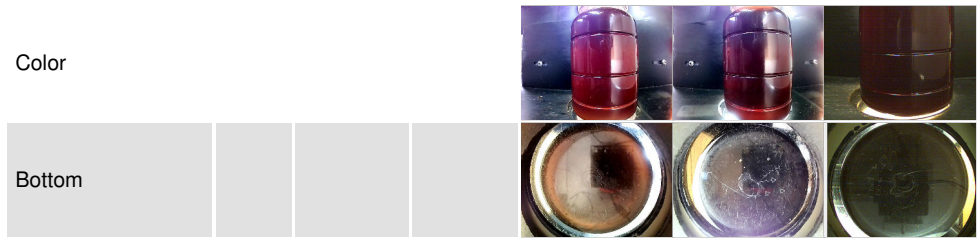

## GRAPHS

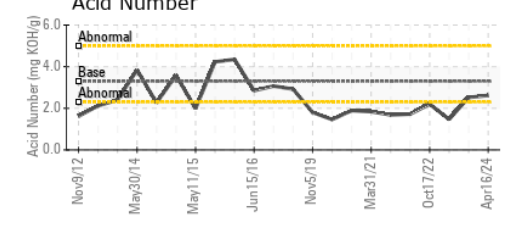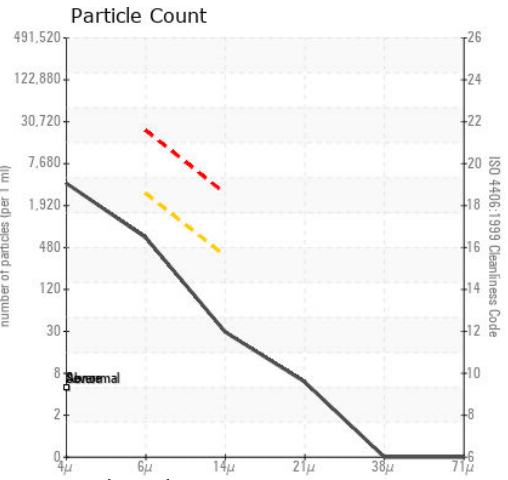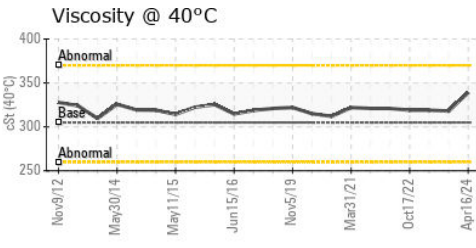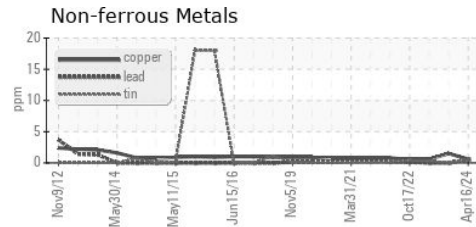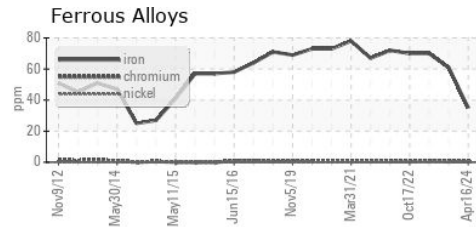

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX016950 **Received** : 17 May 2024  
**Lab Number** : 06182833 **Tested** : 22 May 2024  
**Unique Number** : 11034159 **Diagnosed** : 22 May 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - ROTH ROCK**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: ADAY MAGEC  
 aday.magec@gestampren.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)