




OIL ANALYSIS REPORT

Sample Rating Trend

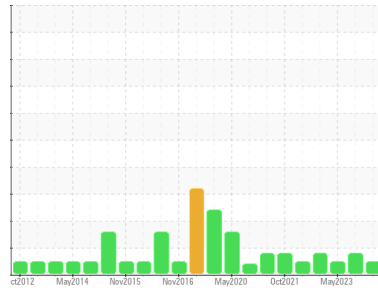

NORMAL



Area
ROTH ROCK [200005321]

Machine Id
18WEA81566

Component
Wind Turbine Gearbox

Fluid
CASTROL OPTIGEAR SYNTHETIC A ISO 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	NX016984	NX012189	NX012178
Sample Date	Client Info	24 Apr 2024	10 Oct 2023	11 May 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184	>80	19	29	14	
Iron	ppm	ASTM D5185m	>150	37	16	34
Chromium	ppm	ASTM D5185m	>5	<1	<1	<1
Nickel	ppm	ASTM D5185m	>10	0	0	<1
Titanium	ppm	ASTM D5185m	>10	<1	0	<1
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>10	5	▲ 15	<1
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>50	3	4	2
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	0	27	<1
Barium	ppm	ASTM D5185m	0	0	<1	0
Molybdenum	ppm	ASTM D5185m	1150	1143	1154	912
Manganese	ppm	ASTM D5185m		<1	1	<1
Magnesium	ppm	ASTM D5185m	1800	1832	1822	1545
Calcium	ppm	ASTM D5185m	20	4	21	86
Phosphorus	ppm	ASTM D5185m	1450	1401	1412	1175
Zinc	ppm	ASTM D5185m	1650	1632	1639	1239
Sulfur	ppm	ASTM D5185m	4900	6948	6281	6112

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	15	17	12
Sodium	ppm	ASTM D5185m	>20	4	3	7
Potassium	ppm	ASTM D5185m	>20	1	0	1
Water	%	ASTM D6304	>0.1	0.046	0.061	0.038
ppm Water	ppm	ASTM D6304	>1000	462	610	386.9

FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647		22374	26078	8448
Particles >6µm	ASTM D7647	>2500	1211	1869	1444
Particles >14µm	ASTM D7647	>320	19	8	56
Particles >21µm	ASTM D7647	>80	3	1	8
Particles >38µm	ASTM D7647	>20	1	0	1
Particles >71µm	ASTM D7647	>4	1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	22/17/11	22/18/10	20/18/13

FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	3.3	2.59	3.06	2.80




OIL ANALYSIS REPORT

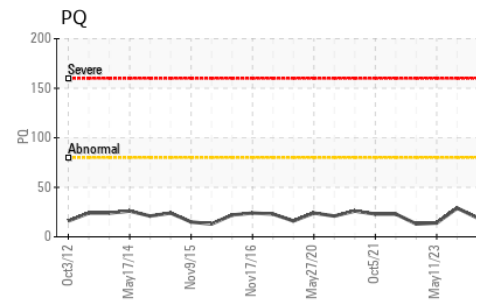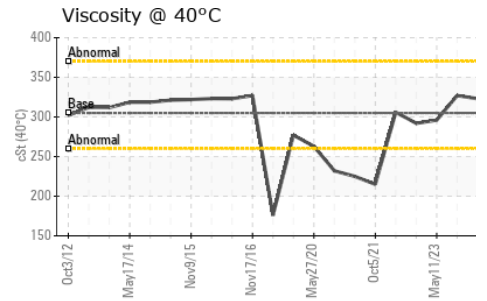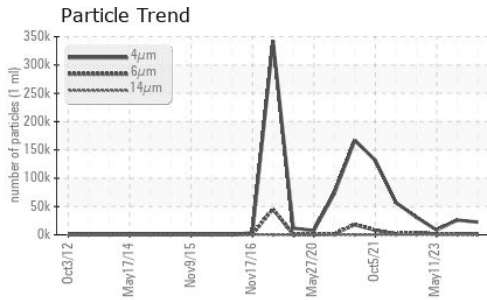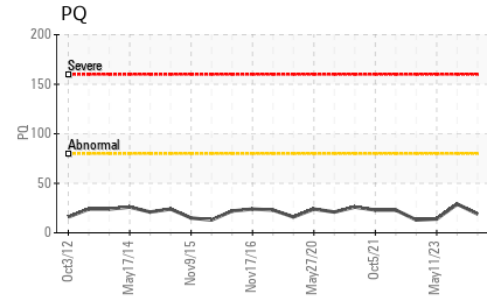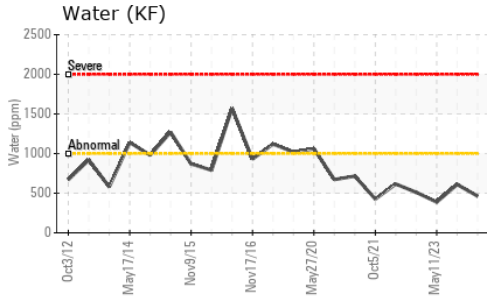






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 305	323	327	296

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

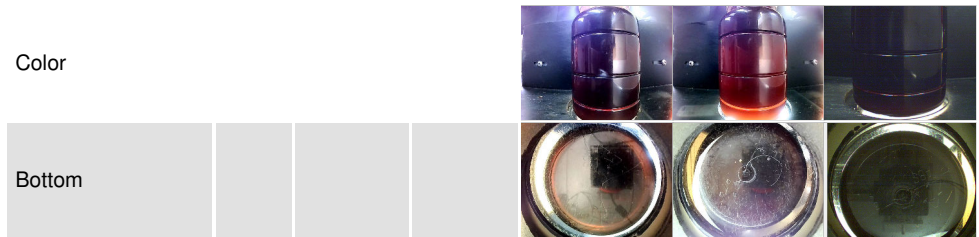

GRAPHS

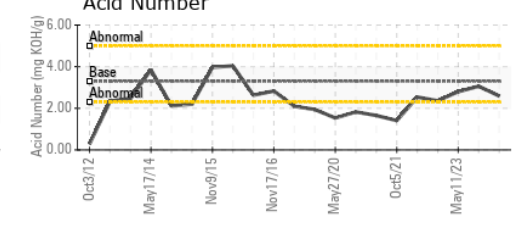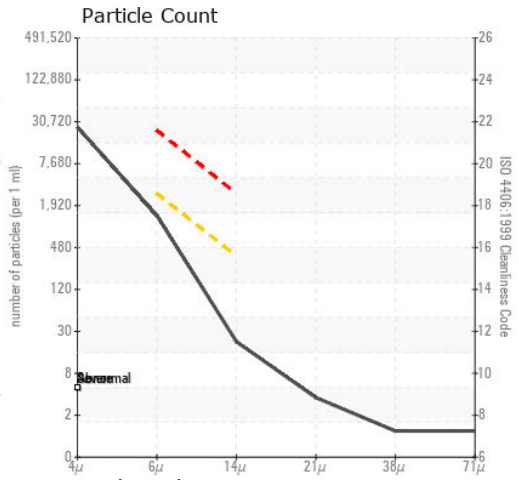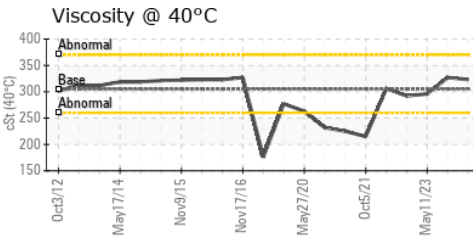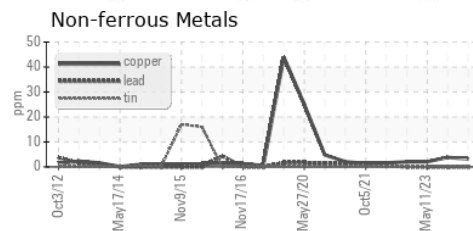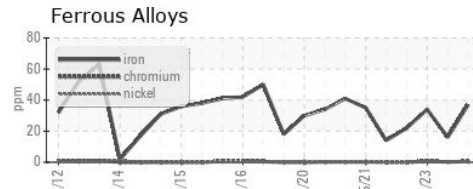

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : NX016984

Lab Number : 06182841

Unique Number : 11034167

Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 17 May 2024

Tested : 20 May 2024

Diagnosed : 21 May 2024 - Angela Borella

NORDEX USA - ROTH ROCK

300 SOUTH WACKER DRIVE, SUITE 1500

CHICAGO, IL

US 60606

Contact: ADAY MAGEC

aday.magec@gestampren.com

T:

F: (312)386-7102