




# OIL ANALYSIS REPORT

## Sample Rating Trend

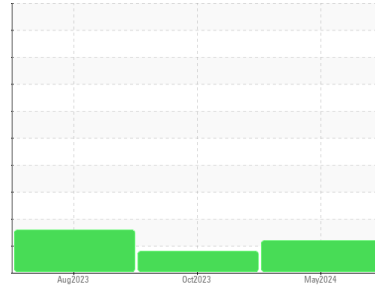

ISO



Machine Id

## SIEMENS GEG 1

Component

Gas Turbine

Fluid

PETRO CANADA SENTRON LD 8000 (774 LTR)

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM6182874</b>	USP255113	USP255108
Sample Date	Client Info	<b>16 May 2024</b>	10 Oct 2023	10 Aug 2023
Machine Age	hrs	Client Info	1728	765
Oil Age	hrs	Client Info	1628	0
Oil Changed	Client Info	<b>N/A</b>	Changed	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >15	<b>8</b>	5	4
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	2	2
Lead	ppm	ASTM D5185m	<b>1</b>	0	0
Copper	ppm	ASTM D5185m >5	<b>&lt;1</b>	1	2
Tin	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	15	10
Calcium	ppm	ASTM D5185m 1351	<b>1686</b>	1652	1615
Phosphorus	ppm	ASTM D5185m 302	<b>299</b>	331	304
Zinc	ppm	ASTM D5185m 358	<b>391</b>	432	376
Sulfur	ppm	ASTM D5185m 2758	<b>3387</b>	3207	3672

### CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>2</b>	3	3
Sodium	ppm	ASTM D5185m	<b>6</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	0
Water	%	ASTM D6304 >0.03	<b>0.054</b>	0.048	0.043
ppm Water	ppm	ASTM D6304 >300	<b>548</b>	487.1	435.2

### FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >2500	<b>▲ 351909</b>	---	▲ 180114
Particles >6µm	ASTM D7647 >640	<b>▲ 61125</b>	---	▲ 19084
Particles >14µm	ASTM D7647 >80	<b>77</b>	---	▲ 87
Particles >21µm	ASTM D7647 >20	<b>11</b>	---	15
Particles >38µm	ASTM D7647 >4	<b>0</b>	---	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c) >18/16/13	<b>▲ 26/23/13</b>	---	▲ 25/21/14

### FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	<b>2.50</b>	1.60	0.79




# OIL ANALYSIS REPORT

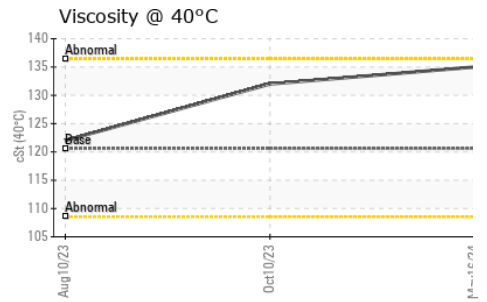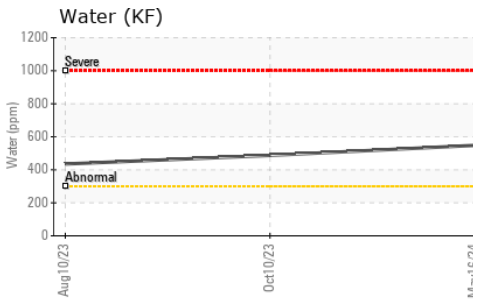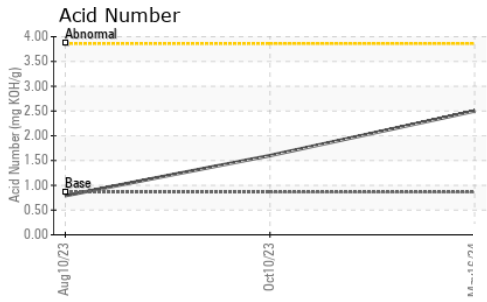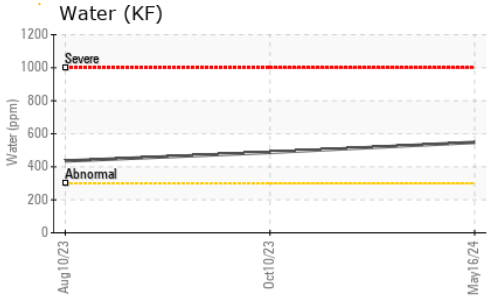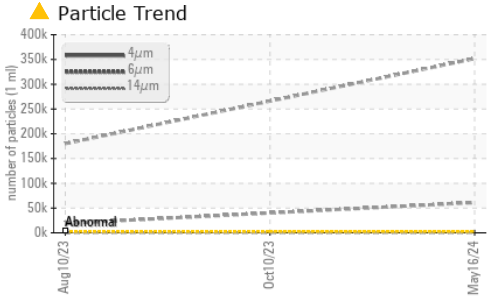





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	120.6	135	132

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

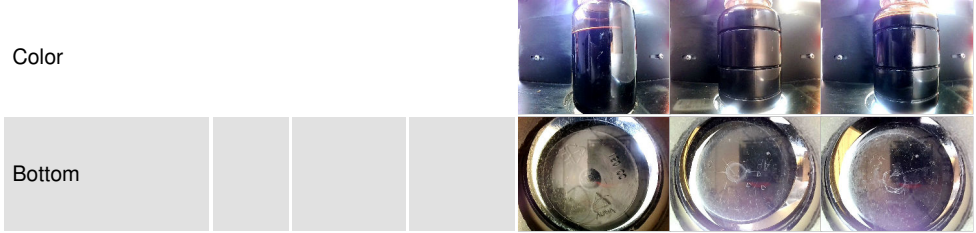

## GRAPHS

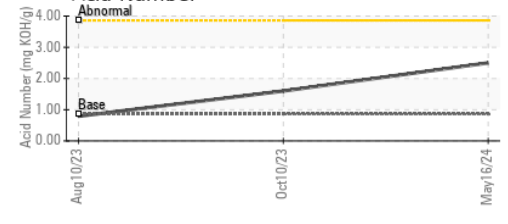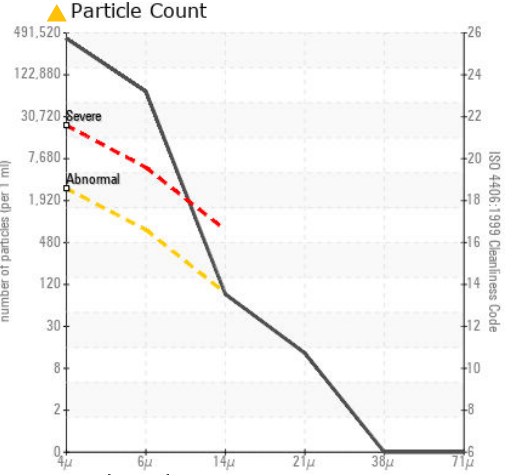

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM6182874      **Received** : 17 May 2024  
**Lab Number** : **06182874**      **Tested** : 29 May 2024  
**Unique Number** : 11034200      **Diagnosed** : 29 May 2024 - Angela Borella  
**Test Package** : IND 2

**DCO-SIEMENS ENERGY**  
 CORINASO PT PSC 1005 BOX 68  
 GUANTANAMO BAY, UT  
 US 34009  
 Contact: BARBARA DORSEY

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)