


OIL ANALYSIS REPORT

Sample Rating Trend

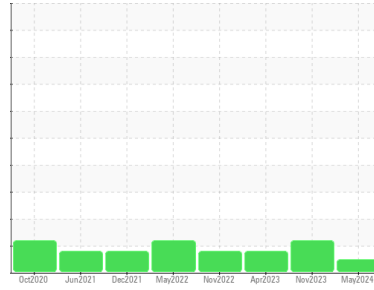

NORMAL

Area
Marcus Hook/Cryogenic/Compressor
 Machine Id
CRYOGENIC COMPRESSOR 40-C-301C
 Component
Rotary Compressor
 Fluid
FRICK COMPRESSOR OIL #12B (385 GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 The amount and size of particulates present in the system are acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO60001793	TO60001827	TO90003045
Sample Date	Client Info			09 May 2024	05 Nov 2023	25 Apr 2023
Machine Age	hrs Client Info			0	0	0
Oil Age	hrs Client Info			0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	7	4	6
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>4	<1	0	0
Copper	ppm	ASTM D5185m	>20	<1	0	0
Tin	ppm	ASTM D5185m	>3	3	2	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	<1	<1
Calcium	ppm	ASTM D5185m		131	126	126
Phosphorus	ppm	ASTM D5185m		0	10	9
Zinc	ppm	ASTM D5185m		0	0	2
Sulfur	ppm	ASTM D5185m		281	332	288

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>45	4	4	4
Sodium	ppm	ASTM D5185m		1	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>0.6	0.031	0.050	0.014
ppm Water	ppm	ASTM D6304		320	507.5	141.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	1186	▲ 6272	1429
Particles >6µm		ASTM D7647	>320	261	▲ 1183	● 387
Particles >14µm		ASTM D7647	>80	12	25	28
Particles >21µm		ASTM D7647	>20	4	3	8
Particles >38µm		ASTM D7647	>4	0	0	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>18/15/13	17/15/11	▲ 20/17/12	● 18/16/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.095	0.083	0.115

OIL ANALYSIS REPORT

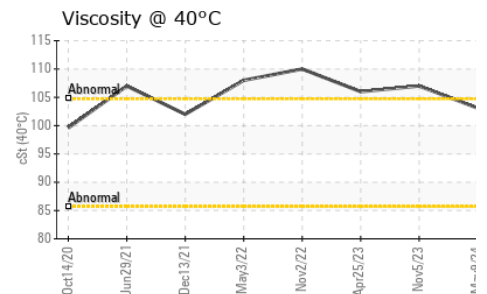
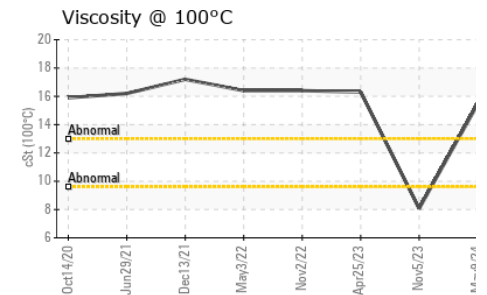
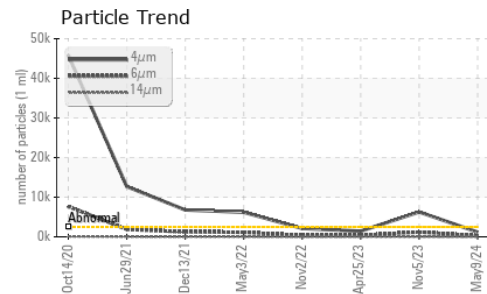
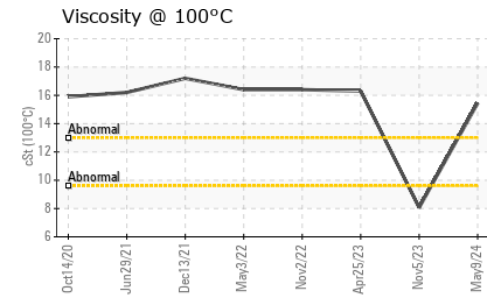
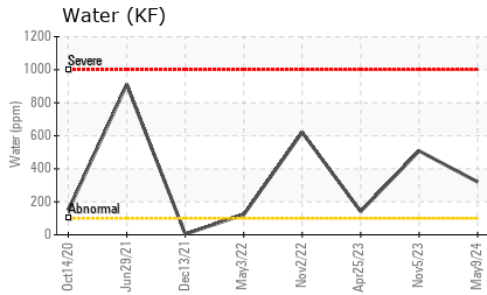


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	103.1	107.0	106
Visc @ 100°C	cSt	ASTM D445	15.44	8.07	16.3
Viscosity Index (VI)	Scale	ASTM D2270	158	---	165

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

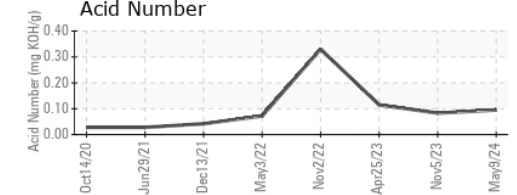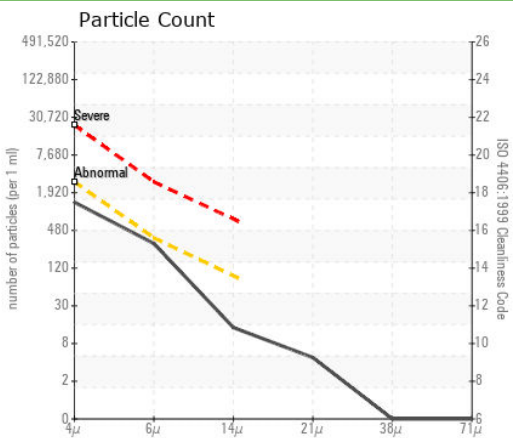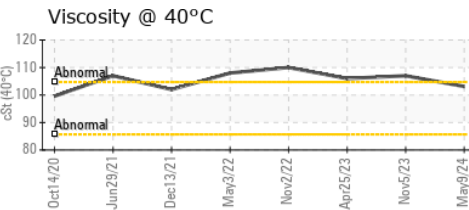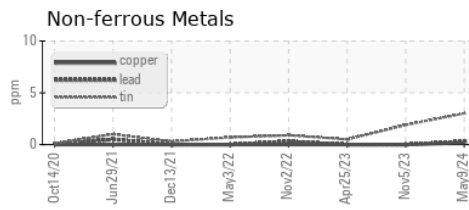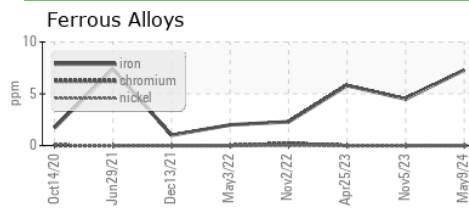

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001793
Lab Number : 06182914
Unique Number : 11034240
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

Received : 17 May 2024
Tested : 28 May 2024
Diagnosed : 28 May 2024 - Angela Borella

ENERGY TRANSFER - MARCUS HOOK
 2ND & GREEN STREETS
 MARCUS HOOK, PA
 US 19061
 Contact: CHRISTOPHER HOFFA
 christopher.hoffa@energytransfer.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)