


# OIL ANALYSIS REPORT

Sample Rating Trend

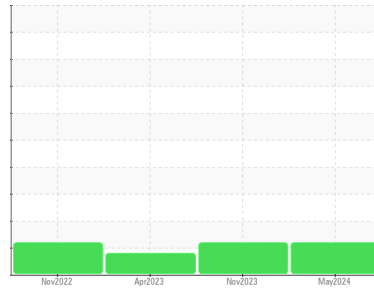

Area  
**Marcus Hook/Cryogenic/Compressor**  
 Machine Id  
**CRYOGENIC COMPRESSOR 30-C-201A**  
 Component  
**Rotary Compressor**  
 Fluid  
**FRICK 18 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. Resample at the next service interval to monitor. ( Customer Sample Comment: Frick #18 )

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>TO90000680</b>	TO60001812	TO90003021
Sample Date	Client Info		<b>09 May 2024</b>	05 Nov 2023	25 Apr 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ATTENTION

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >70	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >4	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >3	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>22</b>	44	42
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	0


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >45	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Water	%	ASTM D6304 >0.6	<b>0.002</b>	0.003	0.002
ppm Water	ppm	ASTM D6304	<b>18</b>	31.8	24.4

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>3446</b>	7090	2469
Particles >6µm	ASTM D7647	>320	<b>707</b>	1362	601
Particles >14µm	ASTM D7647	>80	<b>26</b>	30	29
Particles >21µm	ASTM D7647	>20	<b>6</b>	5	6
Particles >38µm	ASTM D7647	>4	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/15/13	<b>19/17/12</b>	20/18/12	18/16/12


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.083</b>	0.057	0.074

# OIL ANALYSIS REPORT


### ▲ Particle Trend

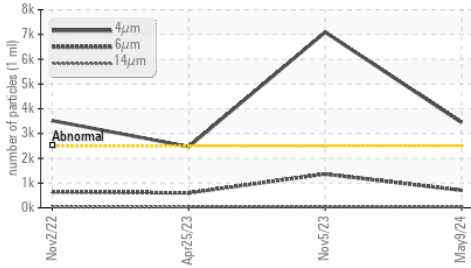


### Water (KF)

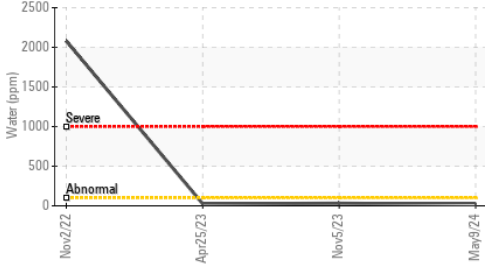


### Viscosity @ 100°C

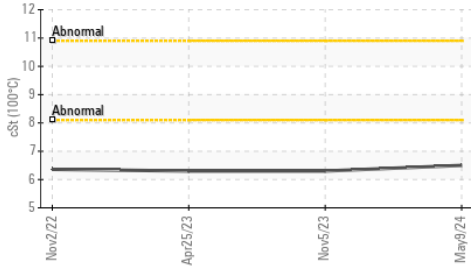

### Water (KF)

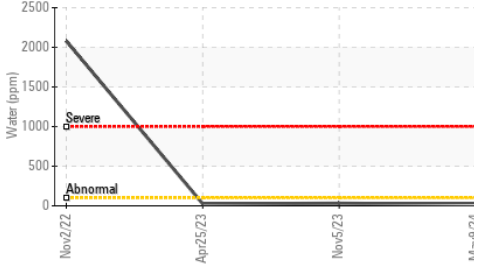


### Viscosity @ 100°C

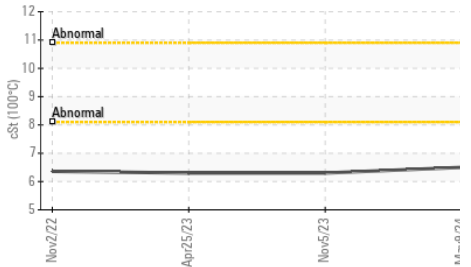

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.7	32.2	32.2
Visc @ 100°C	cSt	ASTM D445	6.5	6.3	6.3
Viscosity Index (VI)	Scale	ASTM D2270	157	150	150

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

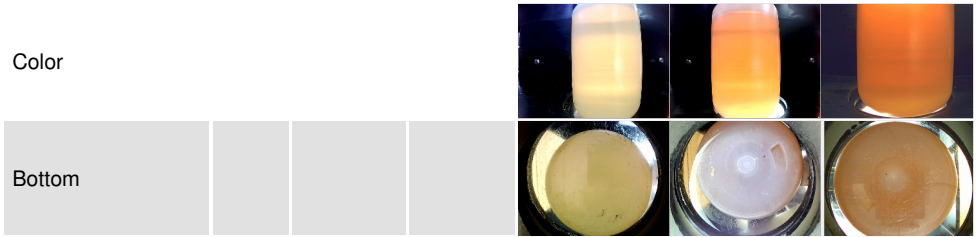


### GRAPHS


#### Ferrous Alloys

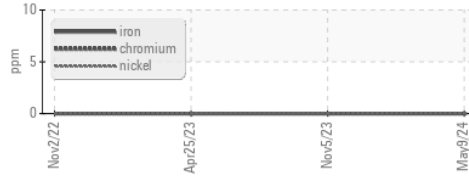


#### Non-ferrous Metals

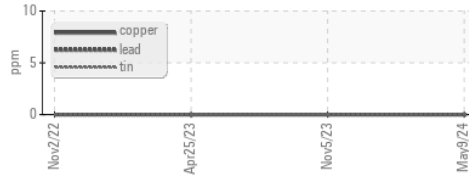


#### Viscosity @ 40°C

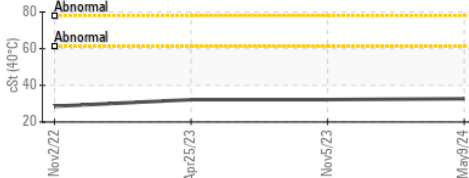

#### ▲ Particle Count

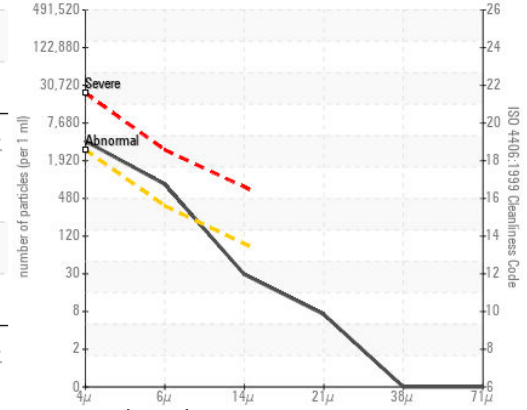

#### Acid Number

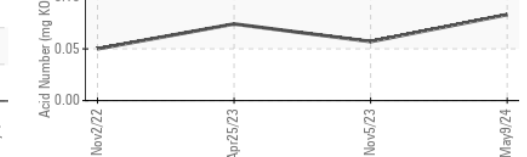

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO90000680 **Received** : 17 May 2024  
**Lab Number** : 06182938 **Tested** : 20 May 2024  
**Unique Number** : 11034264 **Diagnosed** : 21 May 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**ENERGY TRANSFER - MARCUS HOOK**  
 2ND & GREEN STREETS  
 MARCUS HOOK, PA  
 US 19061  
 Contact: CHRISTOPHER HOFFA  
 christopher.hoffa@energytransfer.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)