OIL ANALYSIS REPORT

Sample Rating Trend

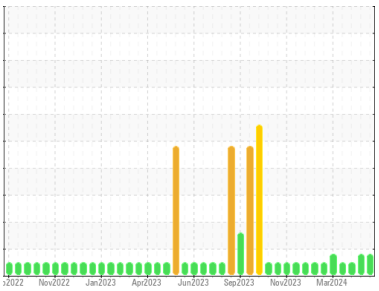

WEAR

Machine Id
Coopersville CAT 7 CPVM07BE
Component
Biogas Engine
Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (125 GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
The tin level is abnormal. All other component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0871577**	WC0871570	WC0871567
Sample Date		Client Info		**14 May 2024**	02 May 2024	24 Apr 2024
Machine Age	hrs	Client Info		**108841**	108556	108368
Oil Age	hrs	Client Info		**497**	212	24
Oil Changed		Client Info		**Not Changd**	Not Changd	Changed
Sample Status				**ABNORMAL**	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method		**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>14	**<1**	0	1
Chromium	ppm	ASTM D5185m	>3	**0**	<1	0
Nickel	ppm	ASTM D5185m		**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>5	**2**	2	1
Lead	ppm	ASTM D5185m	>8	**<1**	<1	1
Copper	ppm	ASTM D5185m	>5	**2**	<1	<1
Tin	ppm	ASTM D5185m	>3	▲ **4**	▲ 4	2
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**75**	3	3
Barium	ppm	ASTM D5185m		**0**	<1	0
Molybdenum	ppm	ASTM D5185m		**4**	1	1
Manganese	ppm	ASTM D5185m		**<1**	<1	<1
Magnesium	ppm	ASTM D5185m		**0**	5	5
Calcium	ppm	ASTM D5185m		**1648**	1791	1702
Phosphorus	ppm	ASTM D5185m		**343**	270	254
Zinc	ppm	ASTM D5185m		**412**	320	306
Sulfur	ppm	ASTM D5185m		**2960**	2392	2038

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>180	**100**	98	46
Sodium	ppm	ASTM D5185m	>20	**<1**	0	<1
Potassium	ppm	ASTM D5185m	>20	**0**	<1	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0**	0	0
Nitration	Abs/cm	*ASTM D7624		**5.7**	6.0	5.2
Sulfation	Abs/.1mm	*ASTM D7415		**19.1**	17.5	15.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**13.0**	10.4	8.3
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.82**	0.70	0.591
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	**4.48**	4.45	4.67

OIL ANALYSIS REPORT

Non-ferrous Metals

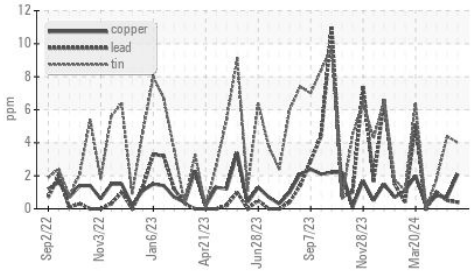

FT-IR (Direct Trend)

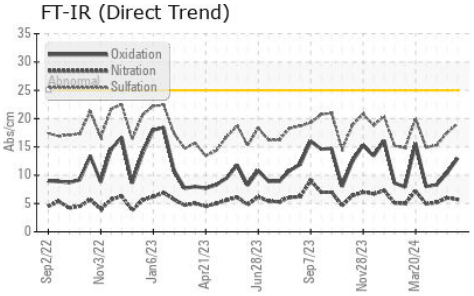

Acid Number

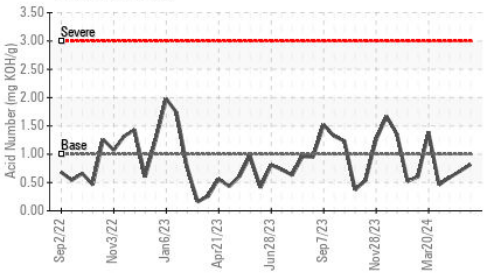

Base Number

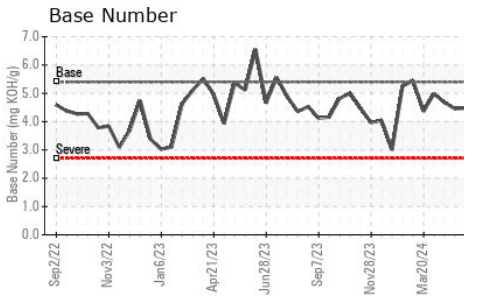

Viscosity @ 100°C

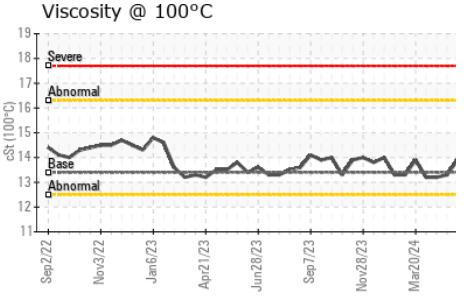

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual		**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	**13.9**	13.3	13.2

GRAPHS

Iron (ppm)

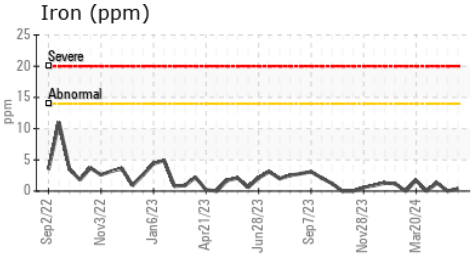

Lead (ppm)

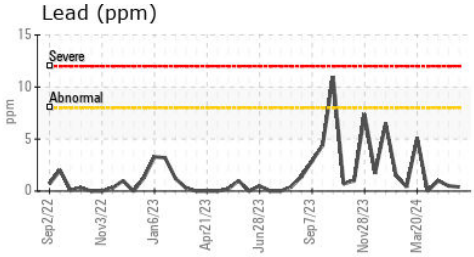

Aluminum (ppm)

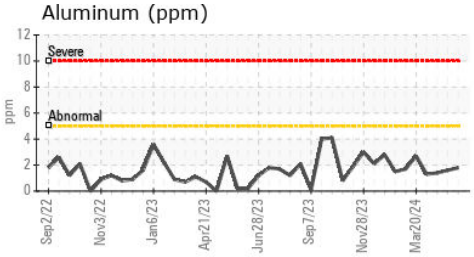

Chromium (ppm)

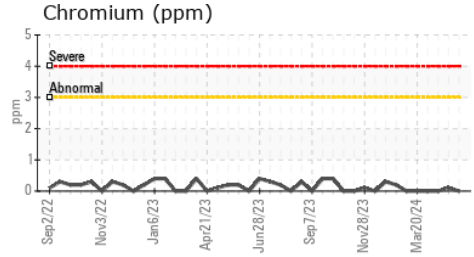

Copper (ppm)

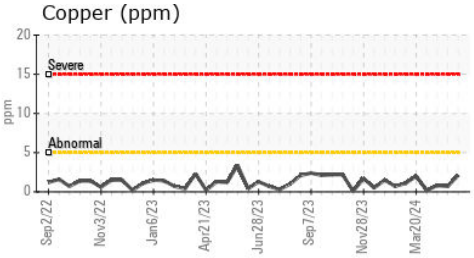

Silicon (ppm)

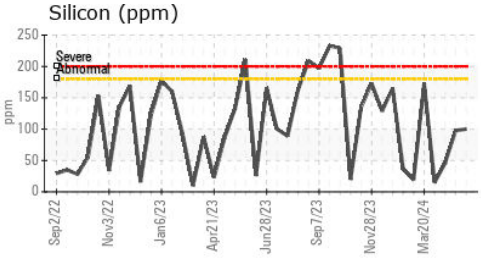

Viscosity @ 100°C

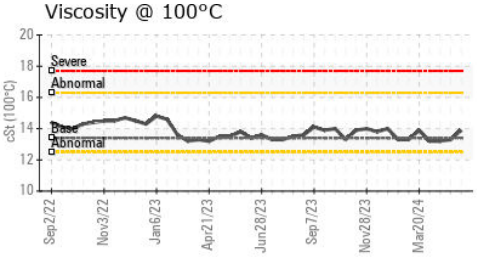

Base Number

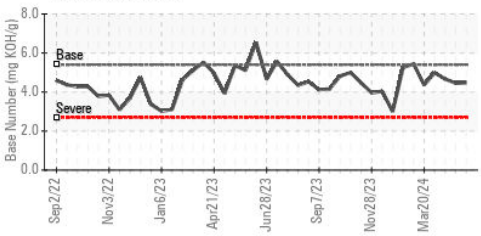

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0871577
Lab Number : 06183051
Unique Number : 11034377
Test Package : MOB 2

Received : 17 May 2024
Tested : 20 May 2024
Diagnosed : 20 May 2024 - Sean Felton

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Coopersville
Coopersville Powerstation, 15362 68th Avenue
Coopersville, MI
US 49404
Contact: Daniel Young
daniel.young@edlenergy.com
T:
F: