




OIL ANALYSIS REPORT

Sample Rating Trend

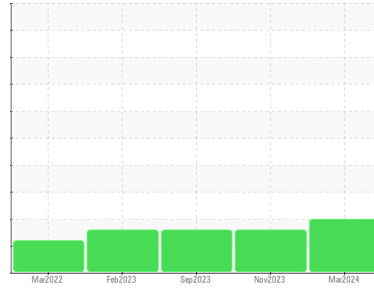

ISO



Machine Id

KAESER 7919042

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	KC128397	KC121109	KC124464	
Sample Date	Client Info	20 Mar 2024	15 Nov 2023	13 Sep 2023	
Machine Age	hrs	Client Info	13616	12472	11275
Oil Age	hrs	Client Info	1000	0	0
Oil Changed	Client Info	Not Chngd	N/A	N/A	
Sample Status		ABNORMAL	ATTENTION	ABNORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	3	0
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	2	<1	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	8	11	12
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	43	0	0
Molybdenum	ppm	ASTM D5185m	<1	3	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	68	23	<1
Calcium	ppm	ASTM D5185m 2	9	<1	0
Phosphorus	ppm	ASTM D5185m	5	0	0
Zinc	ppm	ASTM D5185m	13	27	12

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	1	0	<1
Sodium	ppm	ASTM D5185m	19	21	17
Potassium	ppm	ASTM D5185m >20	4	0	5
Water	%	ASTM D6304 >0.05	0.046	0.008	▲ 0.125
ppm Water	ppm	ASTM D6304 >500	465	85	▲ 1250






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	6853	3759	2932
Particles >6µm	ASTM D7647 >1300	▲ 1690	● 1343	325
Particles >14µm	ASTM D7647 >80	▲ 405	● 106	17
Particles >21µm	ASTM D7647 >20	▲ 200	● 25	5
Particles >38µm	ASTM D7647 >4	▲ 24	1	0
Particles >71µm	ASTM D7647 >3	▲ 1	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/16	● 19/18/14	19/16/11

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.26	0.25


OIL ANALYSIS REPORT

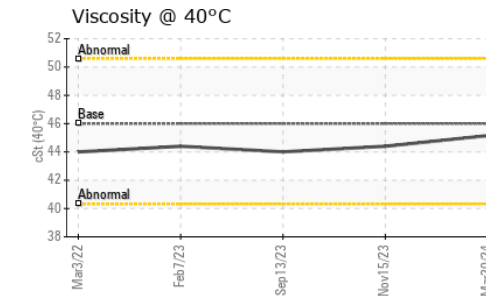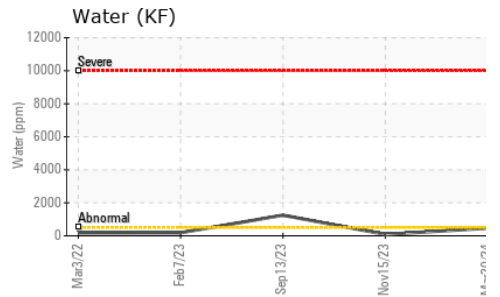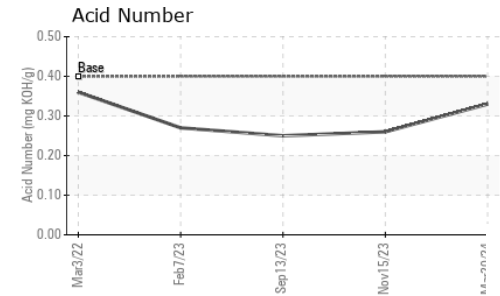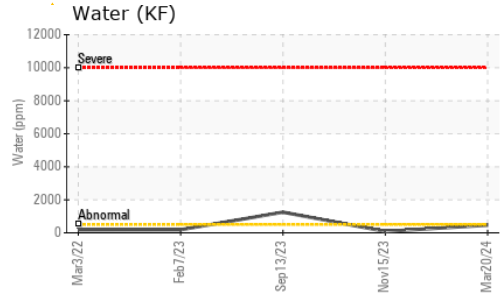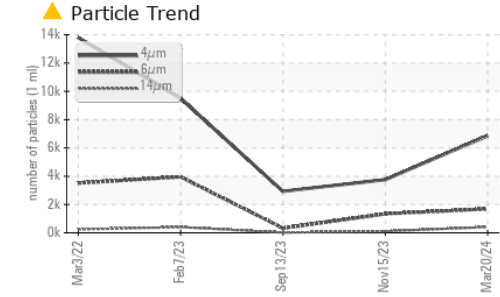





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.15	44.4	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

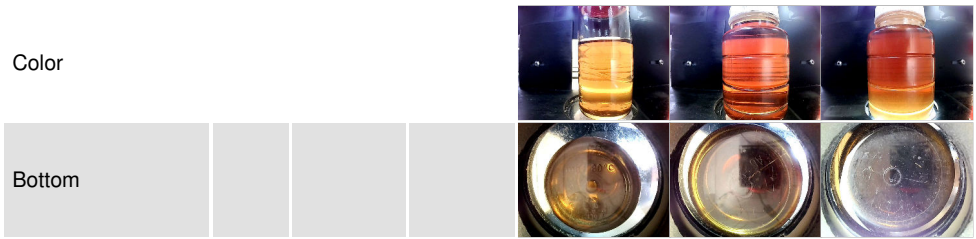

GRAPHS

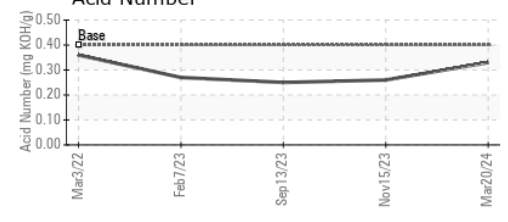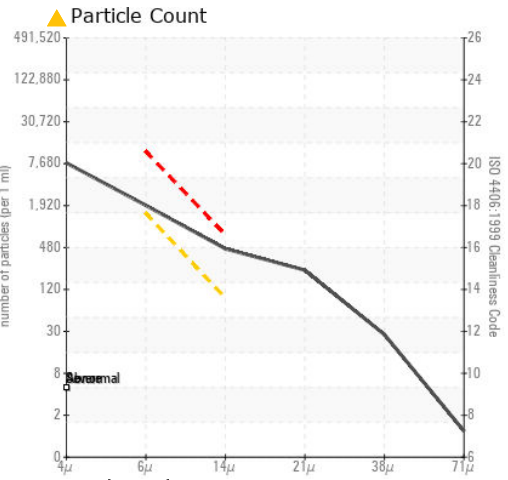

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC128397
Lab Number : 06183331
Unique Number : 11034657
Test Package : IND 2
Received : 17 May 2024
Tested : 29 May 2024
Diagnosed : 29 May 2024 - Don Baldrige

NATIONAL EXPOSURE TESTING
 3211 CENTENNIAL RD
 SYLVANIA, OH
 US 43560
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)