

## **OIL ANALYSIS REPORT**

KAESER SFC 110 6104532 (S/N 1002)

Sample Rating Trend

ISO

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

### DIAGNOSIS

Machine Id

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination


There is a high amount of particulates present in the oil.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129930	KC106839	KC111409
Sample Date		Client Info		11 Apr 2024	20 Nov 2023	23 Jun 2023
Machine Age	hrs	Client Info		29503	27435	25216
Oil Age	hrs	Client Info		2067	6863	3342
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3	5	2
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	<1
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	1
Lead	ppm	ASTM D5185m	>10	- <1	0	0
Copper	ppm	ASTM D5185m	>50	10	10	18
Tin	ppm	ASTM D5185m	>10	1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES	pp	method	limit/bass		-	-
			limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	10	0	0
Molybdenum	ppm	ASTM D5185m		<1	3	0
Manganese	ppm	ASTM D5185m		3	2	2
Magnesium	ppm	ASTM D5185m	90	52	16	21
Calcium	ppm	ASTM D5185m	2	6	0	0
Phosphorus	ppm	ASTM D5185m		6	0	2
Zinc	ppm	ASTM D5185m		30	22	30
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	<1
Sodium	ppm	ASTM D5185m		18	9	7
Potassium	ppm	ASTM D5185m	>20	4	0	<1
Water	%	ASTM D6304	>0.05	0.022	0.008	0.013
ppm Water	ppm	ASTM D6304	>500	224	89	134.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14437	2099	
Particles >6µm		ASTM D7647	>1300	<b>A</b> 3280	375	
Particles >14µm		ASTM D7647	>80	<b>A</b> 389	28	
Particles >21µm		ASTM D7647	>20	🔺 151	7	
Particles >38µm		ASTM D7647	>4	<mark>/</mark> 8	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>1/19/16</b>	18/16/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.37	0.39















# **OIL ANALYSIS REPORT**

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	🔺 MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
FLUID PROPERT Visc @ 40°C	IES cSt	method ASTM D445	limit/base 46	current 44.3	history1 44.0	history2 43.8
	cSt					
Visc @ 40°C	cSt	ASTM D445	46	44.3	44.0	43.8

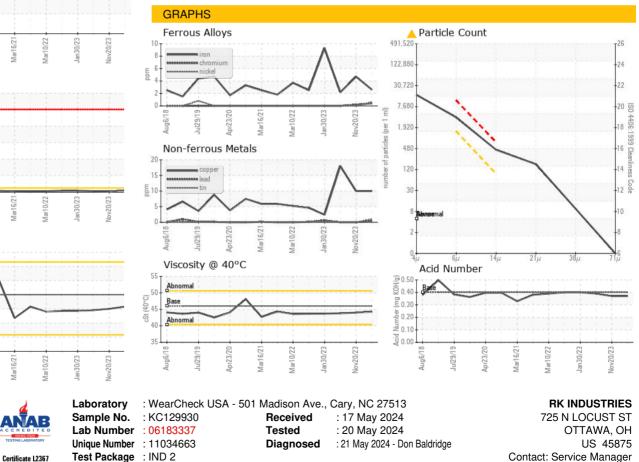

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F:

Contact/Location: Service Manager - RKIOTT Page 2 of 2