




OIL ANALYSIS REPORT

Sample Rating Trend

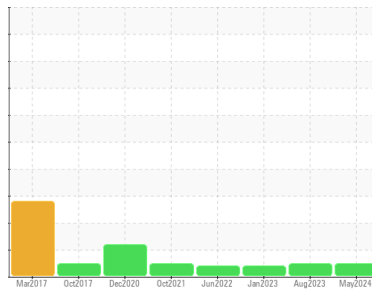

Machine Id
KAESER ASD 40T 5732162 (S/N 1206)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCA012567	KCPA002957	KCP54925
Sample Date	Client Info		03 May 2024	15 Aug 2023	16 Jan 2023
Machine Age	hrs	Client Info	62626	56625	52553
Oil Age	hrs	Client Info	0	7997	1478
Oil Changed	Client Info		Not Changed	Changed	Not Changed
Sample Status			NORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	0	0
Chromium	ppm	ASTM D5185m >5	<1	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	<1	0	0
Aluminum	ppm	ASTM D5185m >15	2	0	0
Lead	ppm	ASTM D5185m >65	<1	0	0
Copper	ppm	ASTM D5185m >65	12	22	21
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 100	14	0	6
Calcium	ppm	ASTM D5185m 0	4	0	0
Phosphorus	ppm	ASTM D5185m 0	5	0	0
Zinc	ppm	ASTM D5185m 0	39	7	40

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	1	1	0
Sodium	ppm	ASTM D5185m	4	2	1
Potassium	ppm	ASTM D5185m >20	2	0	0
Water	%	ASTM D6304 >0.1	0.012	0.007	0.009
ppm Water	ppm	ASTM D6304 >1000	126	75.1	96.4






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		3789	3707	---
Particles >6µm	ASTM D7647 >2500		655	1669	---
Particles >14µm	ASTM D7647 >320		115	281	---
Particles >21µm	ASTM D7647 >80		51	89	---
Particles >38µm	ASTM D7647 >20		3	2	---
Particles >71µm	ASTM D7647 >4		0	0	---
Oil Cleanliness	ISO 4406 (c) >18/15		17/14	19/18/15	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.43	0.41	0.36


OIL ANALYSIS REPORT

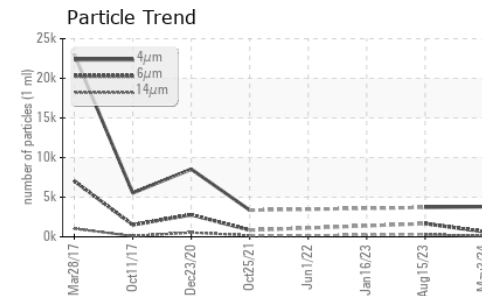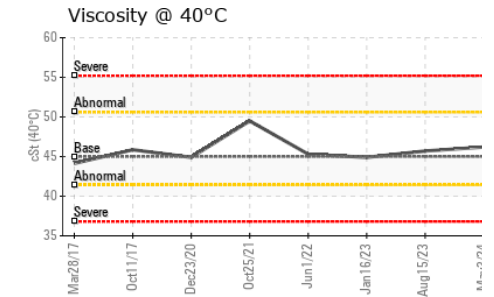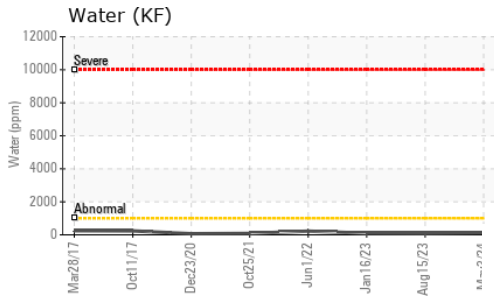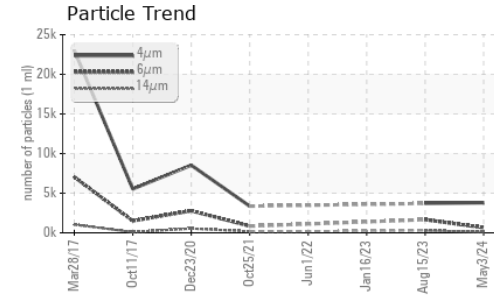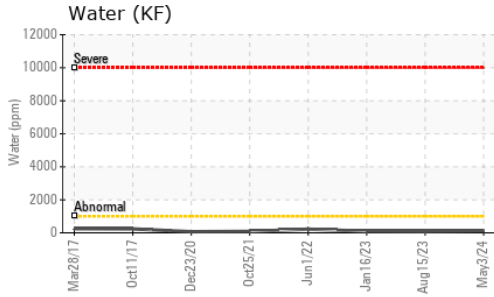






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	46.2	45.7	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

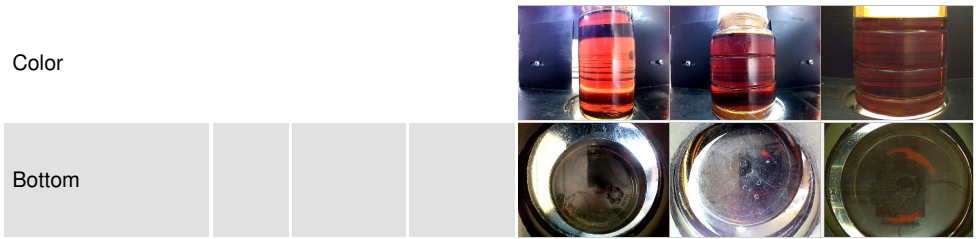

GRAPHS

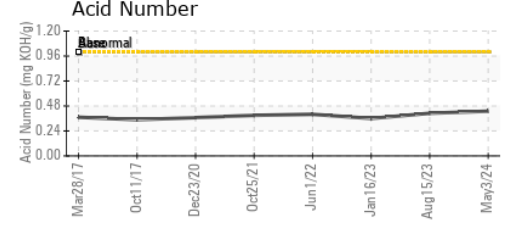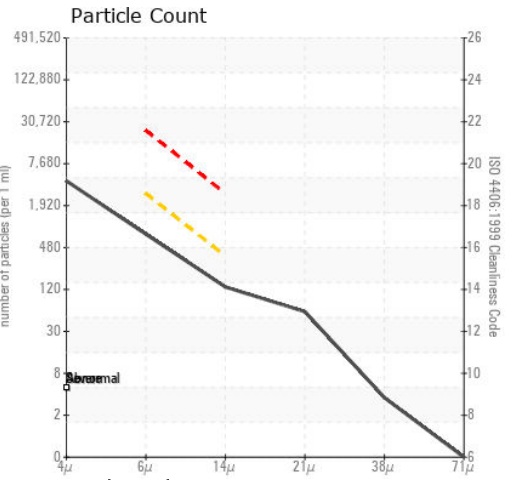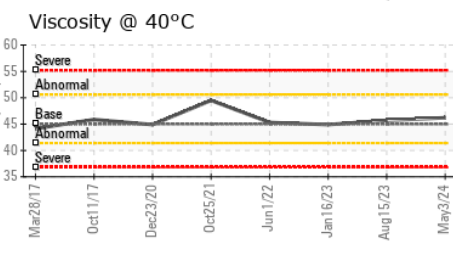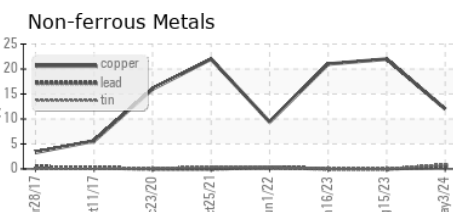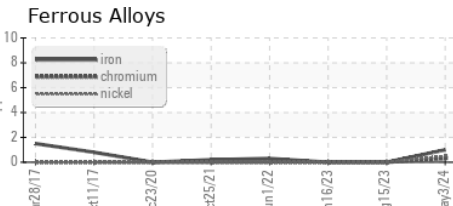

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCA012567
Lab Number : 06183338
Unique Number : 11034664
Test Package : IND 2
Received : 17 May 2024
Tested : 20 May 2024
Diagnosed : 21 May 2024 - Don Baldrige

84 LUMBER
 71 RIVERSIDE DR SW
 CARTERSVILLE, GA
 US 30120
 Contact: CARROL NANCE
 carrol.nance@84lumber.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)