


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER 7499718

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Арі	2021	Apr2022 May20:	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012551	KC97414	KC89862
Sample Date		Client Info		09 May 2024	26 Apr 2022	19 Apr 2021
Machine Age	hrs	Client Info		17177	6786	2767
Oil Age	hrs	Client Info		2632	4019	2767
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	0
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	9	13	11
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	11
Barium	ppm	ASTM D5185m	90	21	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	50	15	32
Calcium	ppm	ASTM D5185m	2	6	0	0
Phosphorus	ppm	ASTM D5185m		5	6	7
Zinc	ppm	ASTM D5185m		17	41	23
Sulfur	ppm	ASTM D5185m		21904	15388	17177
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	3	3
Sodium	ppm	ASTM D5185m		17	13	12
Potassium	ppm	ASTM D5185m	>20	4	3	6
Water	%	ASTM D6304	>0.05	0.017	0.013	△ 0.469
ppm Water	ppm	ASTM D6304	>500	175	133.9	4690
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1634		
Particles >6µm		ASTM D7647	>1300	414		
Particles >14μm		ASTM D7647	>80	36		
Particles >21µm		ASTM D7647	>20	15		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.33



OIL ANALYSIS REPORT

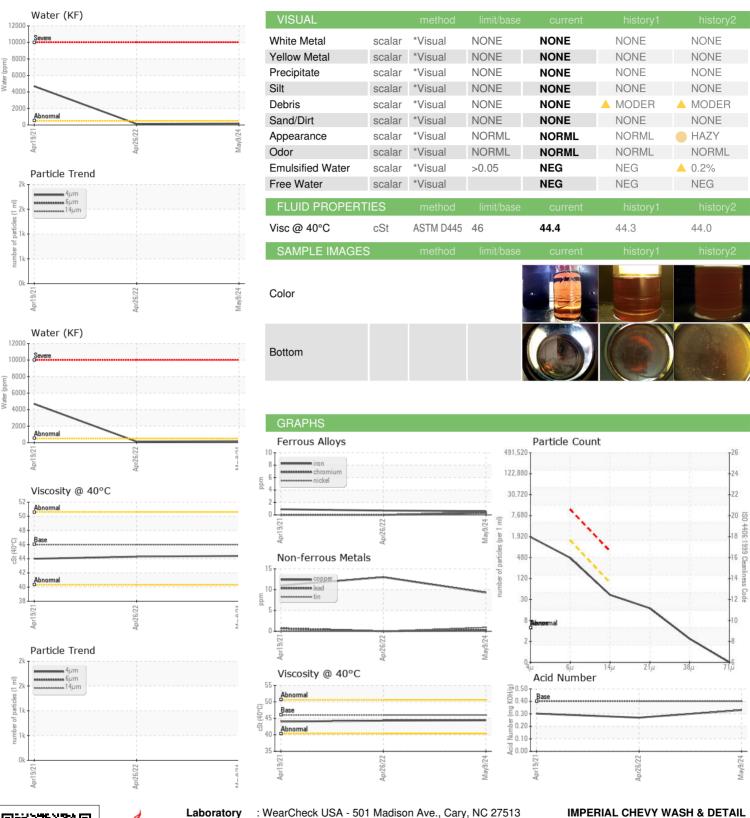





Laboratory Sample No.

: KCPA012551 Lab Number : 06183339 Unique Number : 11034665

Received : 17 May 2024 **Tested** Diagnosed

: 20 May 2024 : 21 May 2024 - Don Baldridge 14 UXBRIDGE RD MENDON, MA US 01756 Contact: KEN M.

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: WEBCHECK IN IMPMILMA - KEN M. - IMPMENKC

T:

F: