




OIL ANALYSIS REPORT

Sample Rating Trend

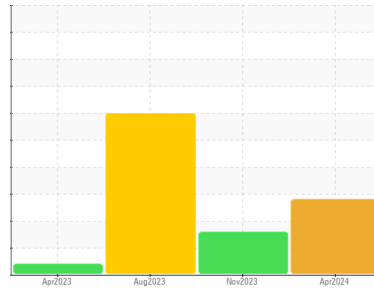

WEAR



Machine Id
KAESER SX 7.5 8382249 (S/N 11866)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC130126	KC124846	KC06005634
Sample Date	Client Info			02 Apr 2024	07 Nov 2023	23 Aug 2023
Machine Age	hrs	Client Info		12594	9330	7766
Oil Age	hrs	Client Info		4000	0	0
Oil Changed	Client Info			Changed	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	SEVERE

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	3
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	<1	0	1
Copper	ppm	ASTM D5185m	>50	▲ 125	6	▲ 61
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	15	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	<1	22	0
Calcium	ppm	ASTM D5185m	2	4	0	0
Phosphorus	ppm	ASTM D5185m		7	0	0
Zinc	ppm	ASTM D5185m		<1	5	0


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	<1	16
Sodium	ppm	ASTM D5185m		0	7	1
Potassium	ppm	ASTM D5185m	>20	1	<1	2
Water	%	ASTM D6304	>0.05	0.003	▲ 0.164	▲ 4.16
ppm Water	ppm	ASTM D6304	>500	33	▲ 1640	▲ 41600

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10405	---	2958
Particles >6µm		ASTM D7647	>1300	▲ 2880	---	▲ 1611
Particles >14µm		ASTM D7647	>80	▲ 460	---	▲ 274
Particles >21µm		ASTM D7647	>20	▲ 205	---	▲ 92
Particles >38µm		ASTM D7647	>4	▲ 20	---	▲ 14
Particles >71µm		ASTM D7647	>3	1	---	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/16	---	▲ 19/18/15


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.20	0.30	0.28

OIL ANALYSIS REPORT


Particle Trend

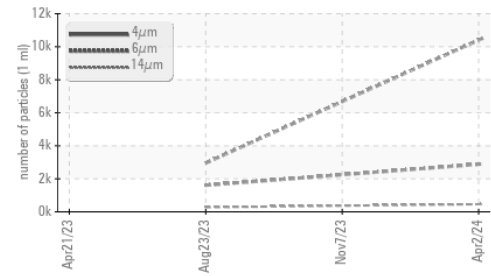


Water (KF)

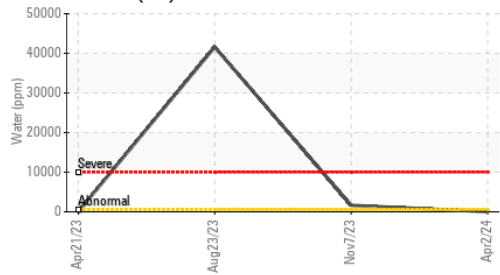


Non-ferrous Metals

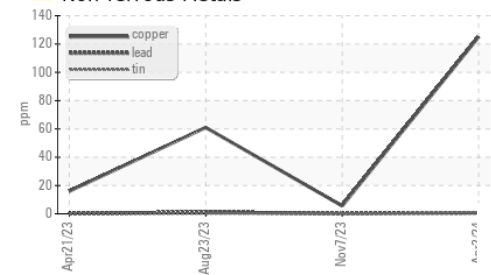

Acid Number

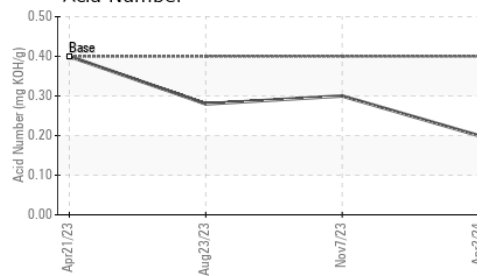

Water (KF)

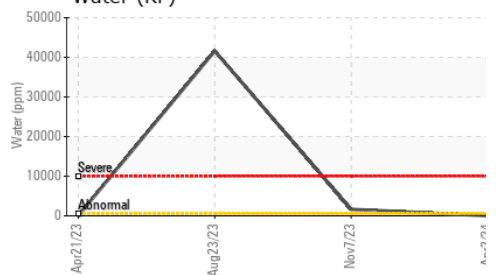





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	HEAVY
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	▲ 0.2%

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445	46	43.4	43.6

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

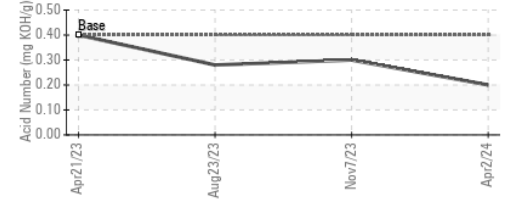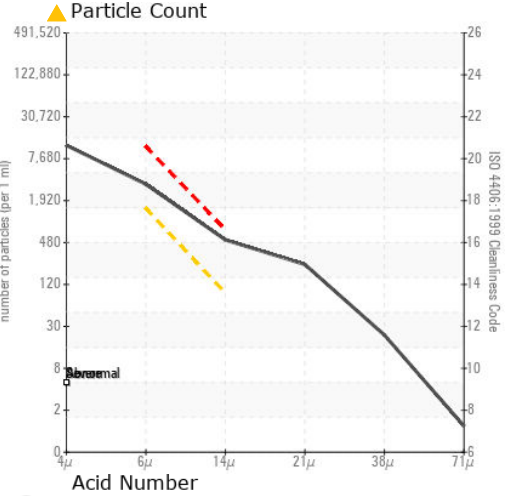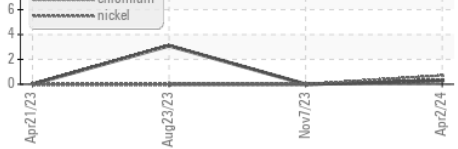

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC130126
Lab Number : 06183341
Unique Number : 11034667
Test Package : IND 2
Received : 17 May 2024
Tested : 20 May 2024
Diagnosed : 21 May 2024 - Don Baldrige

EVERGREEN PLASTICS
 202 WATER TOWER DR
 CLYDE, OH
 US 43410
 Contact:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)