KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

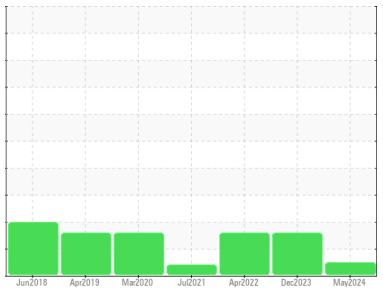

NORMAL

Machine Id
KAESER AIRTOWER 7.5 5672023 (S/N 1030)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCPA016660**	KCPA010131	KCP45673
Sample Date		Client Info		**07 May 2024**	29 Dec 2023	13 Apr 2022
Machine Age	hrs	Client Info		**15940**	15391	11871
Oil Age	hrs	Client Info		**549**	0	0
Oil Changed		Client Info		**Not Changd**	N/A	Changed
Sample Status				**NORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**1**	0	0
Chromium	ppm	ASTM D5185m	>10	**<1**	0	0
Nickel	ppm	ASTM D5185m	>3	**<1**	<1	0
Titanium	ppm	ASTM D5185m	>3	**<1**	0	0
Silver	ppm	ASTM D5185m	>2	**<1**	0	0
Aluminum	ppm	ASTM D5185m	>10	**2**	<1	0
Lead	ppm	ASTM D5185m	>10	**<1**	<1	0
Copper	ppm	ASTM D5185m	>50	**11**	2	18
Tin	ppm	ASTM D5185m	>10	**1**	<1	0
Antimony	ppm	ASTM D5185m		**---**	---	---
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**<1**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	0
Barium	ppm	ASTM D5185m	90	**8**	48	0
Molybdenum	ppm	ASTM D5185m	0	**<1**	0	0
Manganese	ppm	ASTM D5185m		**<1**	<1	0
Magnesium	ppm	ASTM D5185m	100	**26**	51	0
Calcium	ppm	ASTM D5185m	0	**5**	3	0
Phosphorus	ppm	ASTM D5185m	0	**81**	172	3
Zinc	ppm	ASTM D5185m	0	**19**	21	8
Sulfur	ppm	ASTM D5185m	23500	**20262**	10368	15121

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**1**	<1	5
Sodium	ppm	ASTM D5185m		**5**	3	0
Potassium	ppm	ASTM D5185m	>20	**3**	<1	0
Water	%	ASTM D6304	>0.05	**0.016**	0.016	0.002
ppm Water	ppm	ASTM D6304	>500	**168**	167	16.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**4535**	23712	8126
Particles >6µm		ASTM D7647	>1300	**608**	▲ 7103	▲ 2814
Particles >14µm		ASTM D7647	>80	**47**	▲ 444	▲ 321
Particles >21µm		ASTM D7647	>20	**18**	▲ 72	▲ 56
Particles >38µm		ASTM D7647	>4	**2**	1	4
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	**19/16/13**	▲ 22/20/16	▲ 20/19/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.47**	0.72	0.40

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Water (KF)

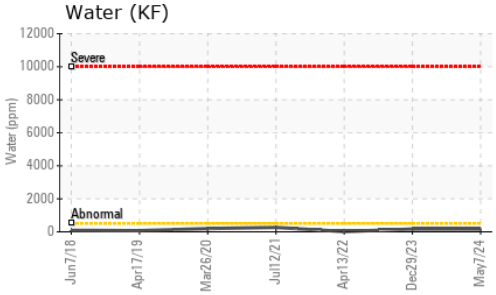

Particle Trend

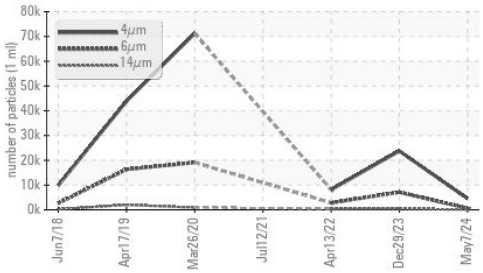

Water (KF)

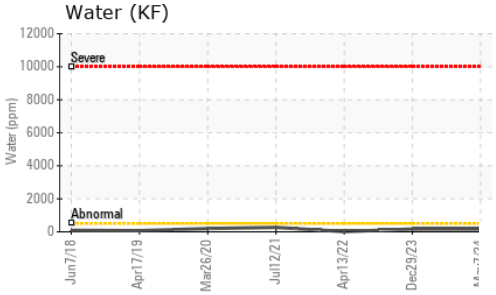

Viscosity @ 40°C

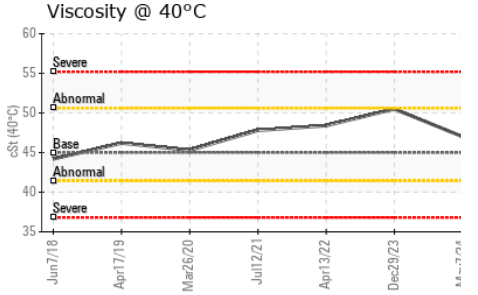

Particle Trend

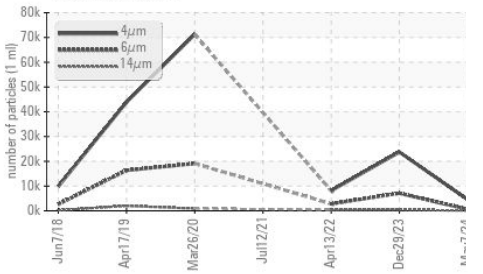

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	**47.0**	50.5	48.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			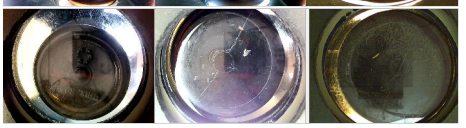		

GRAPHS

Ferrous Alloys

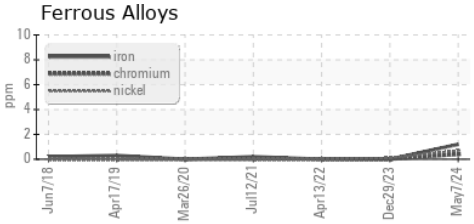

Non-ferrous Metals

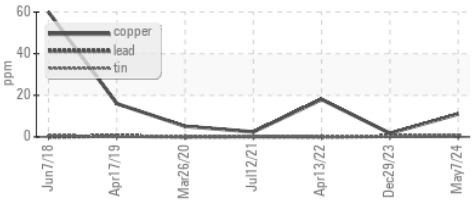

Viscosity @ 40°C

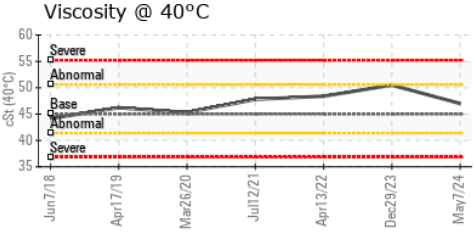

Particle Count

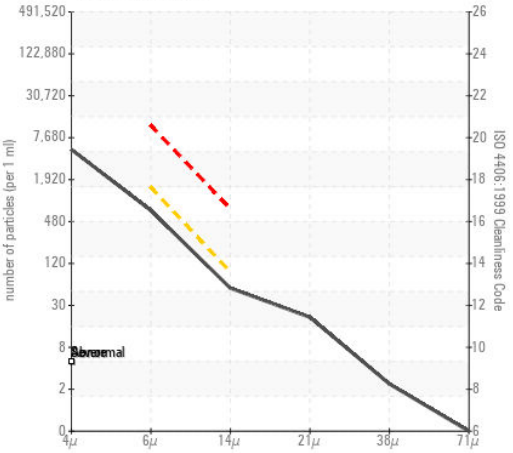

Acid Number

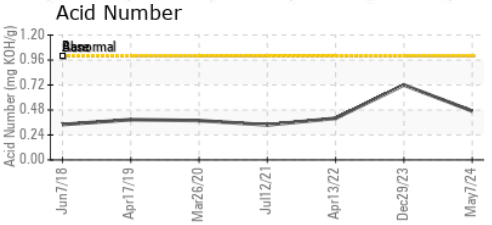

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016660 **Received** : 17 May 2024
Lab Number : 06183352 **Tested** : 21 May 2024
Unique Number : 11034678 **Diagnosed** : 21 May 2024 - Don Baldridge
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

UPS OASIS
301 E OAK AVE
LAWNSIDE, NJ
US 08045
Contact: R. DINSMORE
rdinsmore@ups.com
T:
F:

Report Id: UPSLAW [WUSCAR] 06183352 (Generated: 05/21/2024 18:53:14) Rev: 1

Contact/Location: R. DINSMORE - UPSLAW