




# OIL ANALYSIS REPORT

## Sample Rating Trend

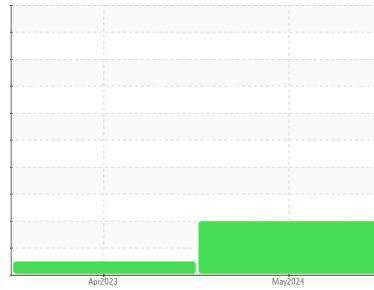

ISO



Machine Id  
**7480135 (S/N 1077)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016787</b>	KCP52629	---
Sample Date	Client Info			<b>14 May 2024</b>	12 Apr 2023	---
Machine Age	hrs	Client Info		<b>13655</b>	7470	---
Oil Age	hrs	Client Info		<b>6000</b>	4035	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	<1	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	<b>15</b>	8	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<1	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	100	<b>2</b>	3	---
Calcium	ppm	ASTM D5185m	0	<b>4</b>	0	---
Phosphorus	ppm	ASTM D5185m	0	<b>3</b>	<1	---
Zinc	ppm	ASTM D5185m	0	<b>13</b>	49	---
Sulfur	ppm	ASTM D5185m	23500	<b>22922</b>	20322	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>0</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	---
Water	%	ASTM D6304	>0.05	<b>0.005</b>	0.007	---
ppm Water	ppm	ASTM D6304	>500	<b>59</b>	71.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>12306</b>	1951	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 4538</b>	538	---
Particles >14µm		ASTM D7647	>80	<b>▲ 673</b>	46	---
Particles >21µm		ASTM D7647	>20	<b>▲ 258</b>	14	---
Particles >38µm		ASTM D7647	>4	<b>▲ 14</b>	1	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 21/19/17</b>	18/16/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.44</b>	0.41	---

# OIL ANALYSIS REPORT


## ▲ Particle Trend

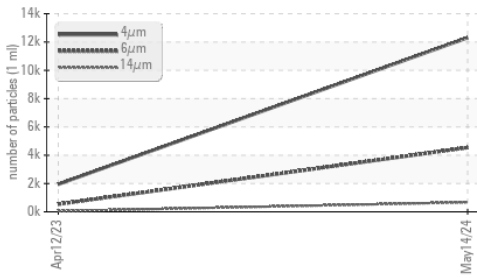

## Water (KF)



## Acid Number

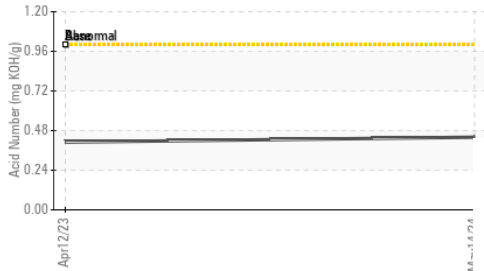

## Water (KF)



## Viscosity @ 40°C




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.2	46.9


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

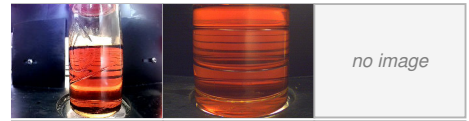

no image


Bottom




no image

## GRAPHS

### Ferrous Alloys

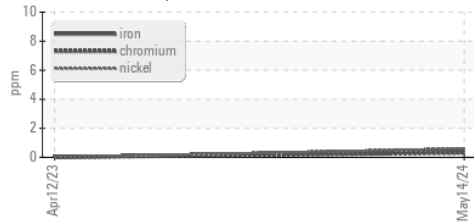


### Non-ferrous Metals

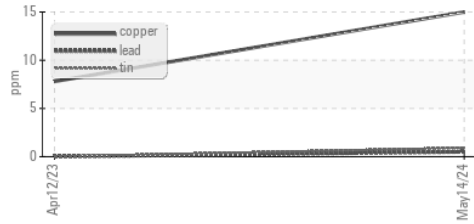


### Viscosity @ 40°C



### ▲ Particle Count

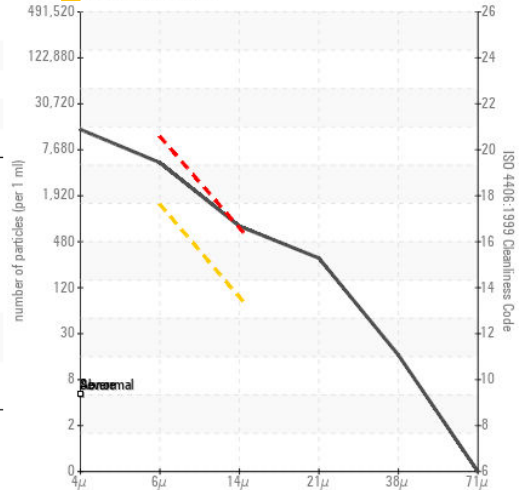

### Acid Number

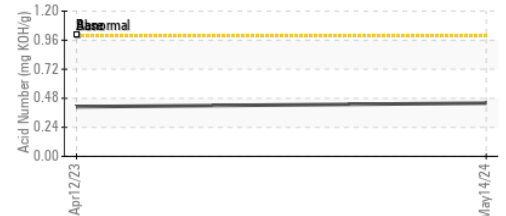

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : KCPA016787

**Lab Number** : 06183359

**Unique Number** : 11034685

**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Received** : 17 May 2024

**Tested** : 21 May 2024

**Diagnosed** : 21 May 2024 - Don Baldrige

**HC COMPOSITES**

601 STATON RD

GREENVILLE, NC

US 27834

Contact: R. JAMES

rjames@worldcat.com

T:

F: