




OIL ANALYSIS REPORT

Sample Rating Trend

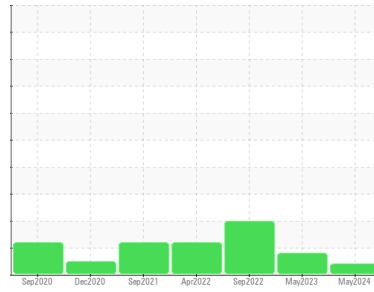

VIS DEBRIS



Machine Id
7265954 (S/N 1059)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC129477	KC112059	KC80921
Sample Date	Client Info	13 May 2024	04 May 2023	08 Sep 2022
Machine Age	hrs	17666	15092	13217
Oil Age	hrs	2574	3656	1781
Oil Changed	Client Info	Not Changed	Changed	Not Changed
Sample Status		ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	<1	3
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	2	3
Lead	ppm	ASTM D5185m >10	1	0	0
Copper	ppm	ASTM D5185m >50	6	6	5
Tin	ppm	ASTM D5185m >10	0	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	28	10	23
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	1	0	<1
Zinc	ppm	ASTM D5185m	33	9	24

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	1	0	0
Sodium	ppm	ASTM D5185m	14	11	11
Potassium	ppm	ASTM D5185m >20	6	4	9
Water	%	ASTM D6304 >0.05	0.010	0.015	0.017
ppm Water	ppm	ASTM D6304 >500	101	156.7	174.6




FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	5630	47464
Particles >6µm	ASTM D7647 >1300	---	1508	13290
Particles >14µm	ASTM D7647 >80	---	78	762
Particles >21µm	ASTM D7647 >20	---	18	111
Particles >38µm	ASTM D7647 >4	---	0	6
Particles >71µm	ASTM D7647 >3	---	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	---	20/18/13	23/21/17

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.43	0.43	0.37


OIL ANALYSIS REPORT

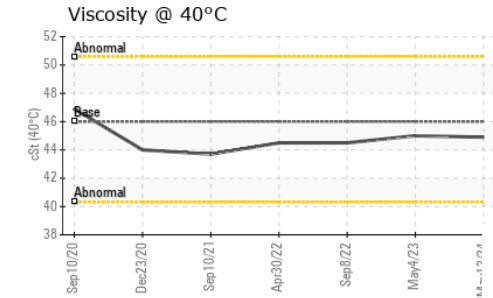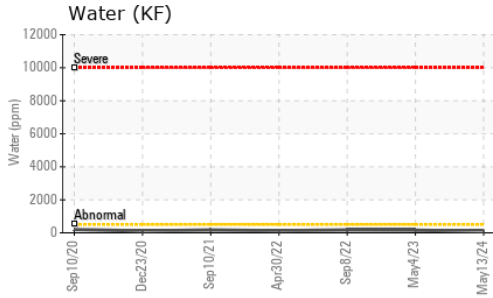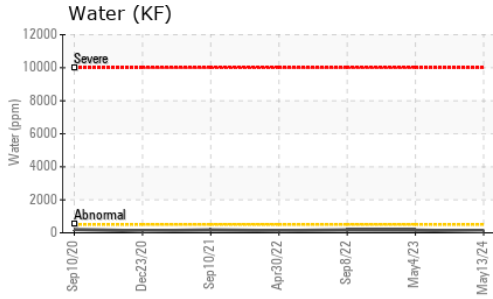





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	45.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

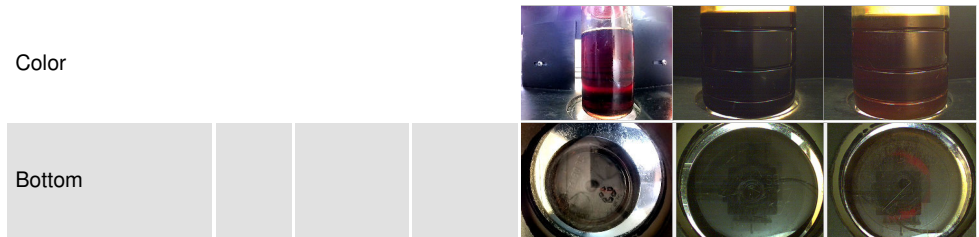

GRAPHS

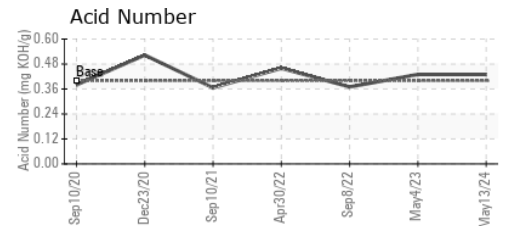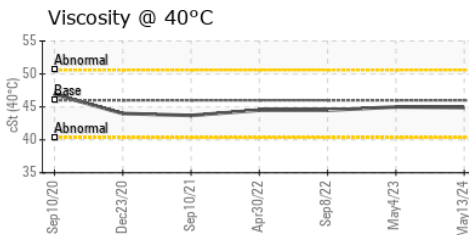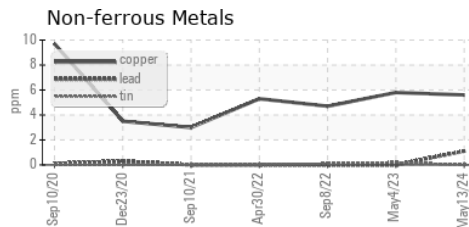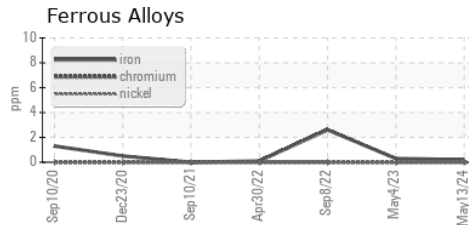

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC129477
Lab Number : 06184311
Unique Number : 11035637
Test Package : IND 2

Received : 20 May 2024
Tested : 22 May 2024
Diagnosed : 22 May 2024 - Don Baldrige

NEW PROCESS STEEL CORP
 5671 S 118TH ST
 ALSIP, IL
 US 60803
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: