


OIL ANALYSIS REPORT

Sample Rating Trend

SAMPLE INFORMATION method limit/base



NACHINE IO 25KGDL16M3 Component Vacuum Pump

Fluid MOBIL DTE OIL HEAVY (1 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Area

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The condition of the oil is acceptable for the time in service.

SAIVIPLE INFORIN		method	iimii/base	current	nistory i	nistory2
Sample Number		Client Info		WC0927422	WC0864059	WC0838511
Sample Date		Client Info		08 May 2024	13 Nov 2023	01 Sep 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION		method	limit/base	ourroat	biotoryd	history2
	N			current	history1	
Water		WC Method	>.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	15	0	8
Chromium	ppm	ASTM D5185m	>20	<1	0	0
Nickel	ppm	ASTM D5185m	>20	<1	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>20	2	1	0
Lead	ppm	ASTM D5185m	>20	<1	0	0
Copper	ppm	ASTM D5185m	>20	<1	<1	<1
Tin	ppm	ASTM D5185m	>20	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		11	2	0
Phosphorus	ppm	ASTM D5185m		98	125	159
Zinc	ppm	ASTM D5185m		37	64	36
Sulfur	ppm	ASTM D5185m		911	1604	1903
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	10	0	2
Sodium	ppm	ASTM D5185m		<1	0	10
Potassium	ppm	ASTM D5185m	>20	2	2	4
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
:16:01) Rev: 1				Submitt	ed By: MICHAE	



OIL ANALYSIS REPORT



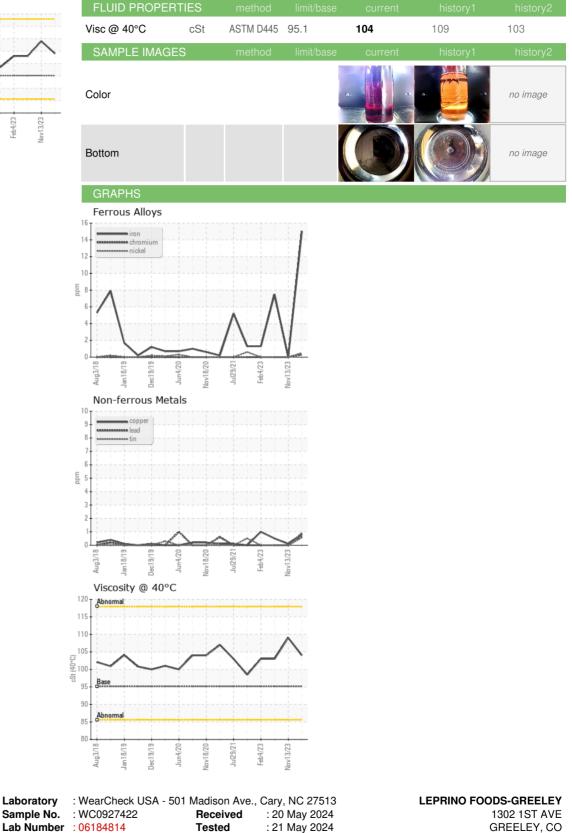

Lab Number : 06184814 Unique Number : 11036140 Diagnosed : 22 May 2024 - Sean Felton US 80631-5909 Test Package : IND 1 Contact: ERIC KLINE Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. EKLINE@LEPRINOFOODS.COM * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (970)347-5190

Laboratory

Submitted By: MICHAEL VILLASENOR Page 2 of 2

T: