




FUEL REPORT

Sample Rating Trend

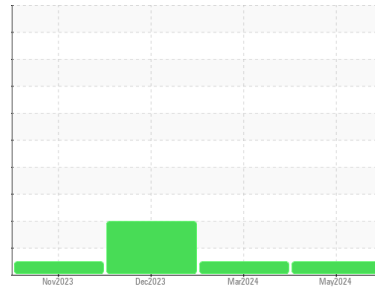

NORMAL



Area

West Virginia

Machine Id

[West Virginia] Diesel - #1 Port

Component

Diesel Fuel

Fluid

MARATHON DIESEL 2 (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0683561	WC0874779	WC0600252
Sample Date	Client Info			12 May 2024	18 Mar 2024	12 Dec 2023
Machine Age	hrs	Client Info		0	0	40132
Sample Status				NORMAL	NORMAL	ATTENTION


PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		2.49	2.42	2.64

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	0	0
Sodium	ppm	ASTM D5185m	<0.1	<1	2	0
Potassium	ppm	ASTM D5185m	<0.1	0	<1	0
Water	%	ASTM D6304	<0.05	0.002	0.002	0.002
ppm Water	ppm	ASTM D6304	<500	23	24	22




HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	2
Nickel	ppm	ASTM D5185m	<0.1	0	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<1	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	0	<1	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	0	0
Zinc	ppm	ASTM D5185m	<0.1	0	0	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

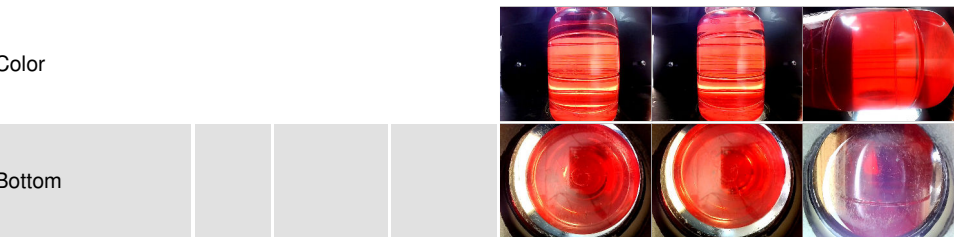




FUEL REPORT

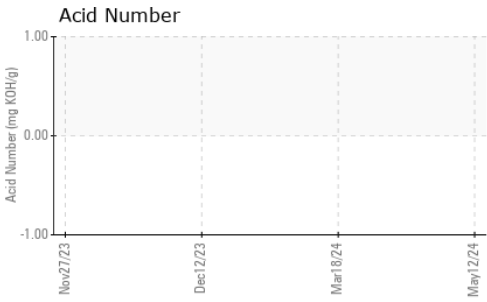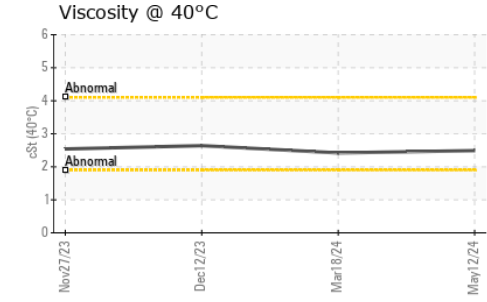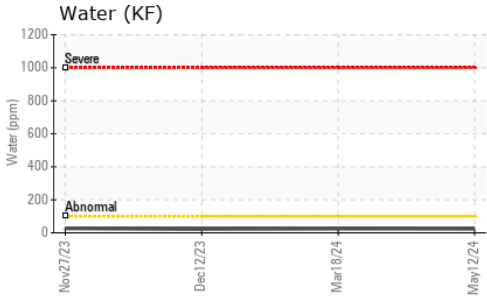

GRAPHS

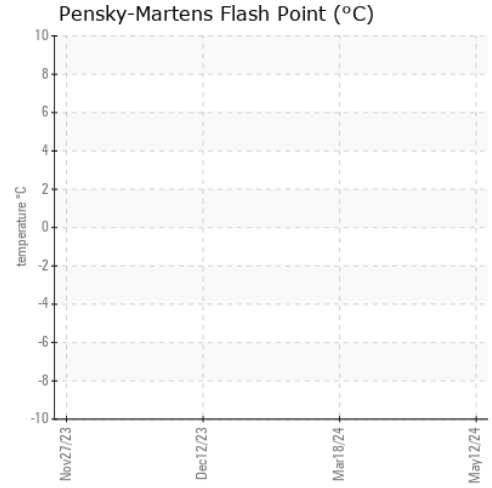

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0683561 **Received** : 20 May 2024
Lab Number : 06184853 **Tested** : 22 May 2024
Unique Number : 11036179 **Diagnosed** : 22 May 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MARATHON PETROLEUM CO.

101 12TH ST
CATLETTSBURG, KY
US 41169

Contact: CORY GUMBERT
cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x: