




OIL ANALYSIS REPORT

Sample Rating Trend

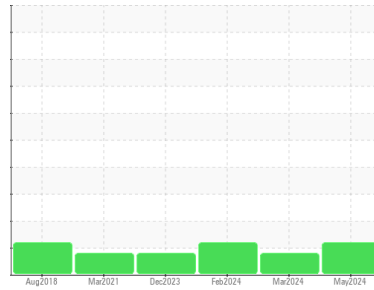

ISO



Area

[1972520]

Machine Id

WP04-XF02 (S/N 31990071)

Component

Hydraulic System

Fluid

JAX PREMIUM HYDRAULIC OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

Confirm oil type. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0891452	WC0891446	WC0881649
Sample Date	Client Info	10 May 2024	07 Mar 2024	08 Feb 2024
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ATTENTION	ATTENTION	ATTENTION

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.05	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	13	19
Chromium	ppm	ASTM D5185m >20	<1	<1
Nickel	ppm	ASTM D5185m >20	<1	0
Titanium	ppm	ASTM D5185m	<1	0
Silver	ppm	ASTM D5185m	<1	0
Aluminum	ppm	ASTM D5185m >20	2	1
Lead	ppm	ASTM D5185m >20	<1	2
Copper	ppm	ASTM D5185m >20	3	3
Tin	ppm	ASTM D5185m >20	1	1
Vanadium	ppm	ASTM D5185m	<1	0
Cadmium	ppm	ASTM D5185m	<1	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0
Barium	ppm	ASTM D5185m	0	3
Molybdenum	ppm	ASTM D5185m	0	<1
Manganese	ppm	ASTM D5185m	1	1
Magnesium	ppm	ASTM D5185m	<1	1
Calcium	ppm	ASTM D5185m	77	79
Phosphorus	ppm	ASTM D5185m	478	496
Zinc	ppm	ASTM D5185m	652	650
Sulfur	ppm	ASTM D5185m	6733	6290

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	3	3
Sodium	ppm	ASTM D5185m	19	19
Potassium	ppm	ASTM D5185m >20	2	4

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	9368	7317	8670
Particles >6µm	ASTM D7647 >1300	2028	1043	2133
Particles >14µm	ASTM D7647 >160	66	61	146
Particles >21µm	ASTM D7647 >40	10	14	34
Particles >38µm	ASTM D7647 >10	0	0	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	20/18/13	20/17/13	20/18/14

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.01	1.12	1.03

OIL ANALYSIS REPORT


Particle Trend

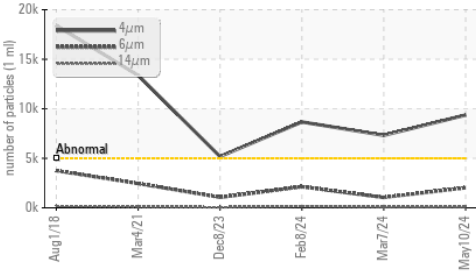


Particle Trend

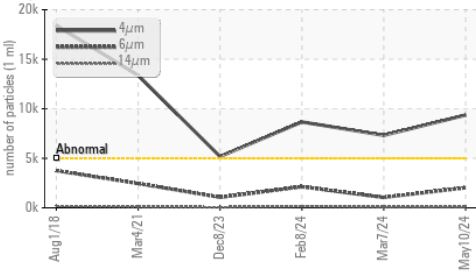

Acid Number

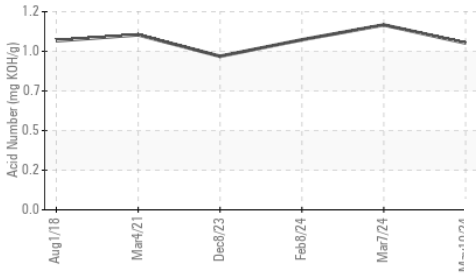

Viscosity @ 40°C

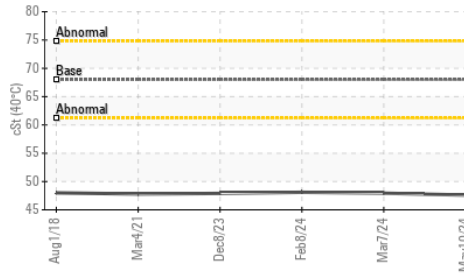


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0	47.6	47.94

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

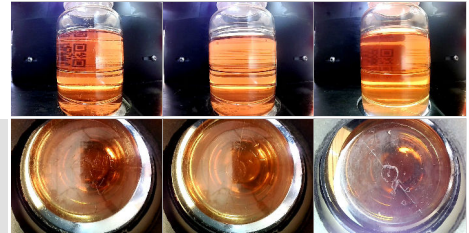


Bottom

GRAPHS


Ferrous Alloys

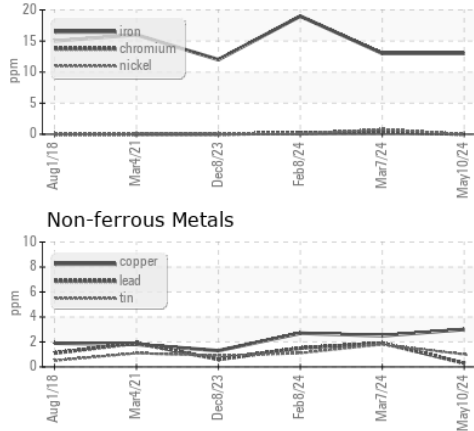


Non-ferrous Metals

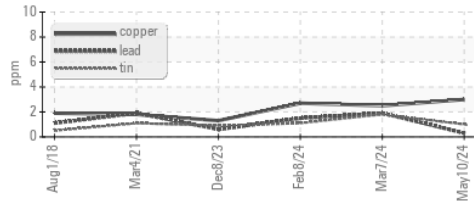


Viscosity @ 40°C

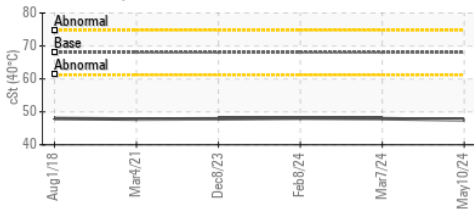

Particle Count

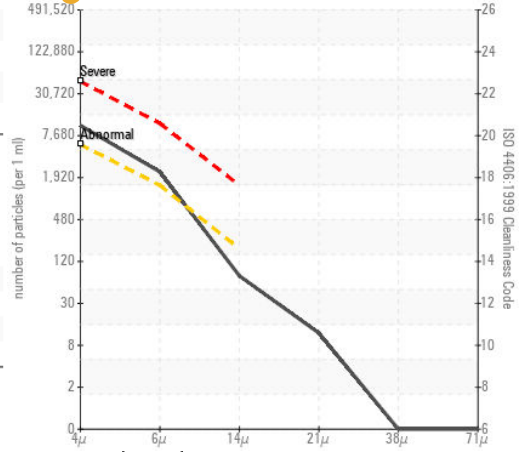

Acid Number

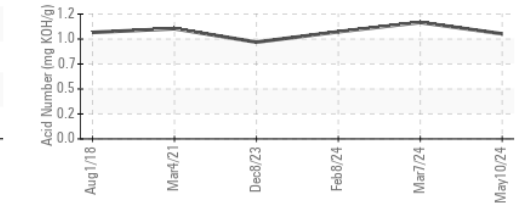

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0891452
Lab Number : 06184956
Unique Number : 11036282
Test Package : IND 2

Received : 20 May 2024
Tested : 22 May 2024
Diagnosed : 22 May 2024 - Don Baldrige

LEPRINO FOODS - LEMOORE EAST
 490 F ST.
 LEMOORE, CA
 US 93245

Contact: CHRISTOPHER FOGG
 cfogg@leprinofoods.com
 T: (559)925-7137

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)