


OIL ANALYSIS REPORT

Sample Rating Trend

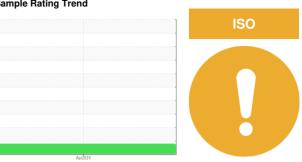

Machine Id

KAESER AIRCENTER SM 10 9175676 (S/N 2432)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2024			
SAMPLE INFORM	MATION					history2
Sample Number		Client Info		KC121916		
Sample Date		Client Info		11 Apr 2024		
Machine Age	hrs	Client Info		3405		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
			>50	11		
Copper Tin	ppm	ASTM D5185m	>10			
	ppm		>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	3		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		7		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m	725	2		
Potassium	ppm	ASTM D5185m	>20	2		
	ppm %					
Water		ASTM D6304 ASTM D6304	>0.05 >500	0.003 30		
ppm Water	ppm				late to make	la la tarra O
FLUID CLEANLIN	ESS	method	limit/base		history1	history2
Particles >4µm		ASTM D7647		4188		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	62		
Particles >21μm		ASTM D7647	>20	4		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.23		



OIL ANALYSIS REPORT

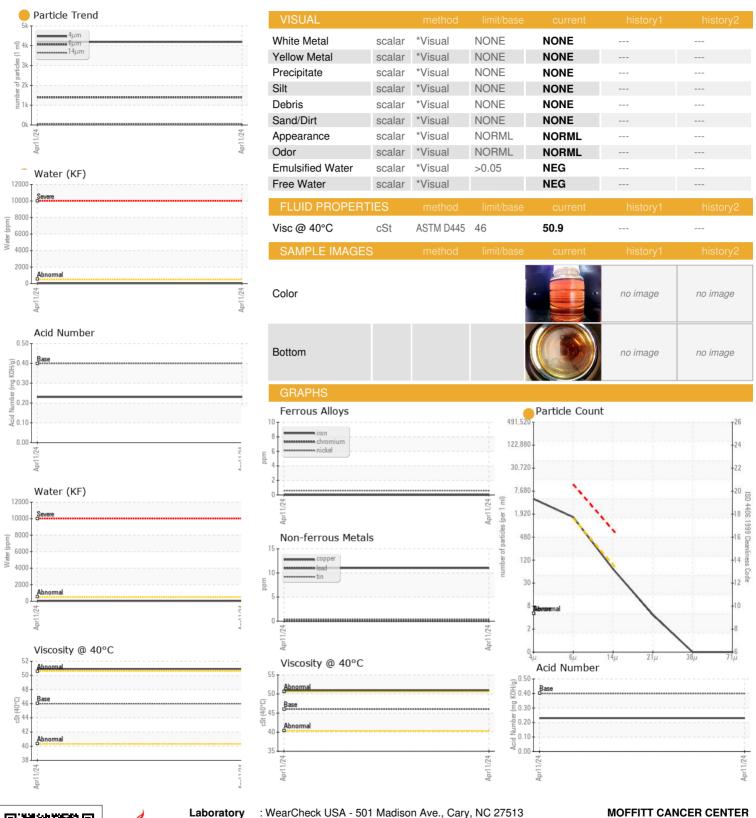





Certificate 12367

Laboratory Sample No.

: KC121916 Lab Number : 06184989 Unique Number : 11036315 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 20 May 2024 **Tested** : 22 May 2024

Diagnosed

: 22 May 2024 - Jonathan Hester

3011 W HOLLY DR TAMPA, FL US 33612

Contact:

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)