


OIL ANALYSIS REPORT

Sample Rating Trend

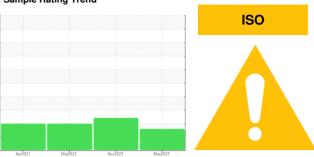

Machine Id

6825515 (S/N 2076)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr202	1 Mar2022	Nov2023 Mi	ny2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018191	KCPA006442	KCP38285
Sample Date		Client Info		14 May 2024	07 Nov 2023	01 Mar 2022
Machine Age	hrs	Client Info		27873	25376	14608
Oil Age	hrs	Client Info		3000	0	3000
Oil Changed		Client Info		Not Changd	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	8	10
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	100	15	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	0	4
Zinc	ppm	ASTM D5185m	0	37	0	0
Sulfur	ppm	ASTM D5185m	23500	21047	15944	15126
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		13	1	0
Potassium	ppm	ASTM D5185m	>20	6	0	0
Water	%	ASTM D6304	>0.05	0.024	0.008	0.004
ppm Water	ppm	ASTM D6304	>500	248	81.9	44.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		69480	12500	21680
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>▲</u> 5478	<u>▲</u> 16294
Particles >14µm		ASTM D7647	>80	A 825	<u></u> 1037	△ 6539
Particles >21µm		ASTM D7647	>20	<u> </u>	▲ 209	<u> </u>
Particles >38µm		ASTM D7647	>4	4	<u>^</u> 8	<u> </u>
Particles >71µm		ASTM D7647	>3	0	<u>4</u>	<u>4</u>
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>23/21/17</u>	<u>^</u> 21/20/17	<u>\$\text{21/20}\$</u>



OIL ANALYSIS REPORT

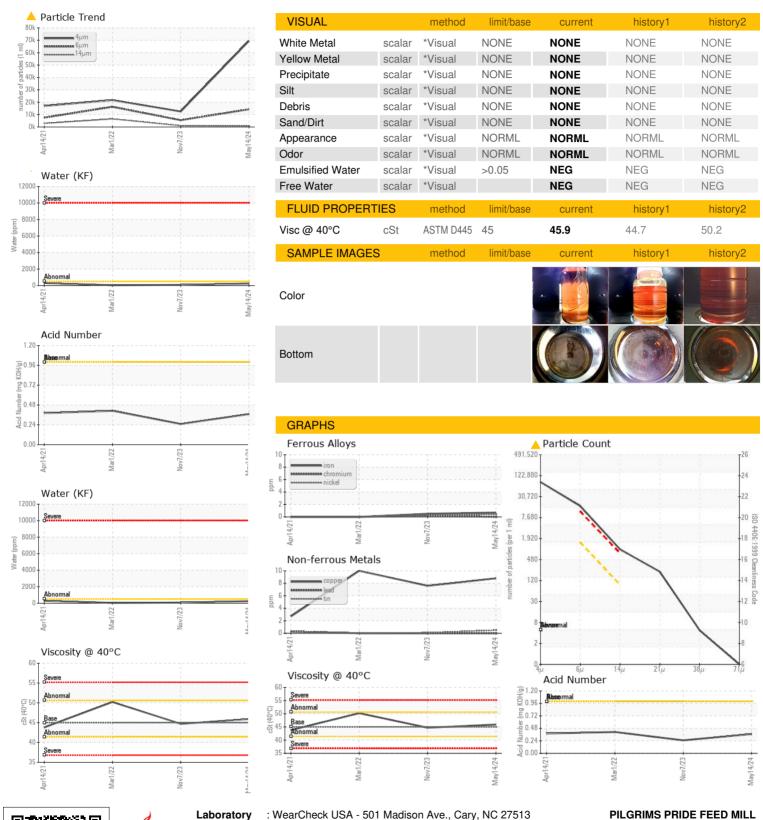





Certificate 12367

Laboratory Sample No. Lab Number

: KCPA018191 : 06185000 Unique Number : 11036326

Received **Tested** Diagnosed

: 22 May 2024 - Jonathan Hester Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 20 May 2024

: 22 May 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

PILGRIMS PRIDE FEED MILL

205 EDGEWOOD DR WINGATE, NC

US 28174 Contact: THOMAS STONER JR

THOMAS.STONEJR2@JBSSA.COM T:

Report Id: PILWIN [WUSCAR] 06185000 (Generated: 05/22/2024 17:49:38) Rev: 1

Contact/Location: THOMAS STONER JR - PILWIN

F: