




# OIL ANALYSIS REPORT

## Sample Rating Trend

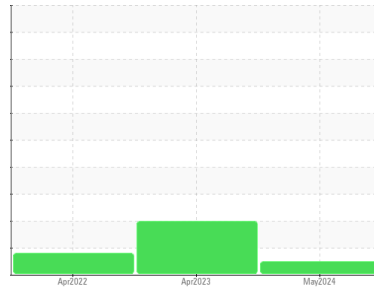

**NORMAL**



Machine Id  
**6613459 (S/N 1252)**  
 Component  
**Compressor**  
 Fluid  
**KAESER OMEGA SB-150 (--- QTS)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA017309</b>	KCP55037	KCP44891
Sample Date	Client Info			<b>13 May 2024</b>	19 Apr 2023	05 Apr 2022
Machine Age	hrs	Client Info		<b>23643</b>	21305	13264
Oil Age	hrs	Client Info		<b>2338</b>	3000	2000
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>12</b>	29	10
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	2	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	2
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>6</b>	4	3
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	1
Barium	ppm	ASTM D5185m		<b>94</b>	91	92
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>99</b>	101	101
Calcium	ppm	ASTM D5185m		<b>6</b>	6	4
Phosphorus	ppm	ASTM D5185m		<b>4</b>	5	3
Zinc	ppm	ASTM D5185m		<b>0</b>	4	0
Sulfur	ppm	ASTM D5185m		<b>24088</b>	22890	18545

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>4</b>	3	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304	>0.05	<b>0.038</b>	0.042	0.048
ppm Water	ppm	ASTM D6304	>500	<b>382</b>	421.8	483.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>6836</b>	38007	36641
Particles >6µm		ASTM D7647	>1300	<b>621</b>	▲ 7846	▲ 5800
Particles >14µm		ASTM D7647	>80	<b>31</b>	▲ 498	● 155
Particles >21µm		ASTM D7647	>20	<b>7</b>	▲ 136	19
Particles >38µm		ASTM D7647	>4	<b>0</b>	▲ 6	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/16/12</b>	▲ 22/20/16	▲ 20/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.38</b>	0.17	0.37


# OIL ANALYSIS REPORT

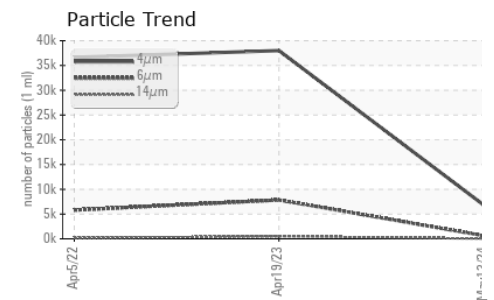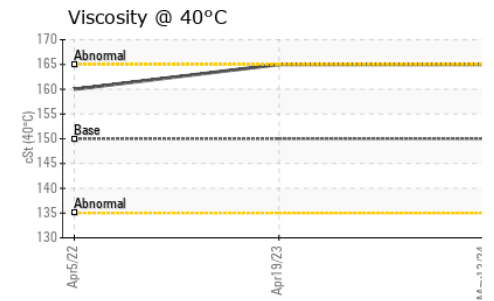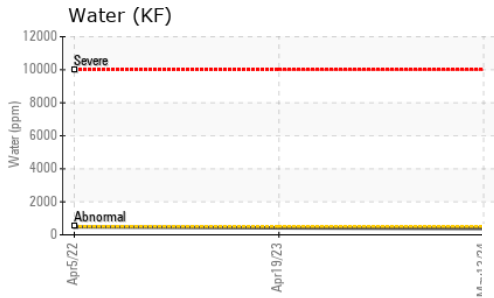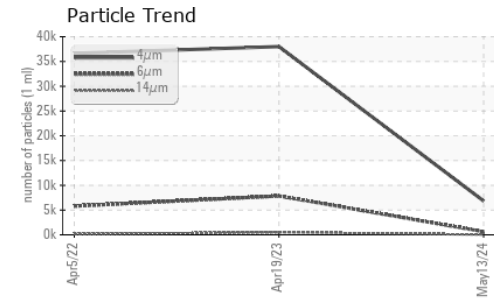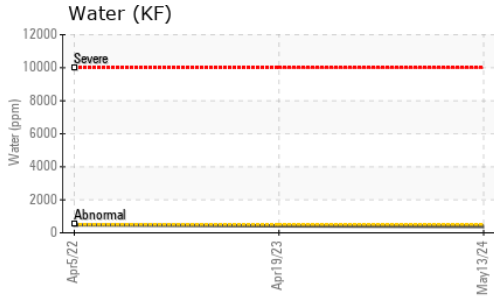






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	165	160

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

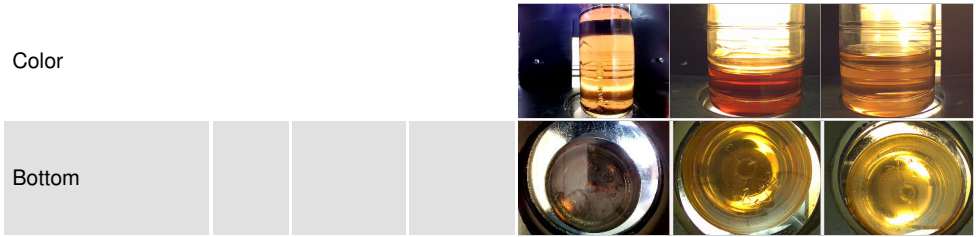

## GRAPHS

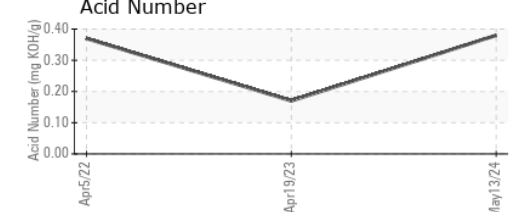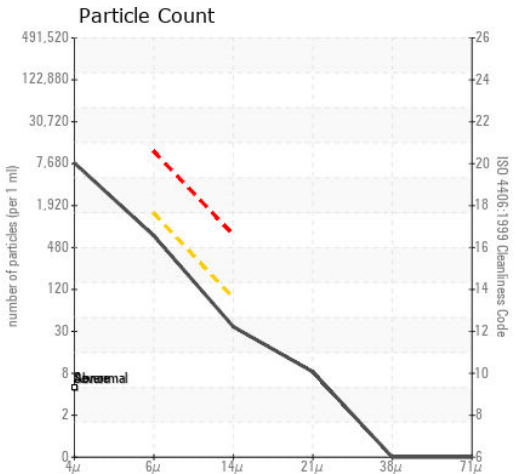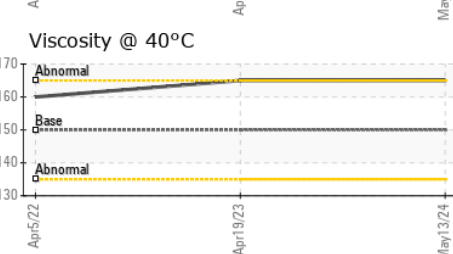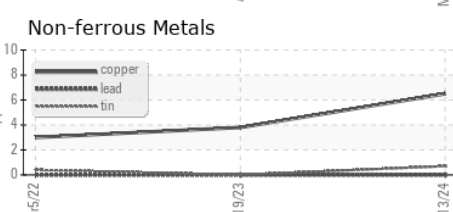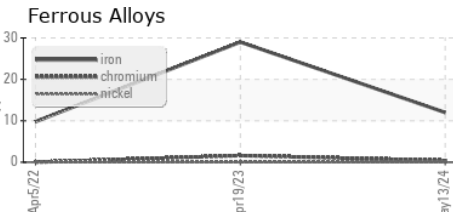

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017309 **Received** : 20 May 2024  
**Lab Number** : 06185005 **Tested** : 22 May 2024  
**Unique Number** : 11036331 **Diagnosed** : 22 May 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**OFS**  
 2000 NORTHEAST EXPY  
 NORCROSS, GA  
 US 30071  
 Contact: K. DYE  
 kdye@ofsoptics.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)