


# **OIL ANALYSIS REPORT**

Sample Rating Trend

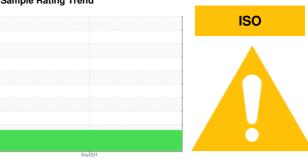

Machine Id

# 2286682 (S/N 1007)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012457		
Sample Date		Client Info		08 May 2024		
Machine Age	hrs	Client Info		15489		
Oil Age	hrs	Client Info		1740		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
		ASTM D5185m	>50	2		
Copper	ppm	ASTM D5185m	>10			
Vanadium	ppm	ASTM D5185m	>10	<1 0		
	ppm			-		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	28		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	86		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	23358		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		16		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.012		
ppm Water	ppm	ASTM D6304	>500	126		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		14650		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2533		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<b>49</b>		
Particles >38μm		ASTM D7647	>4	2		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36		



## **OIL ANALYSIS REPORT**







Laboratory

Sample No.

Lab Number : 06185024 Unique Number : 11036350

: KCPA012457

Received : 20 May 2024 **Tested** Diagnosed

: 22 May 2024 : 22 May 2024 - Jonathan Hester

US 80216 Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: GOODENCO [WUSCAR] 06185024 (Generated: 05/22/2024 17:51:56) Rev: 1

Contact/Location: Service Manager - GOODENCO

T:

F:

4970 COOK ST

DENVER, CO