




# OIL ANALYSIS REPORT

## Sample Rating Trend

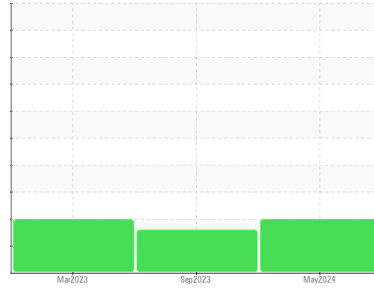

ISO



Machine Id

**KAESER ASD40T 7374160 (S/N 1159)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA012455</b>	KCPA007772	KCP55887
Sample Date	Client Info		<b>06 May 2024</b>	27 Sep 2023	08 Mar 2023
Machine Age	hrs	Client Info	<b>19354</b>	14355	9732
Oil Age	hrs	Client Info	<b>4996</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	N/A	Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	2	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>5</b>	8	3
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>12</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>37</b>	19	1
Calcium	ppm	ASTM D5185m 2	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	1	2
Zinc	ppm	ASTM D5185m	<b>4</b>	26	0
Sulfur	ppm	ASTM D5185m	<b>21291</b>	20809	11153

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>11</b>	5	<1
Potassium	ppm	ASTM D5185m >20	<b>3</b>	3	<1
Water	%	ASTM D6304 >0.05	<b>0.009</b>	0.017	0.006
ppm Water	ppm	ASTM D6304 >500	<b>94</b>	176.2	69.0






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>67635</b>	17708	17563
Particles >6µm	ASTM D7647 >1300		<b>▲ 17856</b>	▲ 5387	▲ 8361
Particles >14µm	ASTM D7647 >80		<b>▲ 870</b>	▲ 223	▲ 876
Particles >21µm	ASTM D7647 >20		<b>▲ 181</b>	▲ 41	▲ 158
Particles >38µm	ASTM D7647 >4		<b>▲ 5</b>	1	▲ 6
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 23/21/17</b>	▲ 21/20/15	▲ 21/20/17

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.43</b>	0.38	0.29


# OIL ANALYSIS REPORT

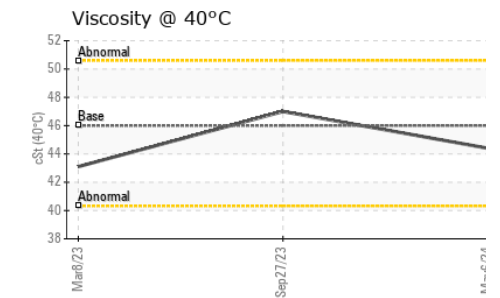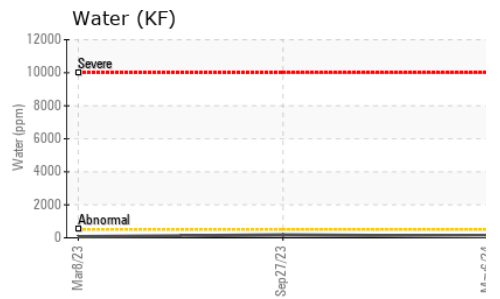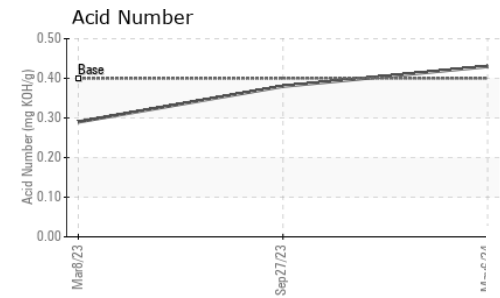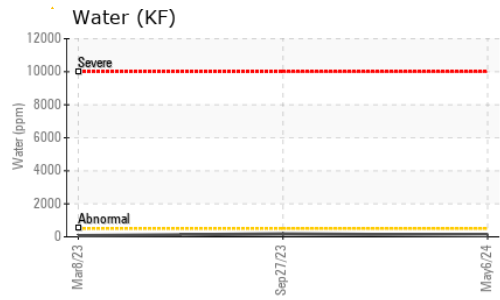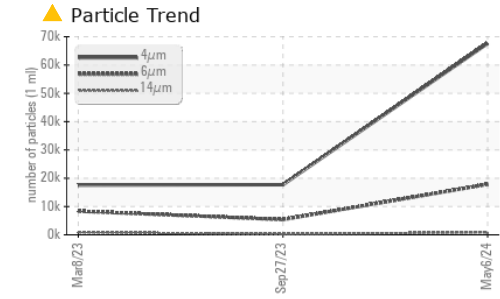




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.4	47.0	43.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

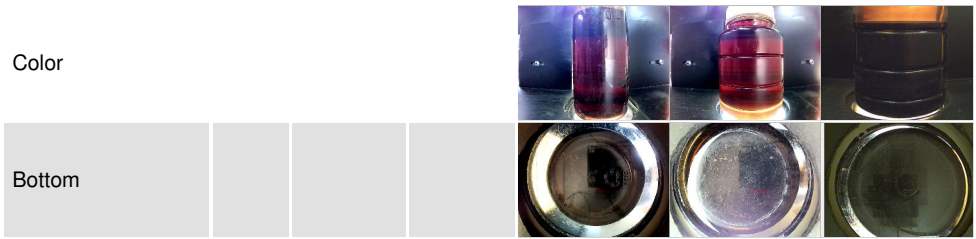

## GRAPHS

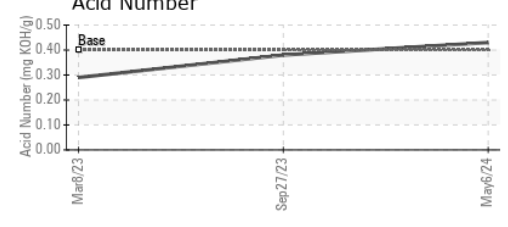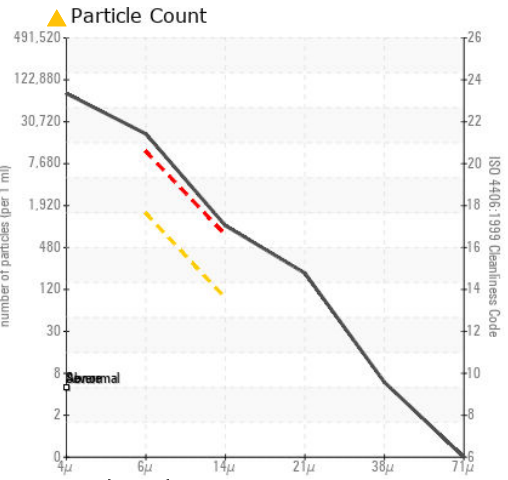

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012455 **Received** : 20 May 2024  
**Lab Number** : 06185036 **Tested** : 22 May 2024  
**Unique Number** : 11036362 **Diagnosed** : 22 May 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ROCLA CONCRETE TIE**  
 3201 LIME RD  
 PUEBLO, CO  
 US 81004  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)