


OIL ANALYSIS REPORT

Sample Rating Trend

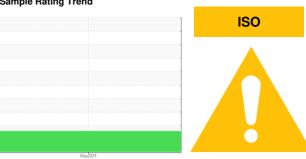

Machine Id

8729619 (S/N 1326) Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06185049		
Sample Date		Client Info		13 May 2024		
Machine Age	hrs	Client Info		514		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m	90	44		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m	_	2		
Zinc	ppm	ASTM D5185m		13		
		method	limit/base	-	history1	history2
Silicon			>25	current <1	riistory i	riistory2
	ppm	ASTM D5185m	>23	11		
Sodium	ppm	ASTM D5185m	00			
Potassium	ppm	ASTM D5185m	>20	12		
Water ppm Water	%	ASTM D6304 ASTM D6304	>0.05	0.016 168		
	ppm					
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	1000	130564		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 71616		
Particles >14µm		ASTM D7647	>80	<u>^</u> 2236		
Particles >21µm		ASTM D7647		<u>^</u> 75		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
A = ! = N		4 OT1 4 D00 45	0.4			


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.26



OIL ANALYSIS REPORT

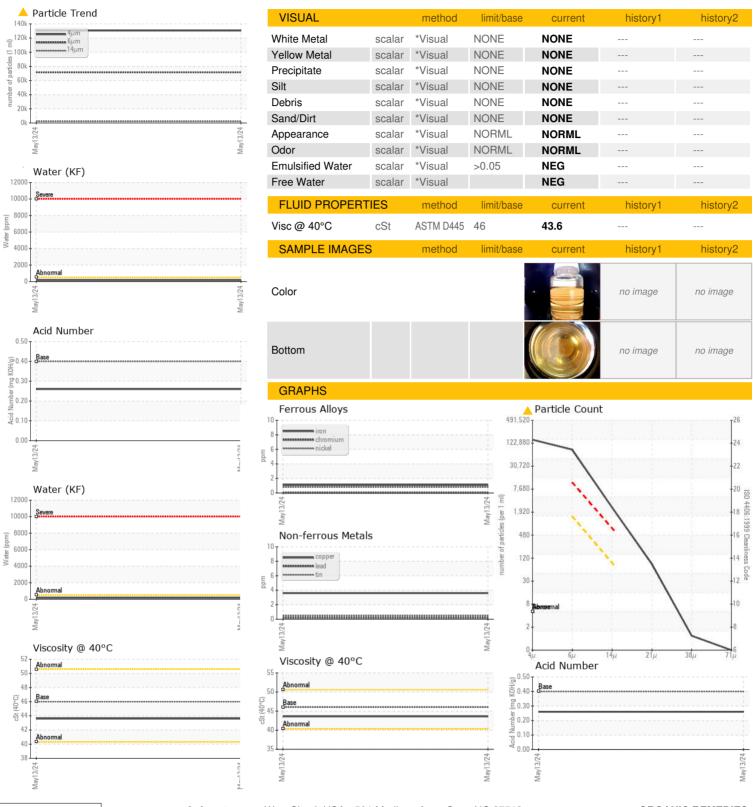





Certificate 12367

Sample No. Lab Number

Laboratory : KC06185049 : 06185049 Unique Number : 11036375

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 20 May 2024

: 22 May 2024 Tested Diagnosed : 22 May 2024 - Jonathan Hester

ORGANIC REMEDIES 11201 PITTSBURGH PLATE GLASS RD SE CUMBERLAND, MD

US 21502 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: