


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

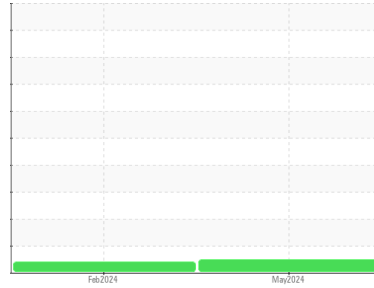

Machine Id
FRICK C-1620

Component
Screw Compressor

Fluid
TULCO LUBSOIL SYN RL WI 100 (300 GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	TO90003209	TO90003224	---
Sample Date	Client Info	01 May 2024	13 Feb 2024	---
Machine Age	hrs	Client Info	17599	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Not Changed	N/A	---
Sample Status		NORMAL	ATTENTION	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>60	0	0	---
Chromium	ppm	ASTM D5185m	>4	0	<1	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>5	<1	0	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>30	2	0	---
Tin	ppm	ASTM D5185m	>15	1	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		0	1	---
Calcium	ppm	ASTM D5185m		0	2	---
Phosphorus	ppm	ASTM D5185m	1500	1375	688	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		28	0	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>50	2	0	---
Sodium	ppm	ASTM D5185m		1	0	---
Potassium	ppm	ASTM D5185m	>20	2	0	---
Water	%	ASTM D6304	>2.26	0.058	0.049	---
ppm Water	ppm	ASTM D6304	>22600	585	498	---






FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm		ASTM D7647	>10000	7619	6602	---
Particles >6µm		ASTM D7647	>2500	1478	1834	---
Particles >14µm		ASTM D7647	>320	67	93	---
Particles >21µm		ASTM D7647	>80	13	17	---
Particles >38µm		ASTM D7647	>20	1	1	---
Particles >71µm		ASTM D7647	>4	0	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/13	20/18/14	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.04	0.014	0.047	---
------------------	----------	------------	------	--------------	-------	-----


OIL ANALYSIS REPORT

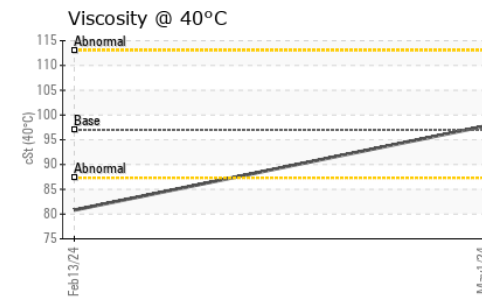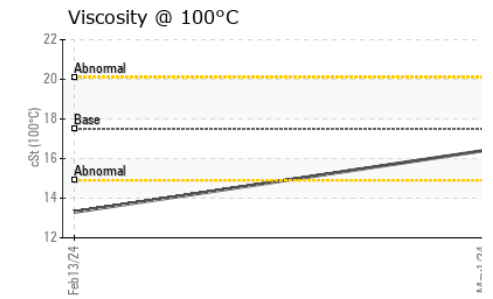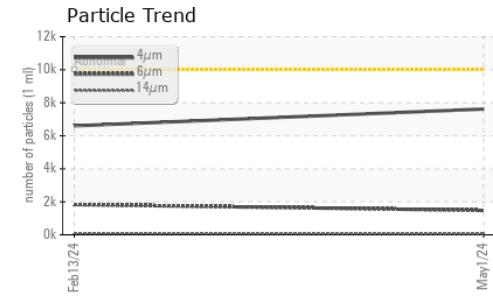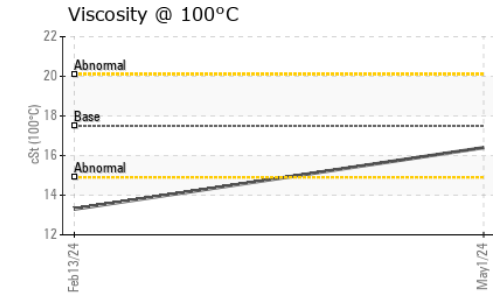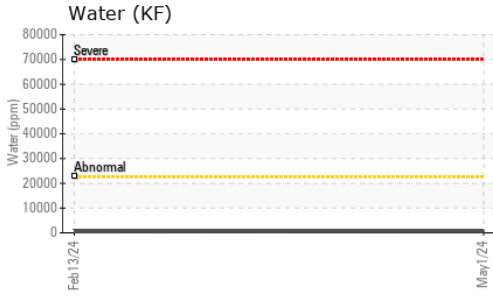






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	97.7	80.8
Visc @ 100°C	cSt	ASTM D445	17.5	16.4	13.3
Viscosity Index (VI)	Scale	ASTM D2270	198	181	167

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

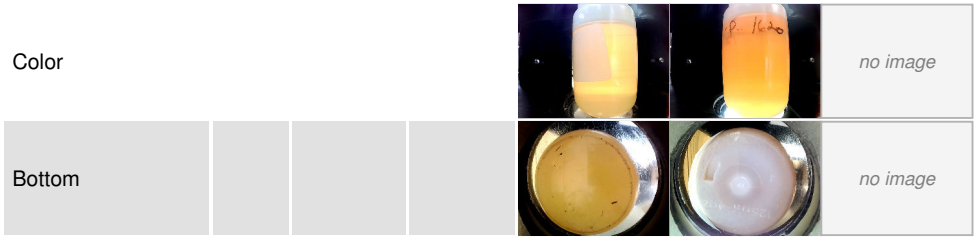

GRAPHS

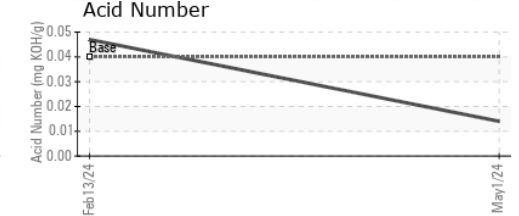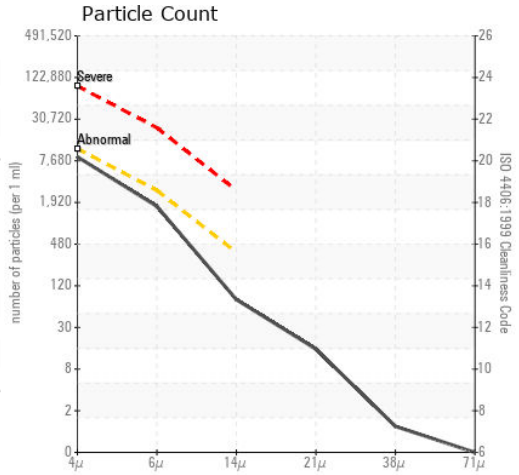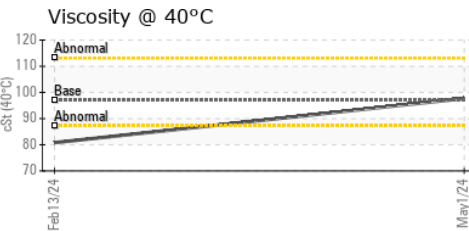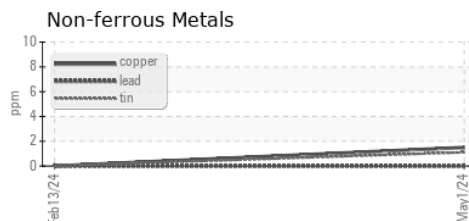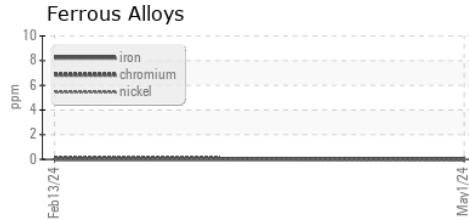

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90003209
Lab Number : 06185072
Unique Number : 11036398
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

KINETIK HOLDINGS - EAST TOYAH
 49 COUNTY RD 419
 PECOS, TX
 US 79772
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: