

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id
GEA C-2360
Component
Screw Compressor
Fluid
TULCO LUBSOIL SYN RL WI 100 (300 GAL)

DIAGNOSIS

Recommendation
Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO20000426	---	---
Sample Date	Client Info	02 Apr 2024	---	---
Machine Age	hrs Client Info	700	---	---
Oil Age	hrs Client Info	700	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>60	2	---	---
Chromium ppm ASTM D5185m	>4	0	---	---
Nickel ppm ASTM D5185m		<1	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m		0	---	---
Aluminum ppm ASTM D5185m	>5	<1	---	---
Lead ppm ASTM D5185m	>10	0	---	---
Copper ppm ASTM D5185m	>30	2	---	---
Tin ppm ASTM D5185m	>15	1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m		0	---	---
Calcium ppm ASTM D5185m		0	---	---
Phosphorus ppm ASTM D5185m	1500	1672	---	---
Zinc ppm ASTM D5185m		0	---	---
Sulfur ppm ASTM D5185m		56	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>50	2	---	---
Sodium ppm ASTM D5185m		<1	---	---
Potassium ppm ASTM D5185m	>20	2	---	---
Water % ASTM D6304	>2.26	0.020	---	---
ppm Water ppm ASTM D6304	>22600	205	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>10000	▲ 127581	---	---
Particles >6µm ASTM D7647	>2500	▲ 32815	---	---
Particles >14µm ASTM D7647	>320	▲ 754	---	---
Particles >21µm ASTM D7647	>80	▲ 103	---	---
Particles >38µm ASTM D7647	>20	1	---	---
Particles >71µm ASTM D7647	>4	0	---	---
Oil Cleanliness ISO 4406 (c)	>20/18/15	▲ 24/22/17	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.04	0.013	---	---

OIL ANALYSIS REPORT

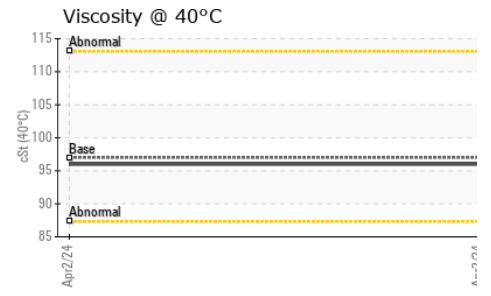
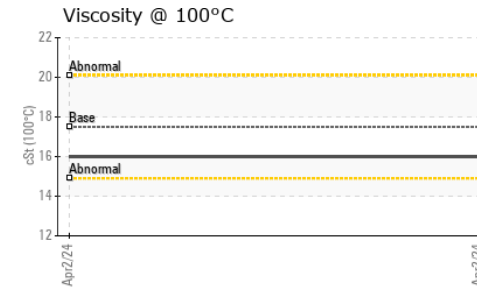
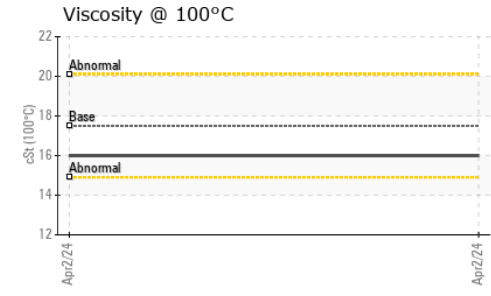
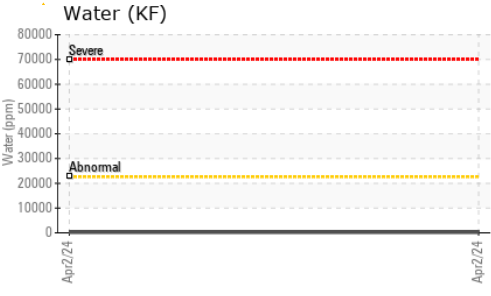
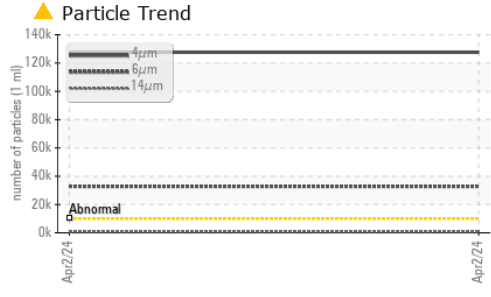


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	▲ MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	97	96.0	---	---
Visc @ 100°C	cSt	ASTM D445	17.5	16.0	---	---
Viscosity Index (VI)	Scale	ASTM D2270	198	179	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2	
Color					no image	no image
Bottom					no image	no image

GRAPHS

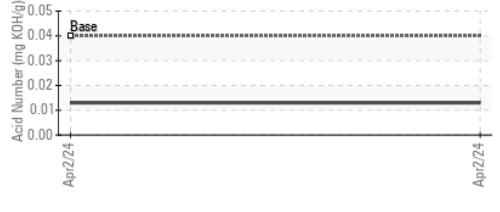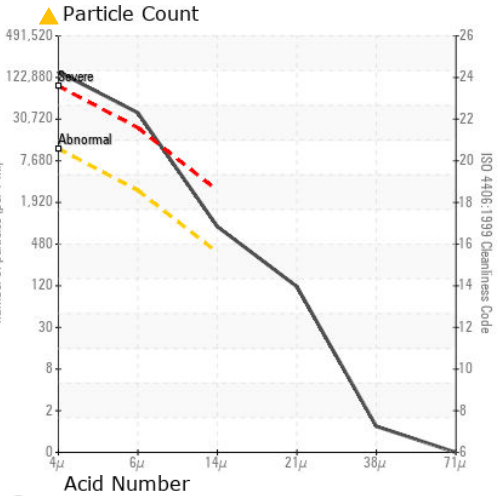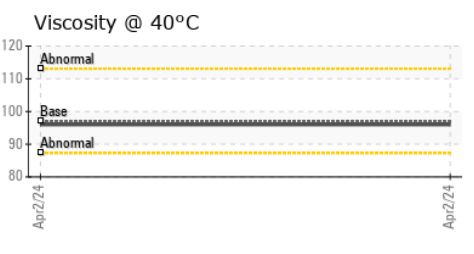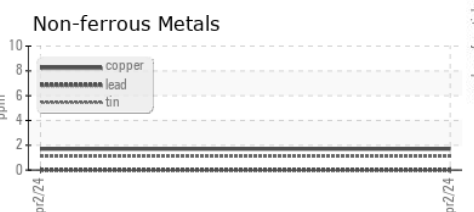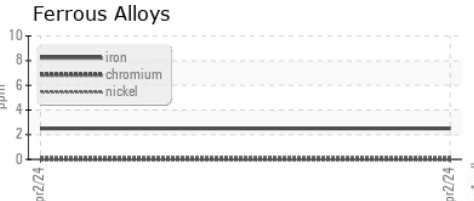

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO20000426 **Received** : 20 May 2024
Lab Number : 06185079 **Tested** : 22 May 2024
Unique Number : 11036405 **Diagnosed** : 22 May 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

KINETIK HOLDINGS - DIAMOND
 1964 FM 2903
 BALMORHEA, TX
 US 79718
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)