




# OIL ANALYSIS REPORT

Area  
**HC-SYN**  
 Machine Id  
**QUINCY ITJ094767**  
 Component  
**Compressor**

### Sample Rating Trend

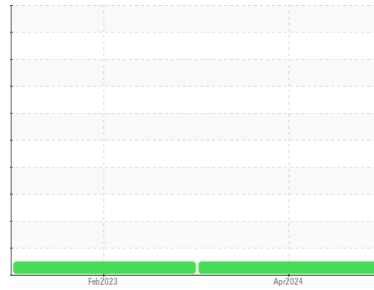

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UHC06185125</b>	UCH05775469	---
Sample Date	Client Info		<b>11 Apr 2024</b>	03 Feb 2023	---
Machine Age	hrs	Client Info	<b>10071</b>	8973	---
Oil Age	hrs	Client Info	<b>2000</b>	0	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	0	---
Lead	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	3	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m	<b>218</b>	165	---
Zinc	ppm	ASTM D5185m	<b>5</b>	11	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	56	---

### CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>3</b>	3	---
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	---

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.05</b>	0.14	---



# OIL ANALYSIS REPORT

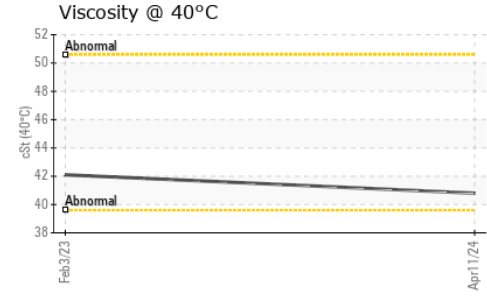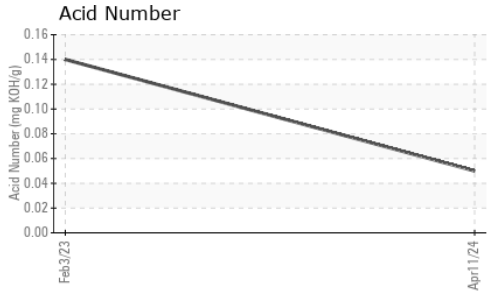


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>40.8</b>	42.1	---

### SAMPLE IMAGES


SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					




no image



no image







no image



no image

### GRAPHS

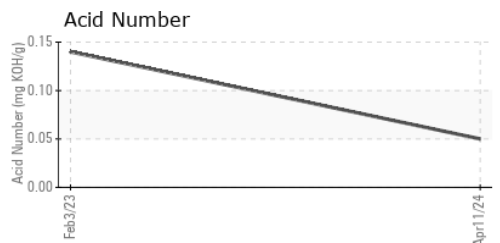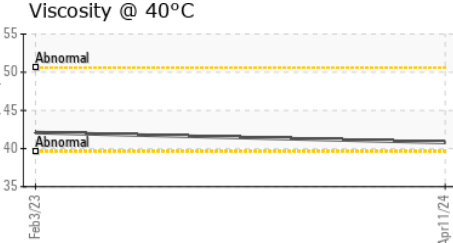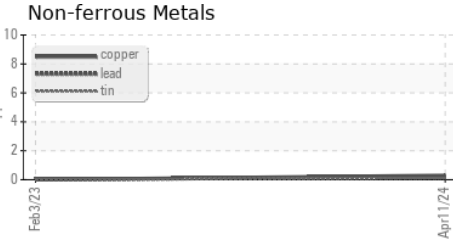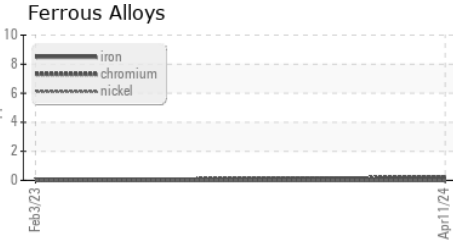

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UHC06185125      **Received** : 20 May 2024  
**Lab Number** : **06185125**      **Tested** : 22 May 2024  
**Unique Number** : 11036451      **Diagnosed** : 22 May 2024 - Wes Davis  
**Test Package** : IND 2

**ATLANTA AIR COMPRESSOR**  
 123 MERCHANTS PARK DR  
 HOSCHTON, GA  
 US 30548  
 Contact: Derik Bray  
 Derik@atlantaaircompressor.com  
 T: (470)252-9952  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)