



OIL ANALYSIS REPORT

Sample Rating Trend



FUEL



Machine Id

NOT GIVEN WC0577824

Component

Diesel Engine

Fluid

CAT DIESEL ENGINE OIL 15W40 (--- GAL)

DIAGNOSIS

● Recommendation

No corrective action is recommended at this time. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

Metal levels are typical for a new component breaking in.

▲ Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

● Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0577824	---	---
Sample Date	Client Info		15 Apr 2024	---	---
Machine Age	hrs	Client Info	368	---	---
Oil Age	hrs	Client Info	35	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			ATTENTION	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	2	---	---
Chromium	ppm	ASTM D5185m >20	<1	---	---
Nickel	ppm	ASTM D5185m >4	0	---	---
Titanium	ppm	ASTM D5185m	<1	---	---
Silver	ppm	ASTM D5185m >3	<1	---	---
Aluminum	ppm	ASTM D5185m >20	1	---	---
Lead	ppm	ASTM D5185m >40	<1	---	---
Copper	ppm	ASTM D5185m >330	<1	---	---
Tin	ppm	ASTM D5185m >15	<1	---	---
Vanadium	ppm	ASTM D5185m	<1	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	73	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	● 38	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	● 460	---	---
Calcium	ppm	ASTM D5185m	1570	---	---
Phosphorus	ppm	ASTM D5185m	975	---	---
Zinc	ppm	ASTM D5185m 1460	1068	---	---
Sulfur	ppm	ASTM D5185m	3121	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	7	---	---
Sodium	ppm	ASTM D5185m	2	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Fuel	%	ASTM D3524 >5	▲ 3.1	---	---

INFRA-RED





	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.1	---	---
Nitration	Abs/cm	*ASTM D7624 >20	5.0	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	21.1	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	18.9	---	---
Base Number (BN)	mg KOH/g	ASTM D2896 11.3	9.76	---	---











OIL ANALYSIS REPORT

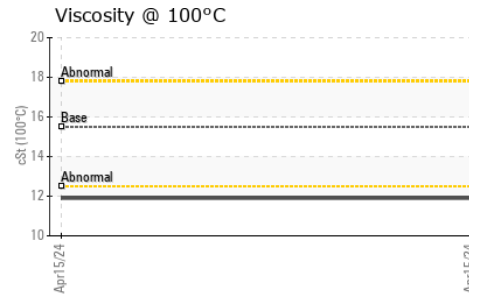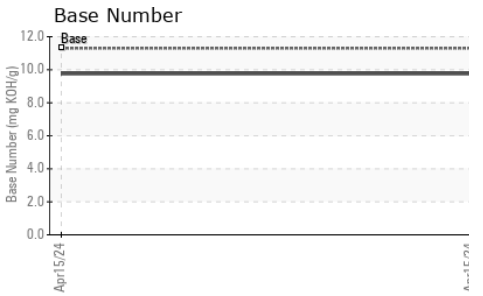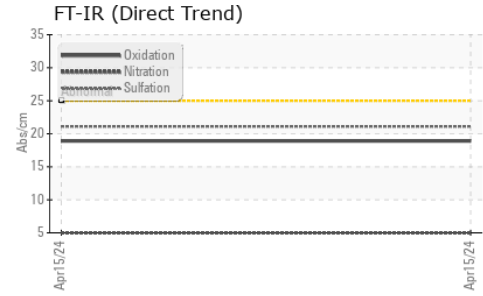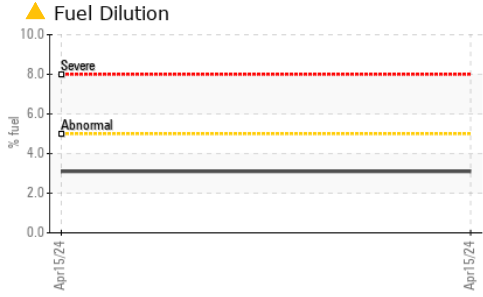

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.5	11.9	---

GRAPHS

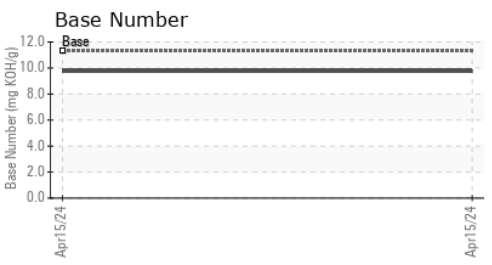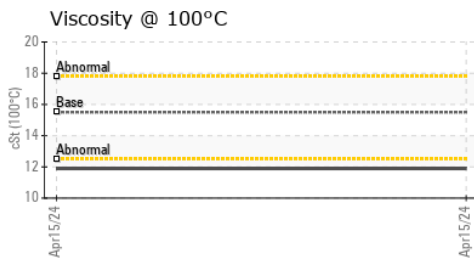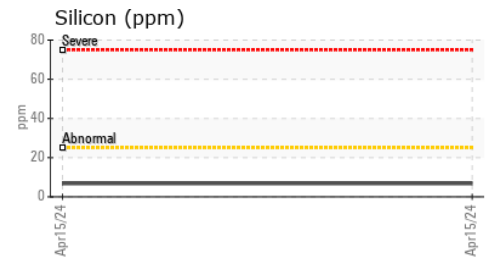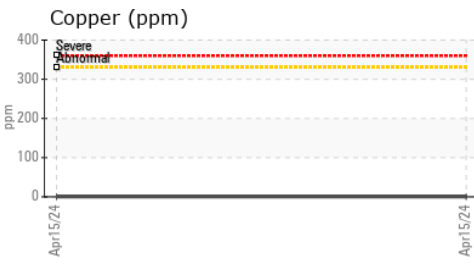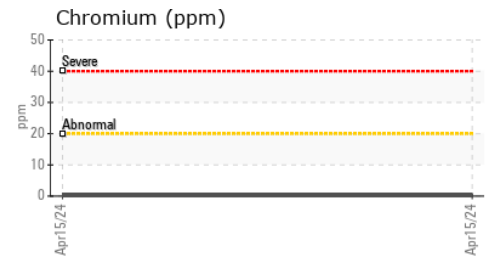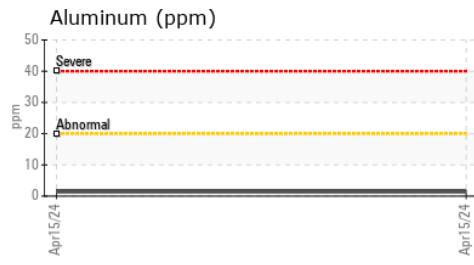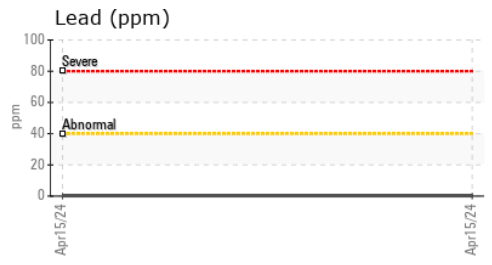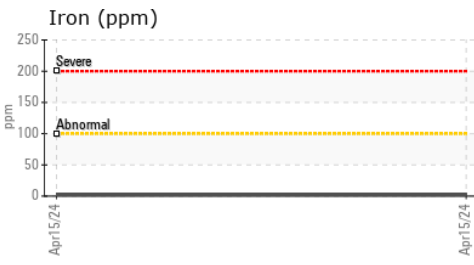

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0577824 **Received** : 20 May 2024
Lab Number : 06185236 **Tested** : 23 May 2024
Unique Number : 11036562 **Diagnosed** : 23 May 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

NEO GENERATOR AND ENGINE, LLC
 10225 PORTLAND AVE SW
 BEACH CITY, OH
 US 44608
 Contact: BILL HOOD
 BHood@neogenservice.com
 T: (330)284-8390
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)