




# OIL ANALYSIS REPORT

## Sample Rating Trend

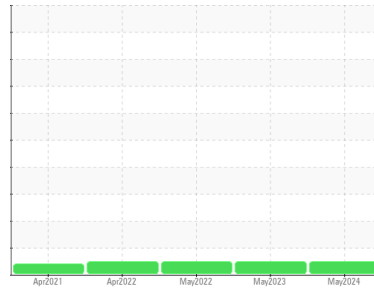

**NORMAL**



Machine Id  
**DUTCHESS COUNTY MEDICAL EXAMINER LR0429752**  
 Component  
**Diesel Engine**  
 Fluid  
 **DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0921622</b>	WC0799937	WC0699486
Sample Date	Client Info		<b>20 May 2024</b>	02 May 2023	19 May 2022
Machine Age	hrs	Client Info	<b>0</b>	0	127
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>2</b>	4	<1
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	2
Copper	ppm	ASTM D5185m >330	<b>2</b>	3	<1
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	<b>14</b>	10	0
Barium	ppm	ASTM D5185m 10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 100	<b>59</b>	46	57
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 450	<b>797</b>	628	869
Calcium	ppm	ASTM D5185m 3000	<b>1305</b>	1358	1079
Phosphorus	ppm	ASTM D5185m 1150	<b>1209</b>	1025	1011
Zinc	ppm	ASTM D5185m 1350	<b>1261</b>	1229	1217
Sulfur	ppm	ASTM D5185m 4250	<b>3765</b>	3901	3350

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	5	3
Sodium	ppm	ASTM D5185m >158	<b>2</b>	2	<1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	0

### INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0.4</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>9.1</b>	5.0	4.7
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>22.4</b>	14.1	18.0

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>21.4</b>	11.1	13.1
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>8.7</b>	8.8	9.8











# OIL ANALYSIS REPORT

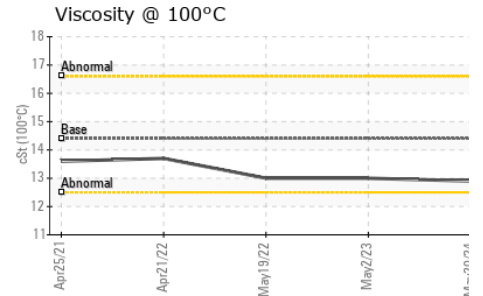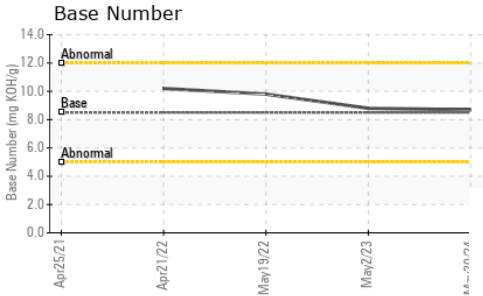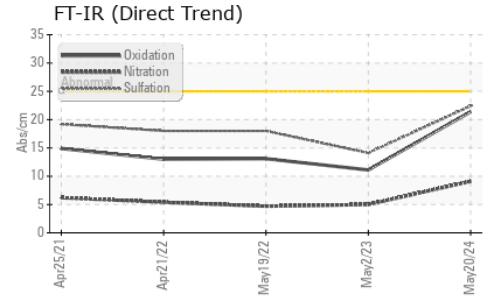

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.9</b>	13.0	13.0

## GRAPHS

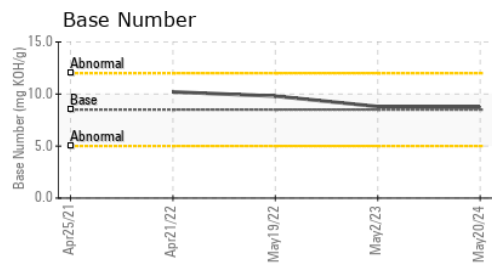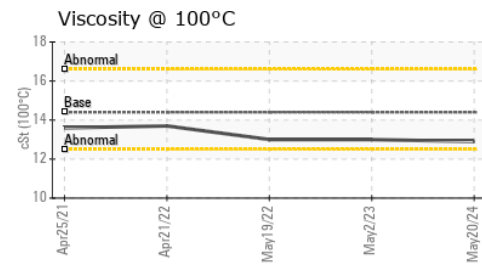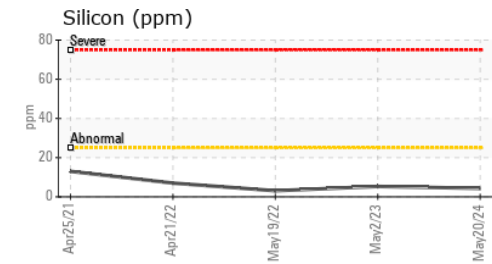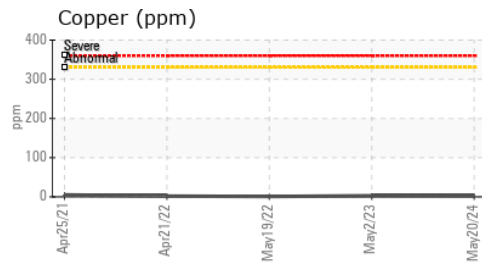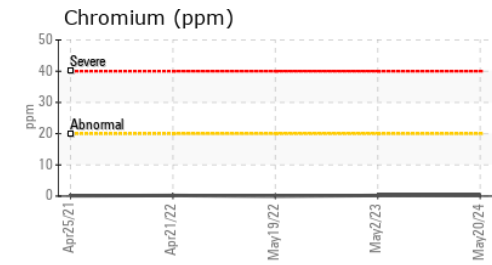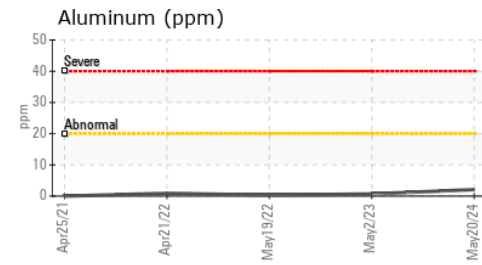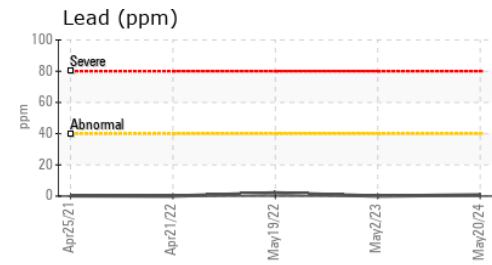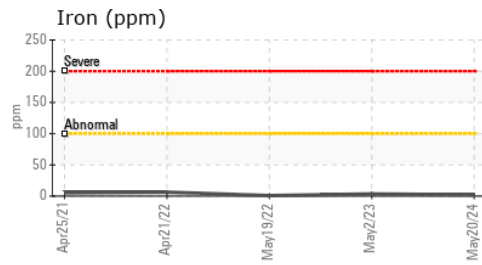

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0921622      **Received** : 20 May 2024  
**Lab Number** : **06185565**      **Tested** : 22 May 2024  
**Unique Number** : 11036891      **Diagnosed** : 22 May 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)