




OIL ANALYSIS REPORT

Sample Rating Trend

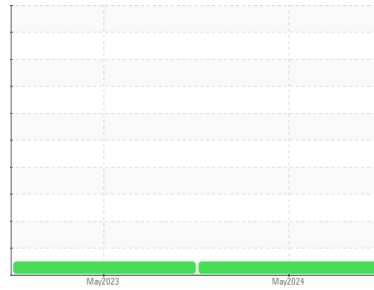

NORMAL



Machine Id
Dutchess County Courthouse 454462
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0921683	WC0799934	---
Sample Date	Client Info	20 May 2024	02 May 2023	---
Machine Age	hrs	0	0	---
Sample Status		NORMAL	NORMAL	---

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >2	0	0	---
Chromium	ppm	ASTM D5185m >2	0	0	---
Nickel	ppm	ASTM D5185m >2	0	0	---
Titanium	ppm	ASTM D5185m >2	<1	0	---
Silver	ppm	ASTM D5185m >2	<1	0	---
Aluminum	ppm	ASTM D5185m >2	0	0	---
Lead	ppm	ASTM D5185m >2	0	0	---
Copper	ppm	ASTM D5185m >2	0	0	---
Tin	ppm	ASTM D5185m >2	0	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 2	0	0	---
Barium	ppm	ASTM D5185m 2	0	0	---
Molybdenum	ppm	ASTM D5185m 2	0	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m 2	<1	3	---
Calcium	ppm	ASTM D5185m 2	0	0	---
Phosphorus	ppm	ASTM D5185m 2	<1	3	---
Zinc	ppm	ASTM D5185m 2	0	0	---
Sulfur	ppm	ASTM D5185m 10	9	0	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >10	<1	0	---
Sodium	ppm	ASTM D5185m >5	<1	0	---
Potassium	ppm	ASTM D5185m >20	0	0	---


VISUAL

method	limit/base	current	history1	history2	
White Metal	scalar	*Visual NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual NONE	NONE	NONE	---
Precipitate	scalar	*Visual NONE	NONE	NONE	---
Silt	scalar	*Visual NONE	NONE	NONE	---
Debris	scalar	*Visual NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	---
Appearance	scalar	*Visual NORML	NORML	NORML	---
Odor	scalar	*Visual NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual >0.05	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---



OIL ANALYSIS REPORT

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image
GRAPHS						



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0921683

Lab Number : 06185679

Unique Number : 11037005

Test Package : MOB 1

Received : 20 May 2024

Tested : 23 May 2024

Diagnosed : 23 May 2024 - Jonathan Hester

GEN TECH LTD

3017 RT 9W

NEW WINDSOR, NY

US 12553

Contact: JOE SAYEGH

joe@gentechltd.com

T: (845)568-0500

F: (845)568-3073

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)