




FUEL REPORT

Sample Rating Trend

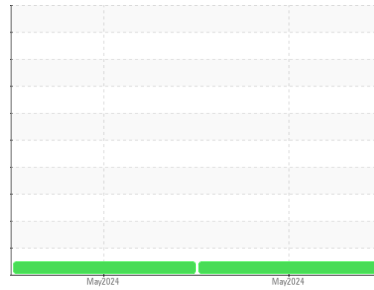

NORMAL



Area

Rutherford Regional Hospital
Machine Id
[Rutherford Regional Hospital] LDR GEN

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (350 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a moderate amount of particulates present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) present in the sample.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B). Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC06185735	WC06185739	---
Sample Date	Client Info	20 May 2024	19 May 2024	---
Machine Age	hrs	Client Info	0	0
Sample Status			NORMAL	NORMAL

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500	L4.5	L4.5
Visc @ 40°C	cSt	ASTM D445	3.0	2.4
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	61

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	5
Sulfur (UVF)	ppm	ASTM D5453	18	119

DISTILLATION

method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	174
5% Distillation Point	°C	ASTM D86		198
10% Distill Point	°C	ASTM D86	201	207
15% Distillation Point	°C	ASTM D86		215
20% Distill Point	°C	ASTM D86	216	223
30% Distill Point	°C	ASTM D86	230	236
40% Distill Point	°C	ASTM D86	243	249
50% Distill Point	°C	ASTM D86	255	262
60% Distill Point	°C	ASTM D86	267	275
70% Distill Point	°C	ASTM D86	280	288
80% Distill Point	°C	ASTM D86	295	302
85% Distillation Point	°C	ASTM D86		312
90% Distill Point	°C	ASTM D86	310	323
95% Distillation Point	°C	ASTM D86		339
Final Boiling Point	°C	ASTM D86	341	354

IGNITION QUALITY






method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36
Cetane Index		ASTM D4737	<40.0	47

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0
Sodium	ppm	ASTM D5185m	<0.1	0
Potassium	ppm	ASTM D5185m	<0.1	0
Water	%	ASTM D6304	<0.05	0.001
ppm Water	ppm	ASTM D6304	<500	15
% Gasoline	%	*In-House	<0.50	0.0
% Biodiesel	%	*In-House	<20.0	0.0



FUEL REPORT

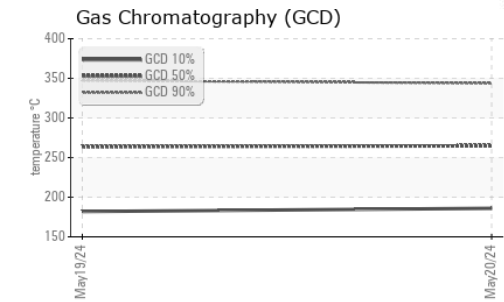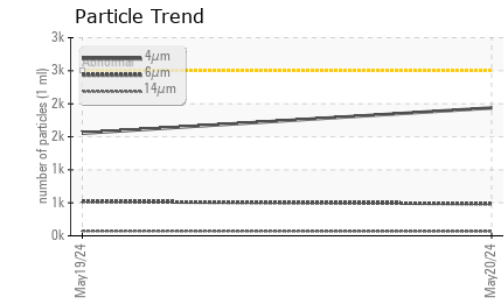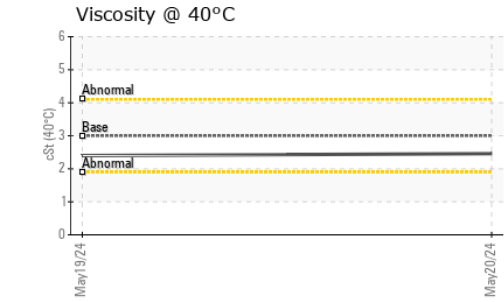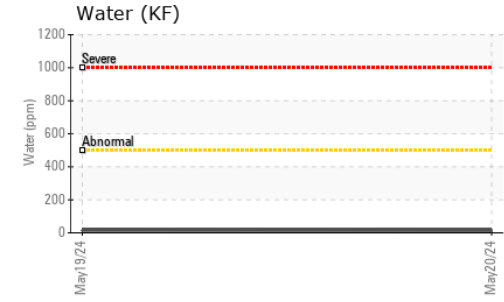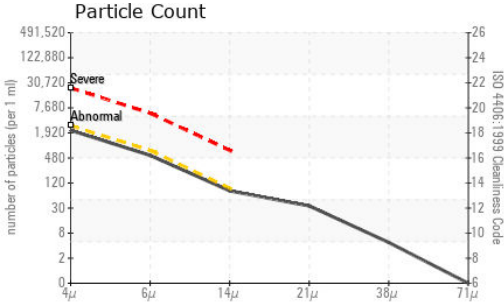

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	1937	1554	---
Particles >6µm	ASTM D7647	>640	487	519	---
Particles >14µm	ASTM D7647	>80	69	73	---
Particles >21µm	ASTM D7647	>20	30	25	---
Particles >38µm	ASTM D7647	>4	4	1	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	18/16/13	18/16/13	---




HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	0	---
Nickel	ppm	ASTM D5185m <0.1	0	0	---
Lead	ppm	ASTM D5185m <0.1	0	0	---
Vanadium	ppm	ASTM D5185m <0.1	0	0	---
Iron	ppm	ASTM D5185m <0.1	0	0	---
Calcium	ppm	ASTM D5185m <0.1	0	0	---
Magnesium	ppm	ASTM D5185m <0.1	0	0	---
Phosphorus	ppm	ASTM D5185m <0.1	0	<1	---
Zinc	ppm	ASTM D5185m <0.1	0	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

no image

no image

GRAPHS

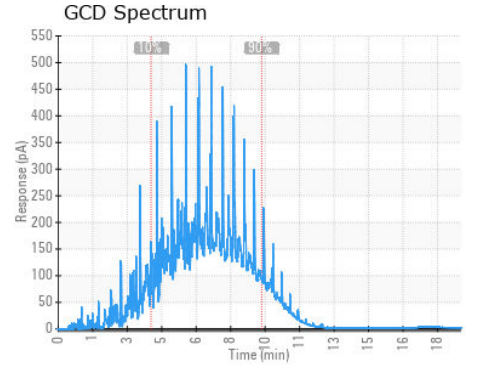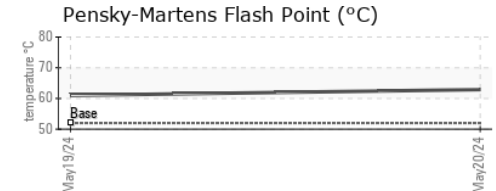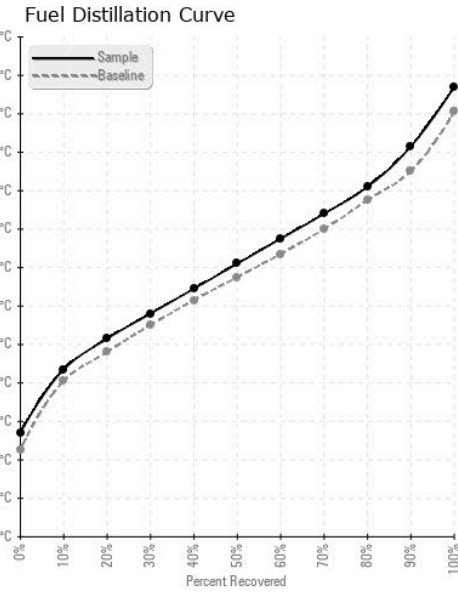

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06185735 **Received** : 20 May 2024
Lab Number : **06185735** **Tested** : 28 May 2024
Unique Number : 11037061 **Diagnosed** : 28 May 2024 - Doug Bogart
Test Package : DF-2 (Additional Tests: Fuel, Screen)

PETROLEUM RECOVERY SERVICES
 210 POWELL DR
 SUMMERVILLE, SC
 US 29483
 Contact: AJAY EL
 Ajay@prsfuel.com
 T: (843)225-1777
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)