

## FUEL REPORT

### Area **Rutherford Regional Hospital** [Rutherford Regional Hospital] GEN DAY 3 Component

**Diesel Fuel** 

Fluid No.2 DIESEL FUEL (ULTRALOW SULPHUR) (100 GAL)

#### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

#### Corrosion


All metal levels are normal indicating no corrosion in the system.

#### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

#### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation.



Sample Rating Trend




NORMAL

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06185738		
Sample Date		Client Info		20 May 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.44		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	61.1		
SULFUR CONTE	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	132		
Sulfur (UVF)	ppm	ASTM D5453		115		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	171		
5% Distillation Point	°C	ASTM D86		194		
10% Distill Point	°C	ASTM D86	201	204		
15% Distillation Point	°C	ASTM D86		211		
20% Distill Point	°C	ASTM D86	216	219		
30% Distill Point	°C	ASTM D86	230	234		
40% Distill Point	°C	ASTM D86	243	247		
50% Distill Point	°C	ASTM D86	255	261		
60% Distill Point	°C	ASTM D86	267	275		
70% Distill Point	°C	ASTM D86	280	289		
80% Distill Point	°C	ASTM D86	295	305		
85% Distillation Point	°C	ASTM D86		316		
90% Distill Point	°C	ASTM D86	310	326		
95% Distillation Point	°C	ASTM D86		345		
Final Boiling Point	°C	ASTM D86	341	361		
IGNITION QUALI	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36		
Cetane Index		ASTM D4737	<40.0	48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	0		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304	<0.05	0.002		
ppm Water	ppm	ASTM D6304	<500	17		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		



# FUEL REPORT

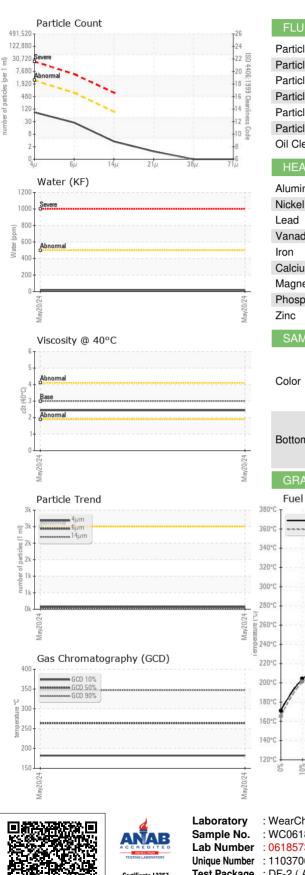


**FLUID CLEANLINESS** 74 ASTM D7647 >2500 Particles >4µm ----Particles >6um ASTM D7647 >640 24 Particles >14µm ASTM D7647 >80 3 Particles >21µm ASTM D7647 >20 1 Particles >38µm ASTM D7647 0 >4 Particles >71µm 0 ASTM D7647 >3 **Oil Cleanliness** ISO 4406 (c) >18/16/13 13/12/9 HEAVY METALS 0 Aluminum ppm ASTM D5185m <0.1 ASTM D5185m <0.1 0 ppm ppm ASTM D5185m < 0.1 0 Vanadium ppm ASTM D5185m <0.1 0 ASTM D5185m < 0.1 0 naa Calcium 0 ppm ASTM D5185m <0.1 Magnesium ASTM D5185m <0.1 0 ppm Phosphorus <0.1 0 ppm ASTM D5185m < 0.1 0 ppm ASTM D5185m SAMPLE IMAGES no image no image

100

50

#### Bottom

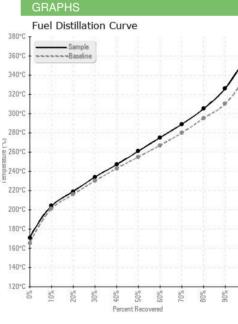

## 8 ₿ 70 60 GCD Spectrum 550 00000 500 450 400 (Pd) 350 300 200 150

Time (min)

no image

Pensky-Martens Flash Point (°C)

no image



: WearCheck USA - 501 Madison Ave., Cary, NC 27513 PETROLEUM RECOVERY SERVICES : WC06185738 Received : 20 May 2024 Lab Number : 06185738 Tested : 28 May 2024 Unique Number : 11037064 Diagnosed : 28 May 2024 - Doug Bogart Test Package : DF-2 (Additional Tests: Fuel, Screen) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

210 POWELL DR SUMMERVILLE, SC US 29483 Contact: AJAY EL Ajay@prsfuel.com T: (843)225-1777 E:

16 20

Report Id: PETSUM [WUSCAR] 06185738 (Generated: 05/28/2024 20:07:50) Rev: 1

Contact/Location: AJAY EL - PETSUM