

OIL ANALYSIS REPORT

Sample Rating Trend



DEGRADATION



Machine Id
NOT GIVEN TO106193491 (S/N NO SIF/NO INFO ON BOTTLE)
 Component
Heat Transfer Fluid
 Fluid
{not provided} (--- LTR)

DIAGNOSIS

- Recommendation**
The fluid is suitable for further service. Resample at the next service interval to monitor. All tests and evaluation performed at WearCheck Canada.
- Contamination**
Pentane Insolubles levels are abnormally high.
- Fluid Condition**
Acid Number (AN) is abnormally high. Visc @ 40°C is abnormally low.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO106193491	---	---
Sample Date	Client Info		27 May 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	11	---	---
Chromium	ppm	ASTM D5185m	>21	0	---	---
Nickel	ppm	ASTM D5185m	>21	0	---	---
Titanium	ppm	ASTM D5185m	>21	0	---	---
Silver	ppm	ASTM D5185m	>21	0	---	---
Aluminum	ppm	ASTM D5185m	>21	0	---	---
Lead	ppm	ASTM D5185m	>21	0	---	---
Copper	ppm	ASTM D5185m	>21	0	---	---
Tin	ppm	ASTM D5185m	>21	0	---	---
Antimony	ppm	ASTM D5185m	>21	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Beryllium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<1	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		1	---	---
Phosphorus	ppm	ASTM D5185m		<1	---	---
Zinc	ppm	ASTM D5185m		<1	---	---
Sulfur	ppm	ASTM D5185m		5023	---	---
Lithium	ppm	ASTM D5185m		<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	0	---	---
Sodium	ppm	ASTM D5185m	>21	<1	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Water	%	ASTM D6304	>0.0601	0.005	---	---
ppm Water	ppm	ASTM D6304	>601	53	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		▲ 0.49	---	---






FLUID PROPERTIES

	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445		▲ 44.6	---	---
COC Flash Point	°C	ASTM D92		228	---	---

SEDIMENT

	method	limit/base	current	history1	history2	
Pentane Insolubles	%	*ASTM D893		▲ 0.494	---	---



OIL ANALYSIS REPORT

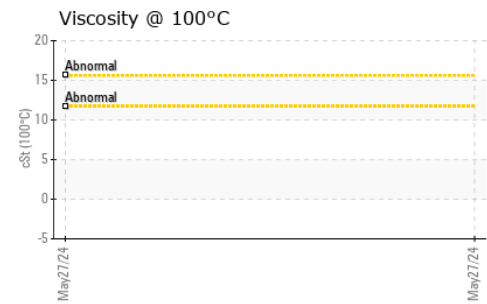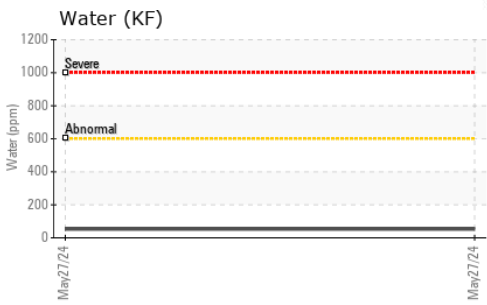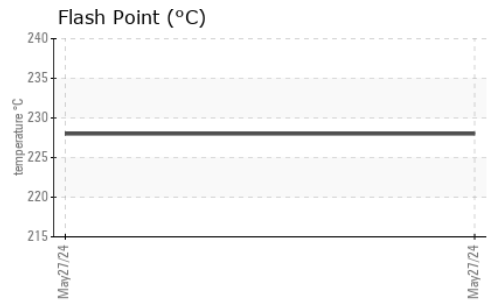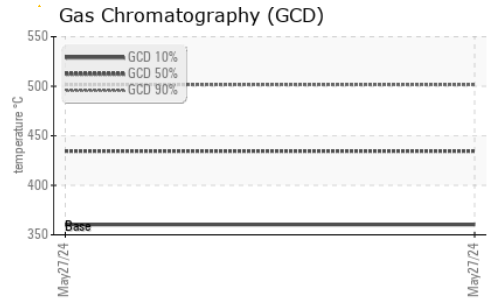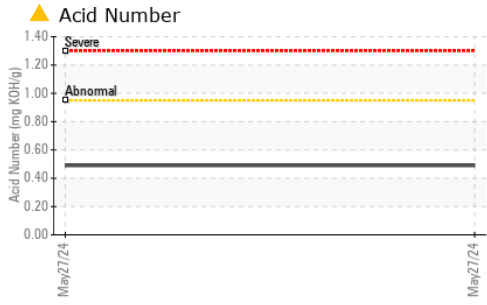

SIMULATED DISTILLATION (GCD)	method	limit/base	current	history1	history2
(GCD) % < 335°C	°C	*ASTM D2887	5.15	---	---
(GCD) Initial Boiling Point	°C	*ASTM D2887	122	---	---
(GCD) 5% Distillation Point	°C	*ASTM D2887	329.8	---	---
(GCD) 10% Distillation Point	°C	*ASTM D2887	157	---	---
(GCD) 20% Distillation Point	°C	*ASTM D2887	389.2	---	---
(GCD) 30% Distillation Point	°C	*ASTM D2887	406.8	---	---
(GCD) 40% Distillation Point	°C	*ASTM D2887	421.1	---	---
(GCD) 50% Distillation Point	°C	*ASTM D2887	204	---	---
(GCD) 60% Distillation Point	°C	*ASTM D2887	447.4	---	---
(GCD) 70% Distillation Point	°C	*ASTM D2887	461.0	---	---
(GCD) 80% Distillation Point	°C	*ASTM D2887	477.2	---	---
(GCD) 90% Distillation Point	°C	*ASTM D2887	501.4	---	---
(GCD) FB% Distillation Point	°C	*ASTM D2887	322	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			no image	no image	no image
Bottom			no image	no image	no image

GRAPHS

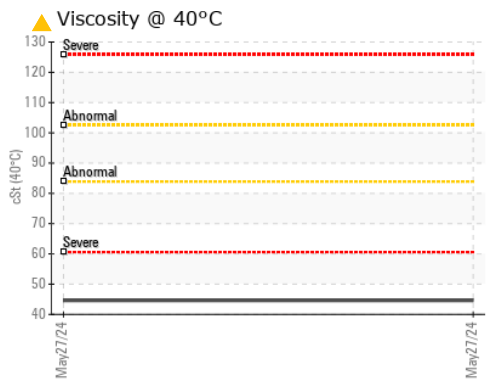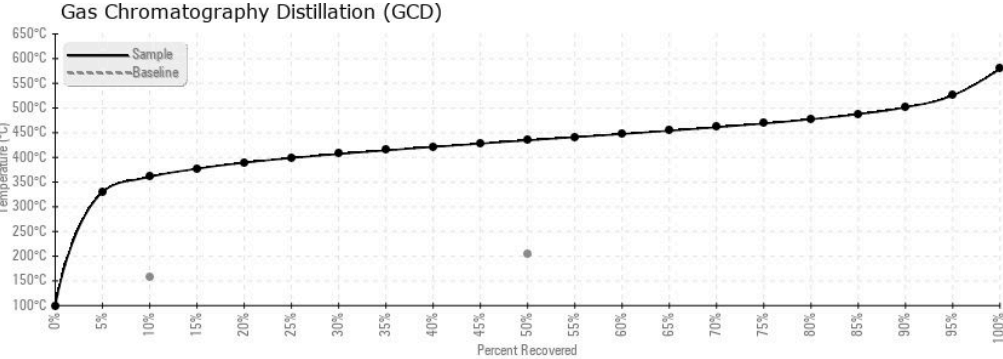

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO106193491
Lab Number : 06193491
Unique Number : 11050243
Test Package : IND 2 (Additional Tests: COC Flash, GCD, KF, KV100, PntInsoCmt)

Received : 28 May 2024
Tested : 17 Jun 2024
Diagnosed : 17 Jun 2024 - Doug Bogart

ERGON - TORREON
 SAN JUDAS TADEO #240 PARQUE INDUSTR, FERROPUERTO
 TORREON, ZZ
 MX 27400
 Contact: JUAN ALBERTO HERNANDEZ
 juan.hernandez@ergon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: