




OIL ANALYSIS REPORT

Sample Rating Trend

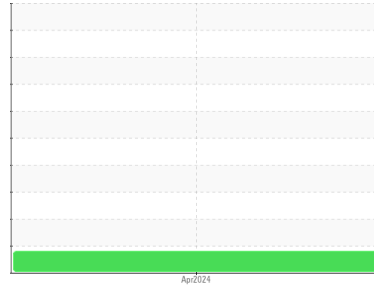

FUEL



Machine Id
16E0005966

Component
Diesel Engine

Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is SAE 30 Diesel Engine Oil. Please confirm the oil type and grade, and specify the brand of the oil on your next sample. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

▲ Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0911416	---	---
Sample Date	Client Info	23 Apr 2024	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		MARGINAL	---	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	---	---
Glycol	WC Method	NEG	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >100	9	---	---
Chromium ppm	ASTM D5185m >20	<1	---	---
Nickel ppm	ASTM D5185m >4	0	---	---
Titanium ppm	ASTM D5185m	0	---	---
Silver ppm	ASTM D5185m >3	<1	---	---
Aluminum ppm	ASTM D5185m >20	<1	---	---
Lead ppm	ASTM D5185m >40	2	---	---
Copper ppm	ASTM D5185m >330	4	---	---
Tin ppm	ASTM D5185m >15	<1	---	---
Vanadium ppm	ASTM D5185m	<1	---	---
Cadmium ppm	ASTM D5185m	<1	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	---	---
Barium ppm	ASTM D5185m	0	---	---
Molybdenum ppm	ASTM D5185m	5	---	---
Manganese ppm	ASTM D5185m	<1	---	---
Magnesium ppm	ASTM D5185m	285	---	---
Calcium ppm	ASTM D5185m	2775	---	---
Phosphorus ppm	ASTM D5185m	1199	---	---
Zinc ppm	ASTM D5185m	1398	---	---
Sulfur ppm	ASTM D5185m	5230	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	4	---	---
Sodium ppm	ASTM D5185m	5	---	---
Potassium ppm	ASTM D5185m >20	1	---	---
Fuel %	ASTM D3524 >5	▲ 4.6	---	---

INFRA-RED





method	limit/base	current	history1	history2
Soot %	*ASTM D7844 >3	0.1	---	---
Nitration	*ASTM D7624 >20	6.0	---	---
Sulfation	*ASTM D7415 >30	16.8	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	13.9	---	---
Base Number (BN)	mg KOH/g ASTM D2896	10.8	---	---











OIL ANALYSIS REPORT

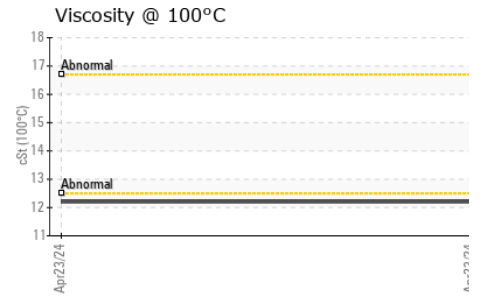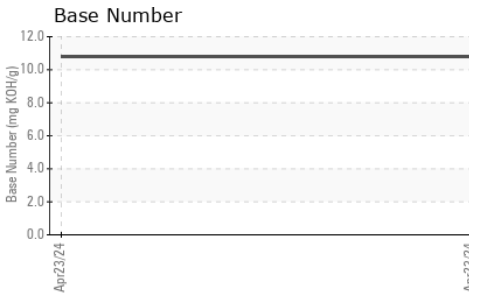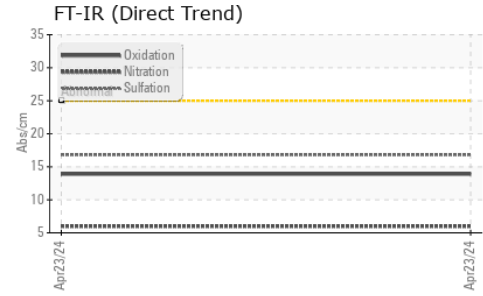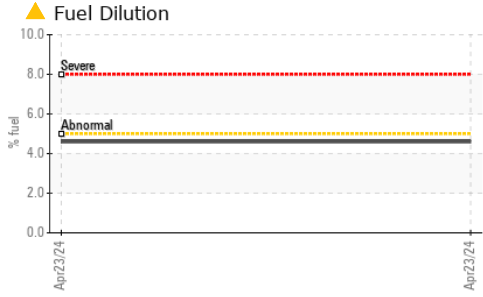

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.2	---	---

GRAPHS

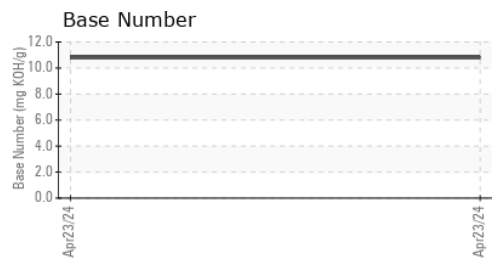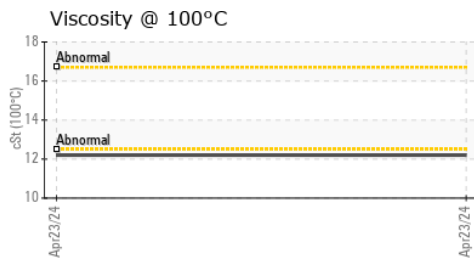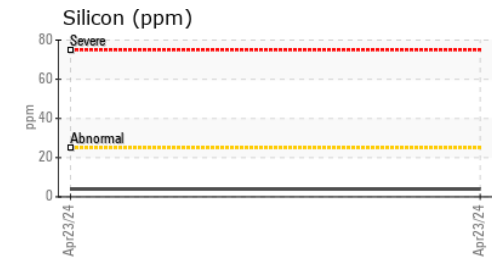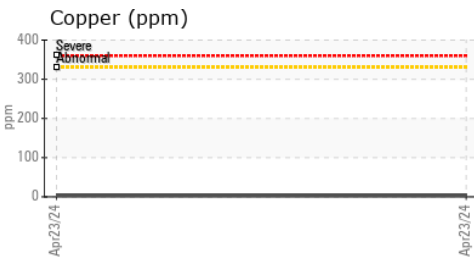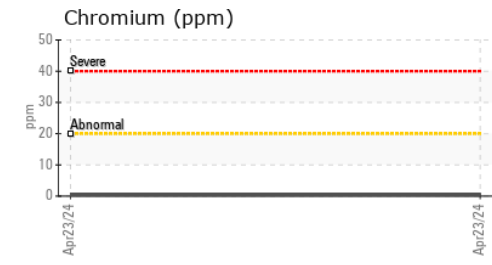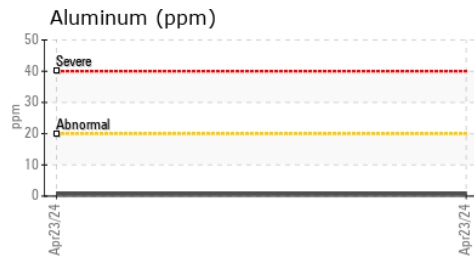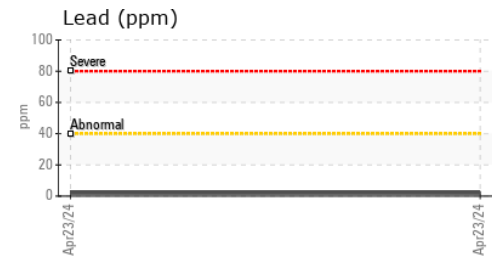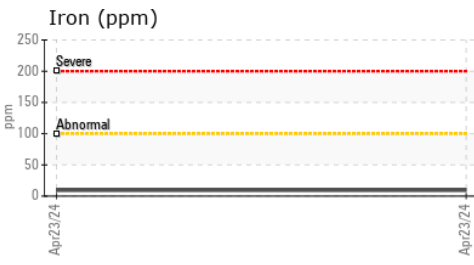

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0911416 **Received** : 29 May 2024
Lab Number : 06193523 **Tested** : 31 May 2024
Unique Number : 11050275 **Diagnosed** : 31 May 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, TBN)

LOFTIN EQUIPMENT
 5204 BEAR CREEK CT
 IRVING, TX
 US 75061
 Contact: Service Manager
 servicemid@loftinequip.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)