




OIL ANALYSIS REPORT

Sample Rating Trend

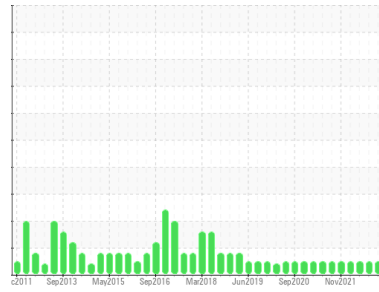

NORMAL



Area

Black Eagle

Machine Id

BLE03 (S/N H00241)

Component

Reservoir Governor System

Fluid

CONOCO HYDRAULIC AW ISO 46 (35 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0926185	WC0843418	WC0670735
Sample Date	Client Info	18 May 2024	29 Feb 2024	14 Sep 2022
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<1	0	1
Chromium	ppm ASTM D5185m >10	0	<1	0
Nickel	ppm ASTM D5185m >10	0	0	<1
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m	<1	0	0
Aluminum	ppm ASTM D5185m >3	0	2	<1
Lead	ppm ASTM D5185m >75	2	<1	<1
Copper	ppm ASTM D5185m >15	<1	<1	<1
Tin	ppm ASTM D5185m >55	<1	0	<1
Vanadium	ppm ASTM D5185m	<1	0	0
Cadmium	ppm ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	<1	0	0
Magnesium	ppm ASTM D5185m	<1	<1	<1
Calcium	ppm ASTM D5185m	47	49	47
Phosphorus	ppm ASTM D5185m	336	273	336
Zinc	ppm ASTM D5185m 3100	429	411	447
Sulfur	ppm ASTM D5185m	1001	746	964

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >8	<1	<1	<1
Sodium	ppm ASTM D5185m	1	0	1
Potassium	ppm ASTM D5185m >20	1	<1	<1





FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >2500	363	1312	177
Particles >6µm	ASTM D7647 >640	73	33	27
Particles >14µm	ASTM D7647 >80	5	2	2
Particles >21µm	ASTM D7647 >20	1	0	1
Particles >38µm	ASTM D7647 >4	0	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >18/16/13	16/13/10	18/12/9	15/12/9

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.4	0.31	0.435	0.33


OIL ANALYSIS REPORT

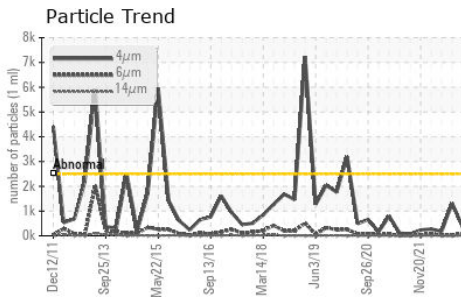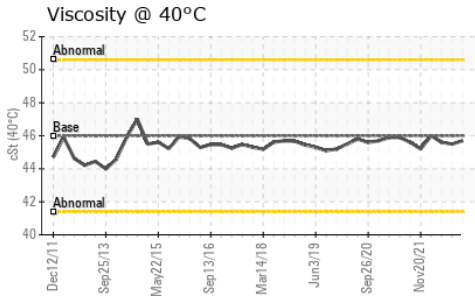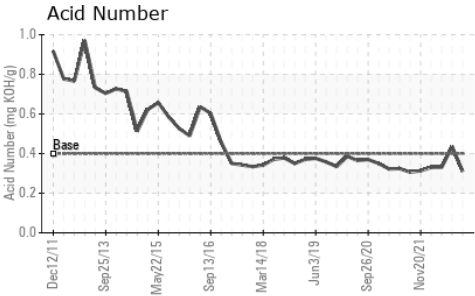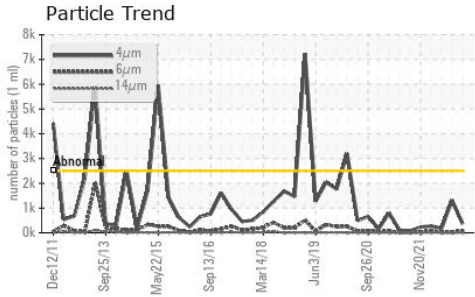






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.7	45.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

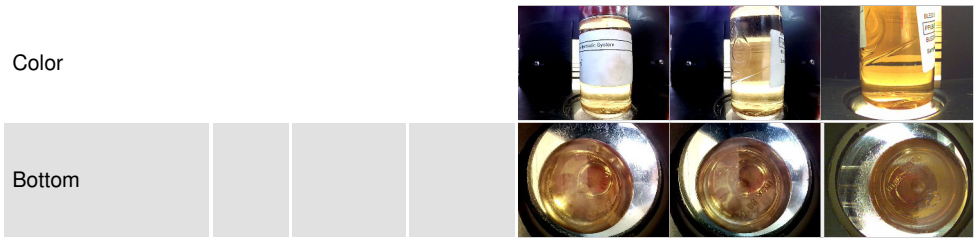

GRAPHS

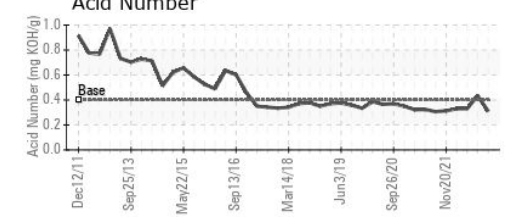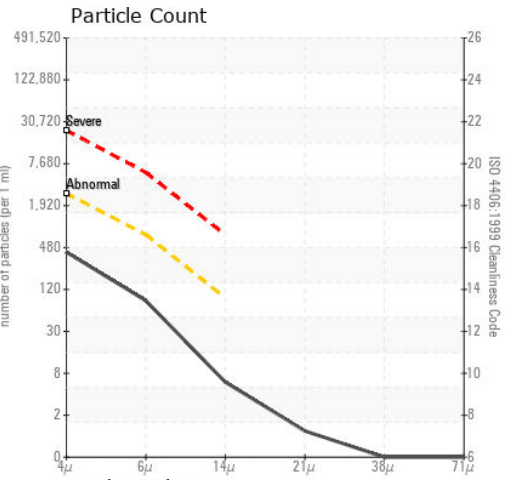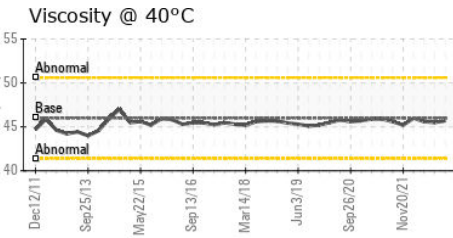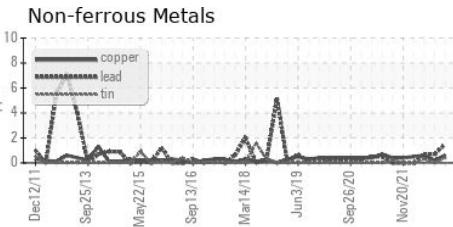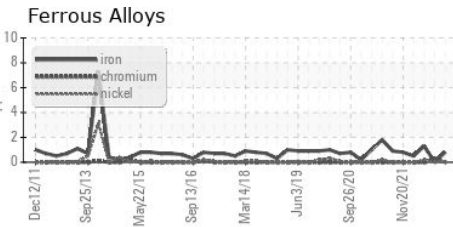

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0926185 **Received** : 29 May 2024
Lab Number : 06193960 **Tested** : 03 Jun 2024
Unique Number : 11056083 **Diagnosed** : 03 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

NORTHWESTERN ENERGY
 6700 RAINBOW DAM RD
 GREAT FALLS, MT
 US 59404
 Contact: Derek Besich
 derek.besich@northwestern.com
 T: (406)268-2325
 F: (406)533-3401

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)