




OIL ANALYSIS REPORT

Sample Rating Trend

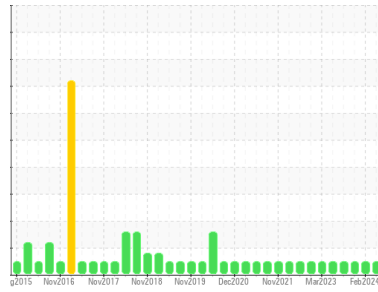

NORMAL



Area

Rainbow

Machine Id

RNB09-02 Turbine Guide Bearing

Component

Oil Filter Guide Bearing

Fluid

CHEVRON GST OIL ISO 68 (35 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0926189	WC0843453	WC0843398
Sample Date	Client Info	18 May 2024	29 Feb 2024	08 Nov 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	0	0
Chromium	ppm	ASTM D5185m >20	0	<1
Nickel	ppm	ASTM D5185m >20	0	0
Titanium	ppm	ASTM D5185m	<1	0
Silver	ppm	ASTM D5185m	<1	0
Aluminum	ppm	ASTM D5185m >20	0	2
Lead	ppm	ASTM D5185m >20	<1	0
Copper	ppm	ASTM D5185m >20	0	0
Tin	ppm	ASTM D5185m >20	<1	0
Vanadium	ppm	ASTM D5185m	<1	0
Cadmium	ppm	ASTM D5185m	<1	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0
Barium	ppm	ASTM D5185m	0	0
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	<1	0
Magnesium	ppm	ASTM D5185m	<1	1
Calcium	ppm	ASTM D5185m	0	3
Phosphorus	ppm	ASTM D5185m	5	1
Zinc	ppm	ASTM D5185m	<1	0
Sulfur	ppm	ASTM D5185m	1105	800

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	2	1
Sodium	ppm	ASTM D5185m	1	0
Potassium	ppm	ASTM D5185m >20	2	<1

FLUID CLEANLINESS





method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >2500	784	527	312
Particles >6µm	ASTM D7647 >640	166	103	63
Particles >14µm	ASTM D7647 >80	9	5	4
Particles >21µm	ASTM D7647 >20	3	1	1
Particles >38µm	ASTM D7647 >4	0	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >18/16/13	17/15/10	16/14/10	15/13/9

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.074	0.42




OIL ANALYSIS REPORT

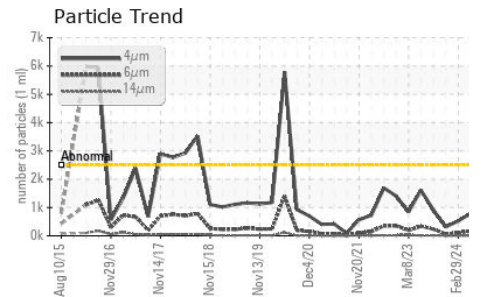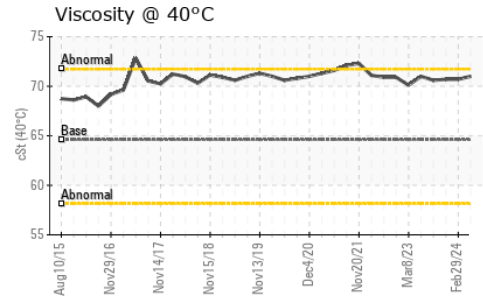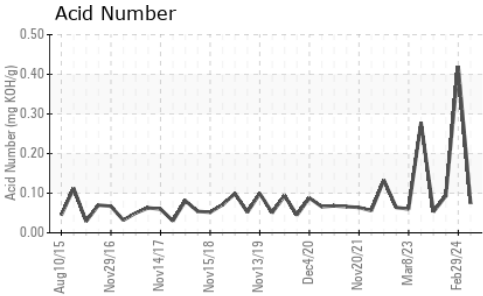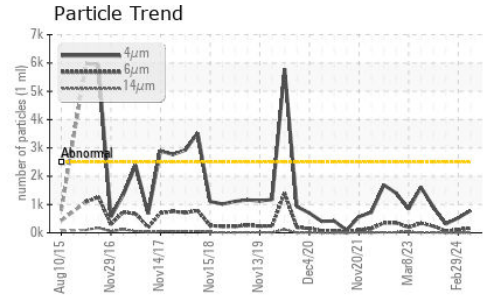






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.6	71.0	70.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

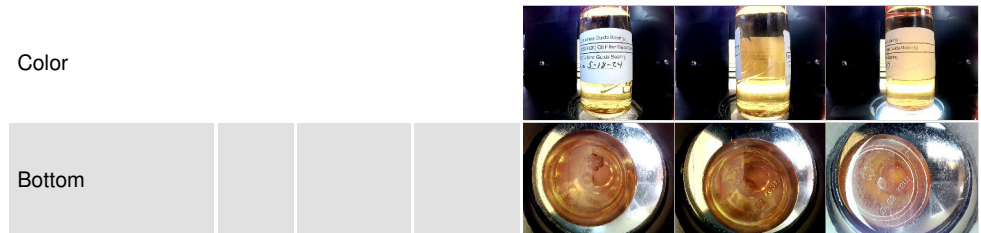

GRAPHS

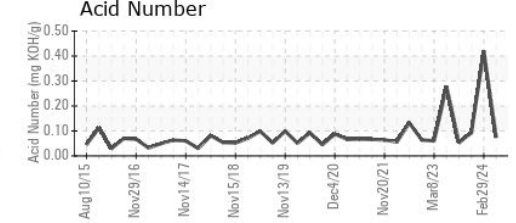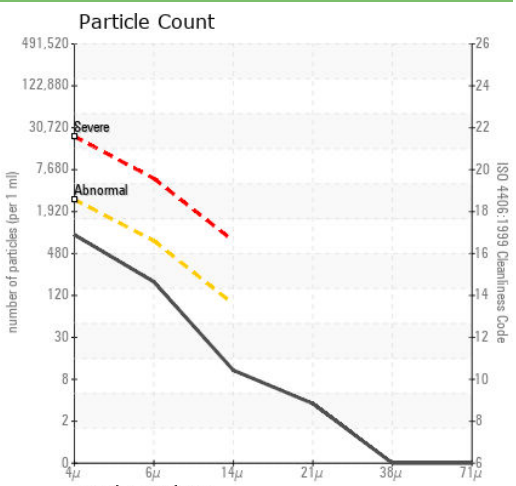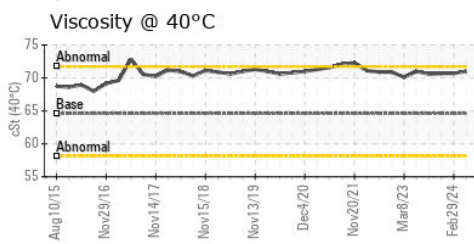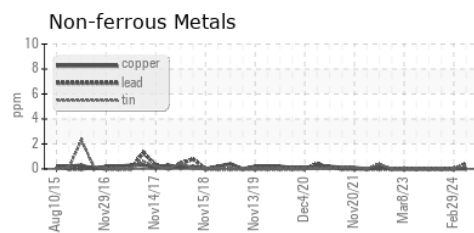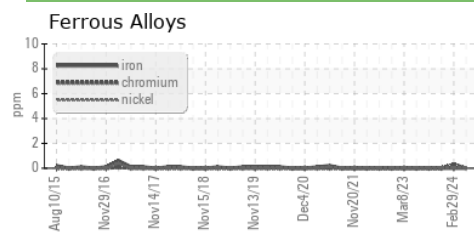

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0926189 **Received** : 29 May 2024
Lab Number : 06193964 **Tested** : 30 May 2024
Unique Number : 11056087 **Diagnosed** : 31 May 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: PrtCount)

NORTHWESTERN ENERGY
 6700 RAINBOW DAM RD
 GREAT FALLS, MT
 US 59404
 Contact: STANLEY BOGNATZ
 srb@mbesi.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (570)575-9252
F: (570)227-0014