




OIL ANALYSIS REPORT

Sample Rating Trend

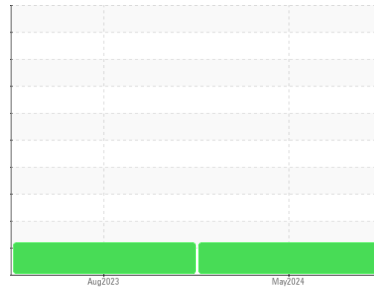

ISO



Machine Id
6975195 (S/N 1169)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a moderate amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA012391	KCPA005663	---
Sample Date	Client Info		09 May 2024	07 Aug 2023	---
Machine Age	hrs	Client Info	30317	49808	---
Oil Age	hrs	Client Info	3357	0	---
Oil Changed	Client Info		Changed	N/A	---
Sample Status			ATTENTION	ATTENTION	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	<1	0	---
Silver	ppm	ASTM D5185m >2	<1	0	---
Aluminum	ppm	ASTM D5185m >10	<1	<1	---
Lead	ppm	ASTM D5185m >10	<1	0	---
Copper	ppm	ASTM D5185m >50	2	4	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	68	53	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m 100	62	54	---
Calcium	ppm	ASTM D5185m 0	3	<1	---
Phosphorus	ppm	ASTM D5185m 0	22	<1	---
Zinc	ppm	ASTM D5185m 0	6	6	---
Sulfur	ppm	ASTM D5185m 23500	22427	21750	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	---
Sodium	ppm	ASTM D5185m	35	27	---
Potassium	ppm	ASTM D5185m >20	8	6	---
Water	%	ASTM D6304 >0.05	0.020	0.033	---
ppm Water	ppm	ASTM D6304 >500	208	336.9	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8289	2676	---
Particles >6µm	ASTM D7647 >1300		1768	888	---
Particles >14µm	ASTM D7647 >80		90	93	---
Particles >21µm	ASTM D7647 >20		16	22	---
Particles >38µm	ASTM D7647 >4		0	1	---
Particles >71µm	ASTM D7647 >3		0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		20/18/14	19/17/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.35	0.35	---


OIL ANALYSIS REPORT

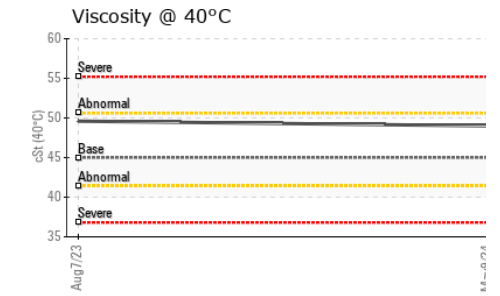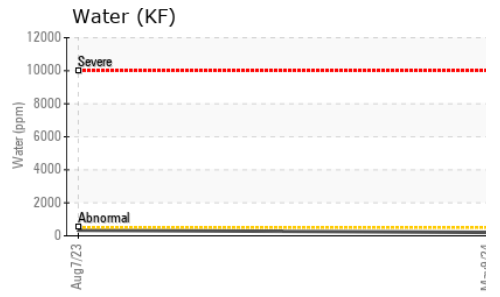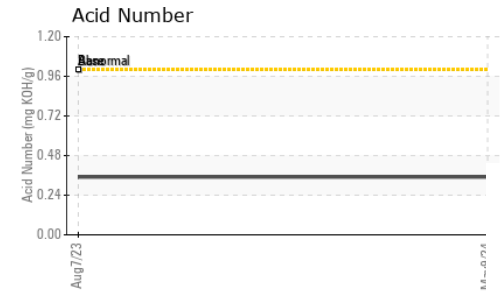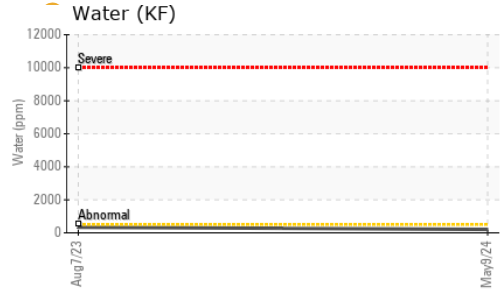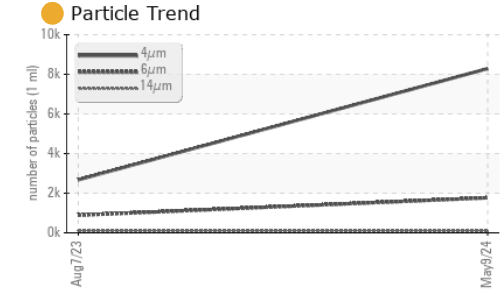






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.0	49.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

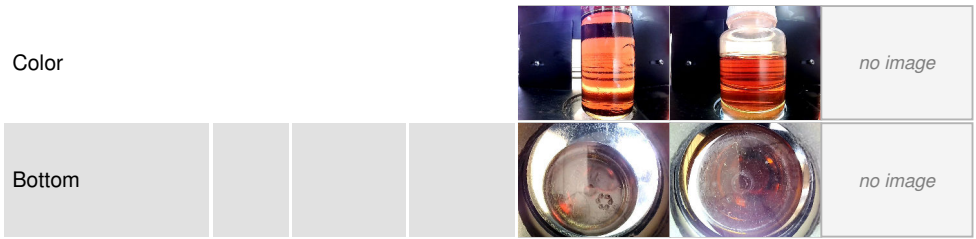

GRAPHS

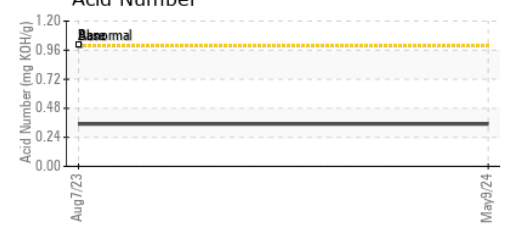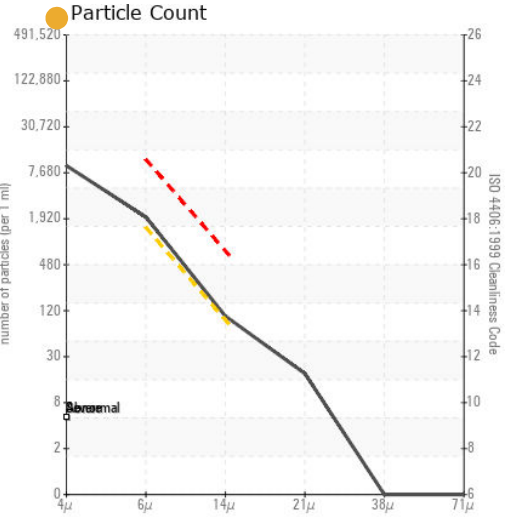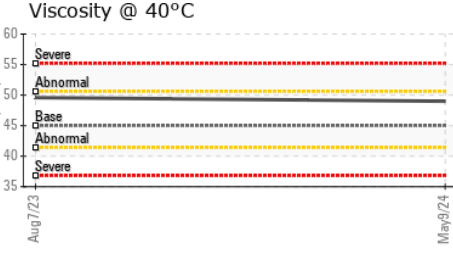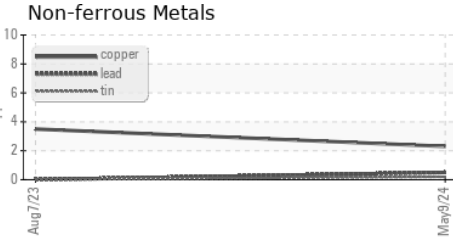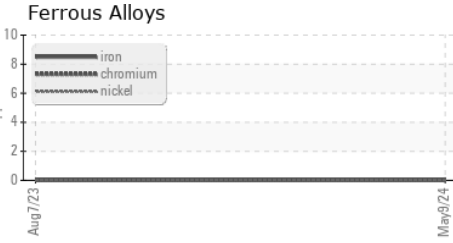

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA012391
Lab Number : 06193975
Unique Number : 11056098
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 29 May 2024
Tested : 30 May 2024
Diagnosed : 31 May 2024 - Angela Borella

GOLDEN STATE MEDICAL SUPPLY
 5187 CAMINO RUIZ
 CAMARILLO, CA
 US 93012
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)