



# OIL ANALYSIS REPORT

## Sample Rating Trend



Machine Id  
**3017724 (S/N 1322)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA012356</b>	KCPA005667	---
Sample Date	Client Info			<b>09 May 2024</b>	07 Aug 2023	---
Machine Age	hrs	Client Info		<b>52889</b>	49828	---
Oil Age	hrs	Client Info		<b>3061</b>	0	---
Oil Changed	Client Info			<b>Changed</b>	N/A	---
Sample Status				<b>ABNORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>2</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>2</b>	3	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>39</b>	36	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	100	<b>70</b>	71	---
Calcium	ppm	ASTM D5185m	0	<b>3</b>	1	---
Phosphorus	ppm	ASTM D5185m	0	<b>2</b>	0	---
Zinc	ppm	ASTM D5185m	0	<b>11</b>	12	---
Sulfur	ppm	ASTM D5185m	23500	<b>22364</b>	25858	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>37</b>	26	---
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	5	---
Water	%	ASTM D6304	>0.05	<b>0.027</b>	0.039	---
ppm Water	ppm	ASTM D6304	>500	<b>277</b>	396.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>56954</b>	6035	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 17527</b>	▲ 2028	---
Particles >14µm		ASTM D7647	>80	<b>▲ 530</b>	▲ 201	---
Particles >21µm		ASTM D7647	>20	<b>▲ 63</b>	▲ 48	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	2	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 23/21/16</b>	▲ 20/18/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.35</b>	0.34	---


# OIL ANALYSIS REPORT

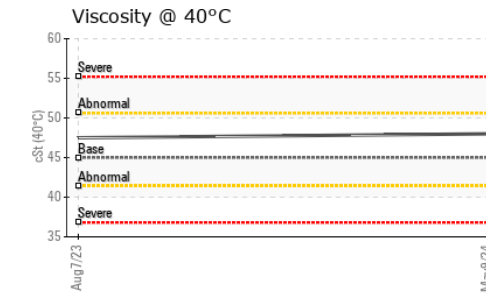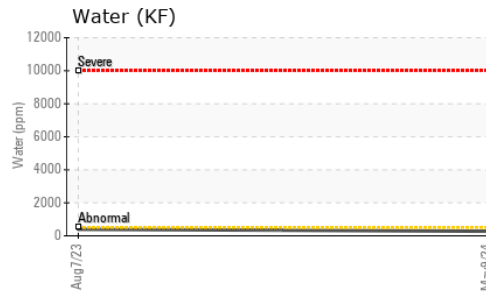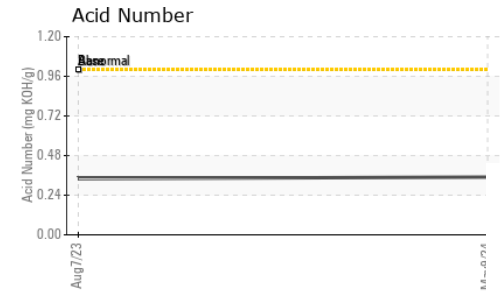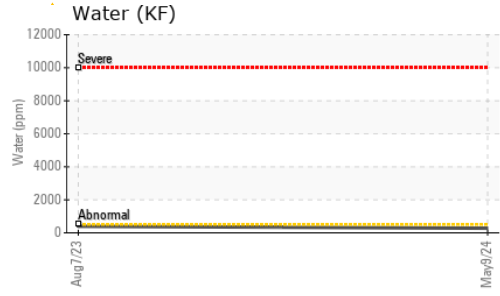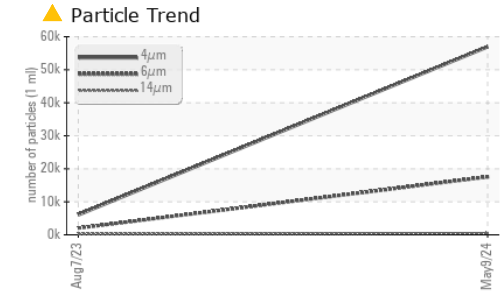






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.0	47.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

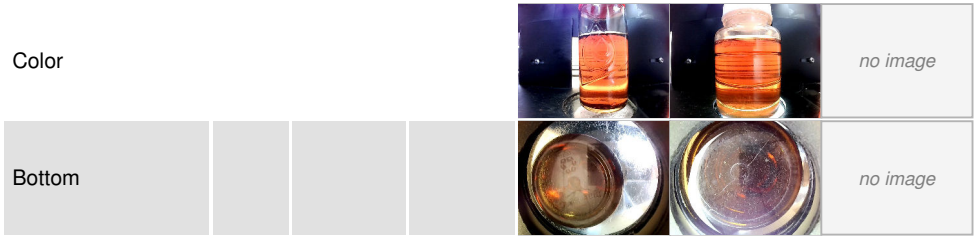

## GRAPHS

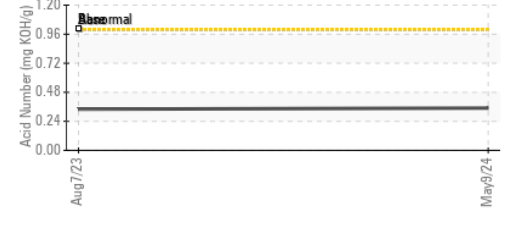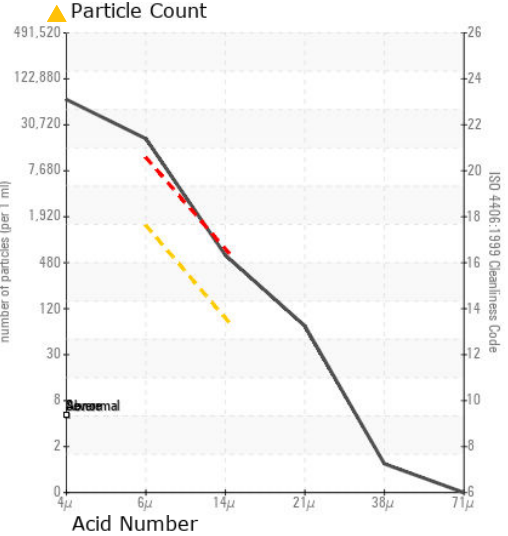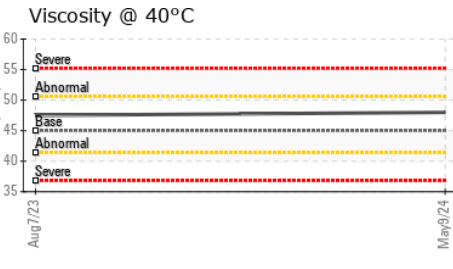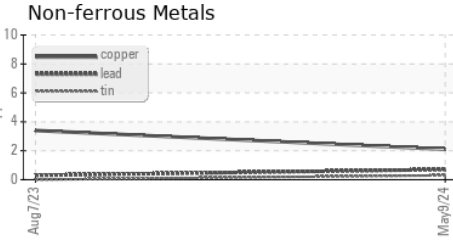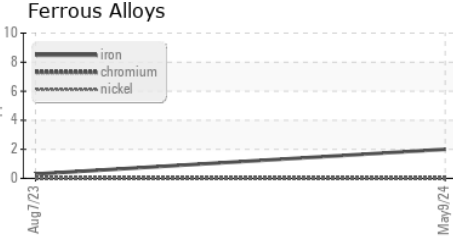

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012356 **Received** : 29 May 2024  
**Lab Number** : 06193976 **Tested** : 30 May 2024  
**Unique Number** : 11056099 **Diagnosed** : 31 May 2024 - Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**GOLDEN STATE MEDICAL SUPPLY**  
 5187 CAMINO RUIZ  
 CAMARILLO, CA  
 US 93012  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)