




PROBLEM SUMMARY

Sample Rating Trend

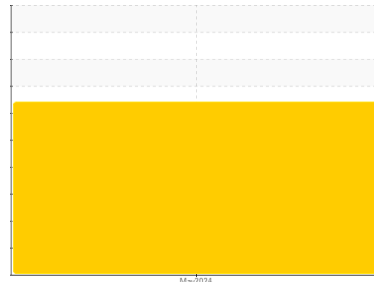


WATER



Machine Id
KAESER 7349957
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

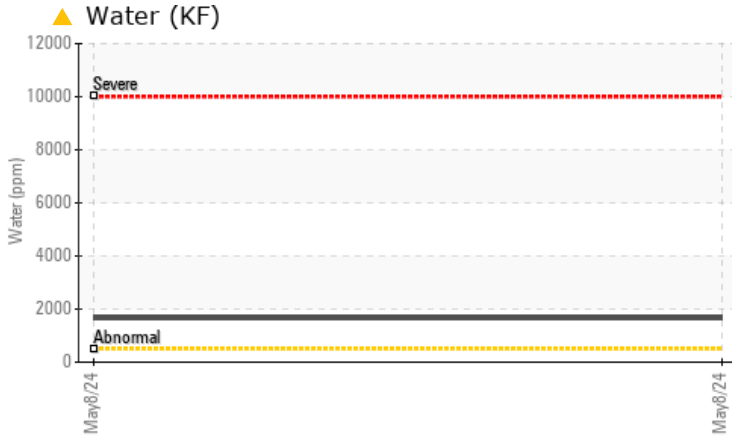

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	---	---
Water	%	ASTM D6304	>0.05	▲ 0.166	---	---
ppm Water	ppm	ASTM D6304	>500	▲ 1660	---	---
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	---	---
Free Water	scalar	*Visual		▲ >10%	---	---

Customer Id: MARGOLCA
Sample No.: KCPA017202
Lab Number: 06193982
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

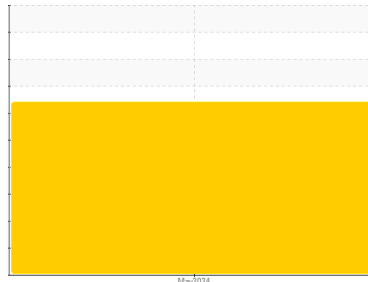

WATER



Machine Id
KAESER 7349957
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

Excessive free water present. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA017202	---	---
Sample Date	Client Info			08 May 2024	---	---
Machine Age	hrs	Client Info		7871	---	---
Oil Age	hrs	Client Info		1107	---	---
Oil Changed	Client Info			Changed	---	---
Sample Status				SEVERE	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>3	0	---	---
Titanium	ppm	ASTM D5185m	>3	<1	---	---
Silver	ppm	ASTM D5185m	>2	<1	---	---
Aluminum	ppm	ASTM D5185m	>10	<1	---	---
Lead	ppm	ASTM D5185m	>10	<1	---	---
Copper	ppm	ASTM D5185m	>50	3	---	---
Tin	ppm	ASTM D5185m	>10	<1	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		<1	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---	---
Barium	ppm	ASTM D5185m	90	<1	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m	100	<1	---	---
Calcium	ppm	ASTM D5185m	0	0	---	---
Phosphorus	ppm	ASTM D5185m	0	2	---	---
Zinc	ppm	ASTM D5185m	0	9	---	---
Sulfur	ppm	ASTM D5185m	23500	22086	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	---	---
Sodium	ppm	ASTM D5185m		2	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---
Water	%	ASTM D6304	>0.05	▲ 0.166	---	---
ppm Water	ppm	ASTM D6304	>500	▲ 1660	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		478	---	---
Particles >6µm		ASTM D7647	>1300	261	---	---
Particles >14µm		ASTM D7647	>80	44	---	---
Particles >21µm		ASTM D7647	>20	15	---	---
Particles >38µm		ASTM D7647	>4	2	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	16/15/13	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.38	---	---


OIL ANALYSIS REPORT

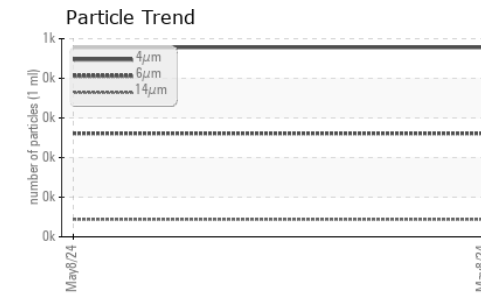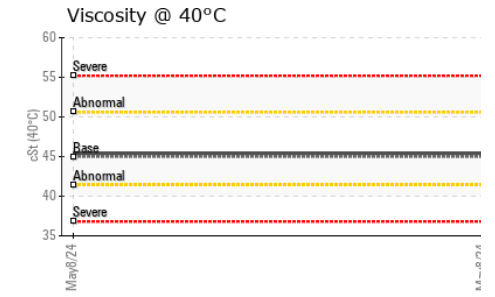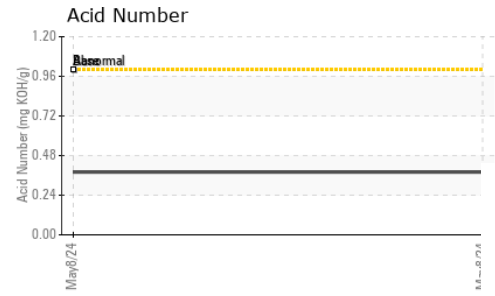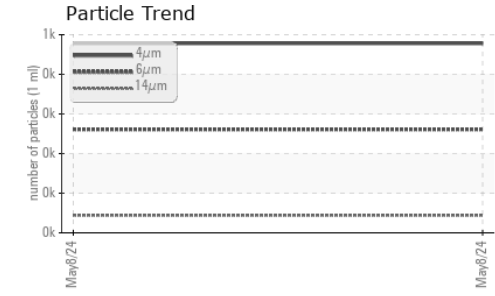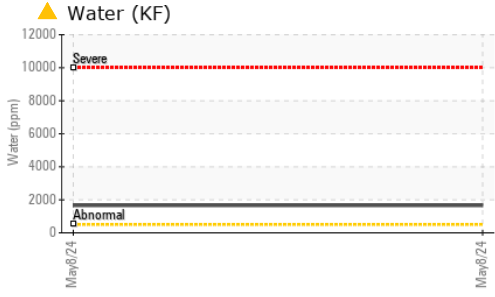





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	---
Free Water	scalar	*Visual		▲ >10%	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

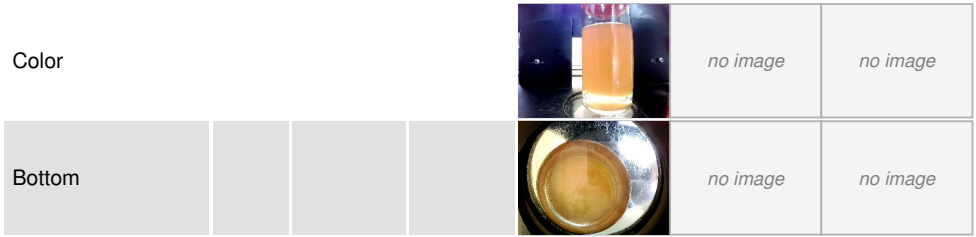

GRAPHS

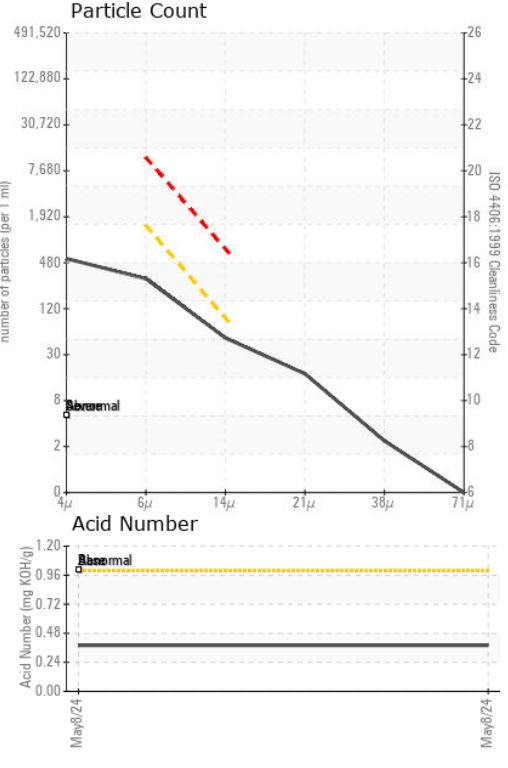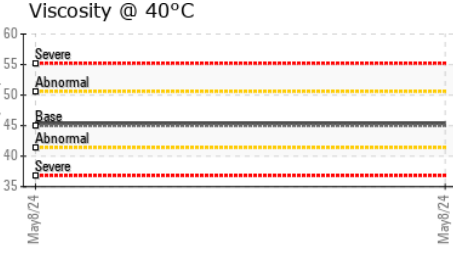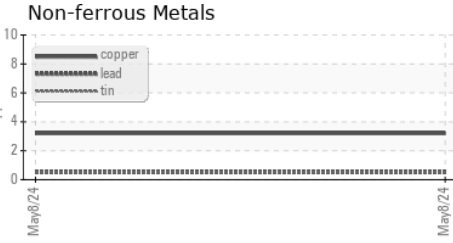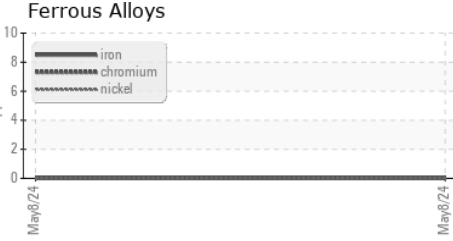

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA017202 **Received** : 29 May 2024
Lab Number : 06193982 **Tested** : 03 Jun 2024
Unique Number : 11056105 **Diagnosed** : 03 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MARBORG INDUSTRIES
 14470 CALLE REAL
 GOLETA, CA
 US 93117
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: