


OIL ANALYSIS REPORT

Sample Rating Trend

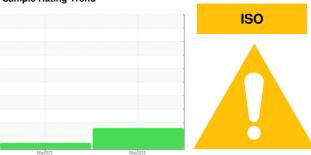

Machine Id

4087819 (S/N 4214)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		L	Mar2023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP55400	KCP54021	
Sample Date		Client Info		28 May 2024	08 Mar 2023	
Machine Age	hrs	Client Info		18372	16652	
Oil Age	hrs	Client Info		0	16652	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	nnm	ASTM D5185m	>50	0	0	,
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum		ASTM D5185m	>10	0	0	
	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m		9	1	
Copper	ppm	ASTM D5185m	>50 >10		0	
	ppm		>10	<1		
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	<1	6	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	1	7	
Zinc	ppm	ASTM D5185m	0	0	2	
Sulfur	ppm	ASTM D5185m	23500	20889	19352	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		1	0	
Potassium	ppm	ASTM D5185m	>20	1	1	
Water	%	ASTM D6304	>0.05	0.007	0.010	
ppm Water	ppm	ASTM D6304	>500	80	102.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9526	1355	
Particles >6μm		ASTM D7647	>1300	<u>2174</u>	364	
Particles >14μm		ASTM D7647	>80	<u> </u>	28	
Particles >21μm		ASTM D7647	>20	47	9	
Particles >38μm		ASTM D7647	>4	2	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/18/15	18/16/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.56	0.37	



OIL ANALYSIS REPORT

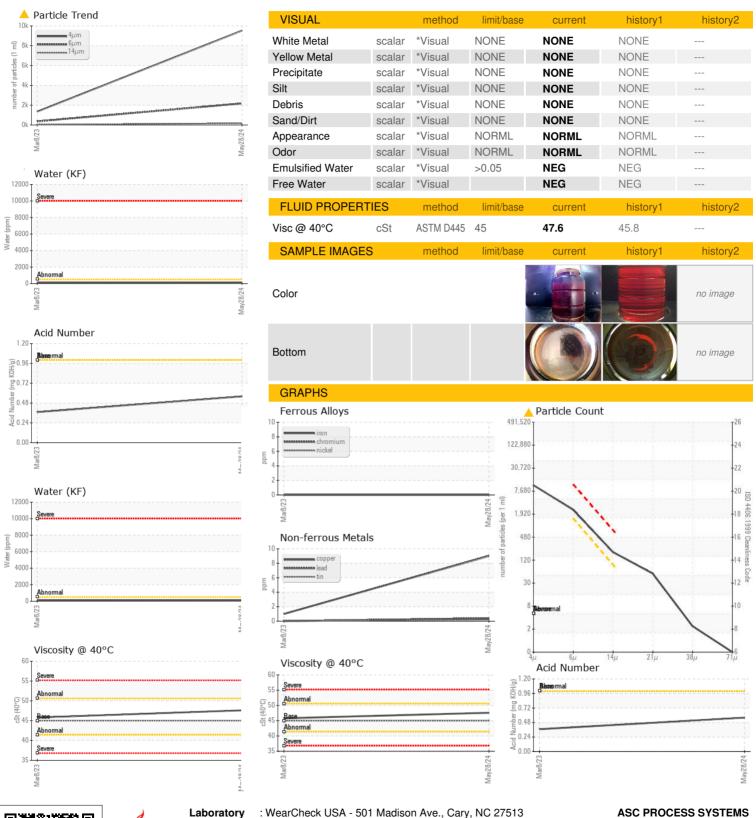





Certificate 12367

Sample No.

Laboratory Lab Number

: KCP55400 : 06193986 Unique Number : 11056109

Received : 29 May 2024 **Tested** Diagnosed

: 30 May 2024 : 31 May 2024 - Angela Borella

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Service Manager T:

Report Id: ASCVAL [WUSCAR] 06193986 (Generated: 05/31/2024 09:59:03) Rev: 1

Contact/Location: Service Manager - ASCVAL

28402 LIVINGSTON AVE

VALENCIA, CA

US 91355

F: