

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

SULLAIR AC3 - 75 HP SULLAIR (S/N 003-128909)

Air Compressor

USPI HT FG 46 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM36311		
Sample Date		Client Info		28 May 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>4	0		
Nickel	ppm	ASTM D5185m	>4	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>20	<1		
Copper	ppm	ASTM D5185m	>40	1		
Tin	ppm	ASTM D5185m	>5	<1		
Vanadium	ppm	ASTM D5185m	/0	<1		
Cadmium	ppm	ASTM D5185m		<1		
	рріп					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m	5	3		
Zinc	ppm	ASTM D5185m		10		
Sulfur	ppm	ASTM D5185m	1	17		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.6	0.028		
ppm Water	ppm	ASTM D6304	>6000	290		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>10000	291		
Particles >6µm		ASTM D7647	>2500	47		
Particles >14µm		ASTM D7647	>320	6		
Particles >21µm		ASTM D7647	>80	1		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	15/13/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.03	0.81		
• ,						



OIL ANALYSIS REPORT

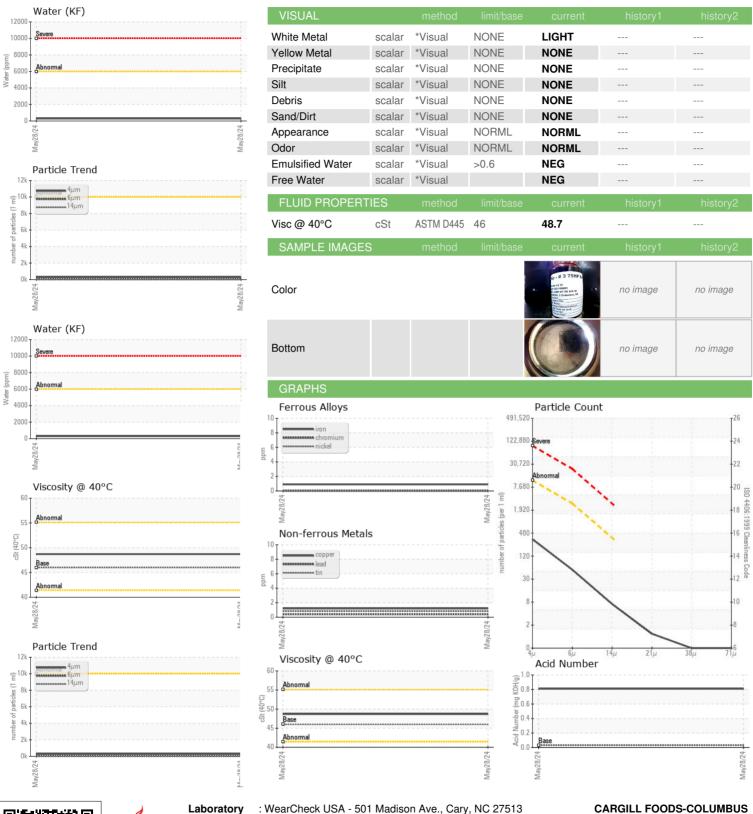



Laboratory Sample No. : USPM36311 Lab Number : 06193991

Unique Number : 11056114 Test Package : IND 2

Received : 29 May 2024 **Tested** : 30 May 2024 Diagnosed : 31 May 2024 - Doug Bogart

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

COLUMBUS, NE

US 68601

Contact:

T:

F: