




# OIL ANALYSIS REPORT

Sample Rating Trend

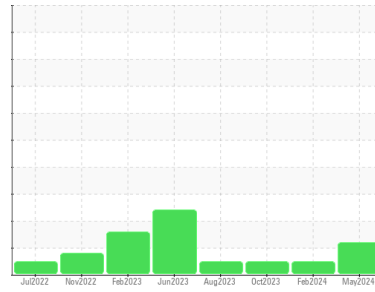

DEGRADATION



Machine Id  
**SULLAIR SULLAIR 1 200HP (S/N 201912180054)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI HT FG 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is approaching the top-end of the recommended limit. Confirmed.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM36308</b>	USPM30905	USPM29787
Sample Date	Client Info	<b>28 May 2024</b>	01 Feb 2024	02 Oct 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>MARGINAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >40	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	0	1
Phosphorus	ppm	ASTM D5185m 5	<b>1</b>	2	2
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 1	<b>33</b>	39	39

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	<1
Water	%	ASTM D6304 >0.6	<b>0.033</b>	0.015	0.055
ppm Water	ppm	ASTM D6304 >6000	<b>333</b>	154	555.7

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>264</b>	275	158
Particles >6µm	ASTM D7647 >2500	<b>46</b>	78	38
Particles >14µm	ASTM D7647 >320	<b>4</b>	15	4
Particles >21µm	ASTM D7647 >80	<b>1</b>	5	2
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>15/13/9</b>	15/13/11	14/12/9

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.03	<b>▲ 1.36</b>	0.65	0.40




# OIL ANALYSIS REPORT

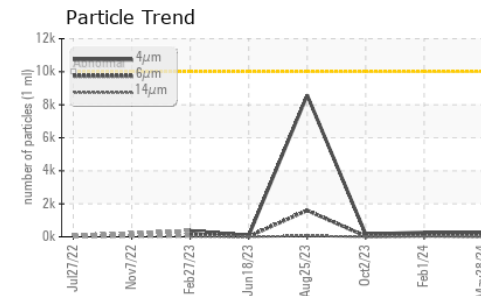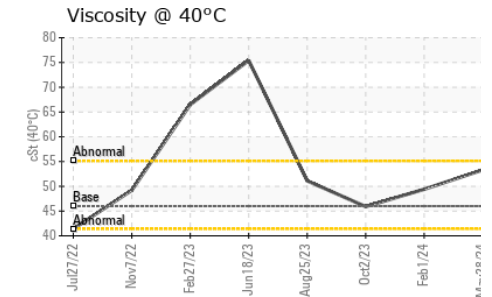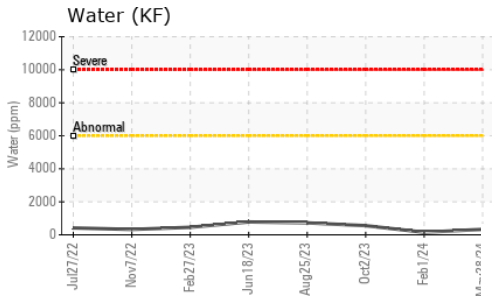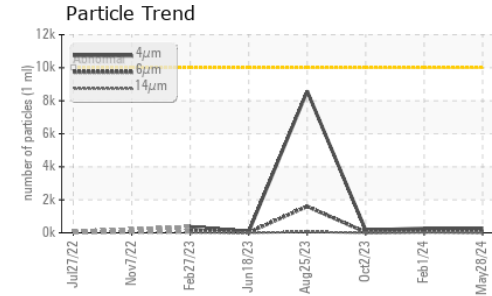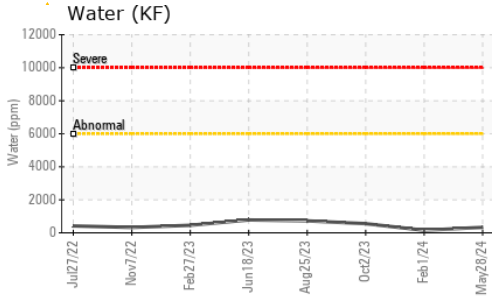





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	53.3	49.4	45.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

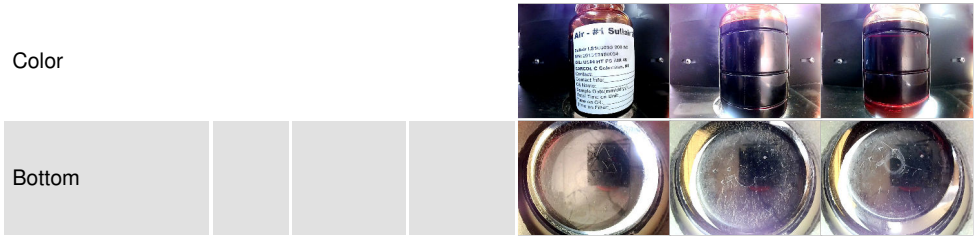

## GRAPHS

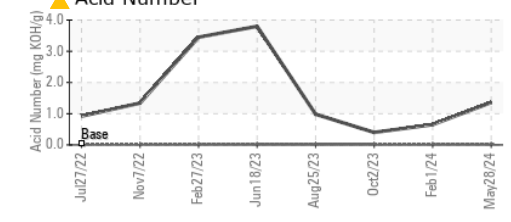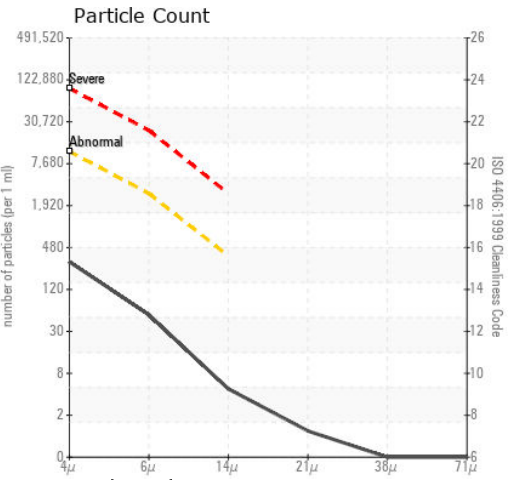

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36308 **Received** : 29 May 2024  
**Lab Number** : 06193992 **Tested** : 30 May 2024  
**Unique Number** : 11056115 **Diagnosed** : 31 May 2024 - Doug Bogart  
**Test Package** : IND 2

**CARGILL FOODS-COLUMBUS**  
 COLUMBUS, NE  
 US 68601  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)