

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# MYCOM S-4 MFG (S/N 2012183)

Rotary Compressor

**CHEVRON CAPELLA OIL WF 68 (110 GAL)** 

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		n2006 Jul201	0 Jul2012 Jan2014 J	an 2016 Apr 2018 Oct 2019 Oct 20	21 Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012855	USP247117	USP247112
Sample Date		Client Info		10 May 2024	17 Nov 2023	22 May 2023
Machine Age	hrs	Client Info		88933	88606	87052
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	10	7	12
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>4	<1	0	0
Copper	ppm	ASTM D5185m	>20	0	0	<1
Tin	ppm	ASTM D5185m	>3	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		2	3	2
Sulfur	ppm	ASTM D5185m		44	12	23
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>45	<1	0	<1
Sodium	ppm	ASTM D5185m		1	0	0
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water	%	ASTM D6304	>0.6	0.001	0.002	0.00
ppm Water	ppm	ASTM D6304		9	16	0.00
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		5397	815	18232
Particles >6µm		ASTM D7647	>2500	555	225	3321
Particles >14μm		ASTM D7647	>320	8	10	32
Particles >21µm		ASTM D7647	>80	2	2	1
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	20/16/10	17/15/10	21/19/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.028	0.014	0.015





## **OIL ANALYSIS REPORT**



35k -		μm μm			1			
30k +		4μm			Λ			
20k -					A //			
15k -					1			1
10k		17771	۸		NIA		A /	1
5k 0k					V	$\sim$	V.	-1
Jan24/06	Jul19/10	Jul24/12	Jan 16/14	18	Apr17/18	Oct9/19	0ct11/21	Nov17/23








VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.6	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
PLUID PHOPENT	IEO	memod	iiiiii/base	current	riistory i	nistoryz
Visc @ 40°C	cSt	ASTM D445	64.0	64.3	64.5	64.5

SAMPLE IMAGES	method	limit/base	current
Color			Address 1937 COSMAN TO A COSMAN VICE A



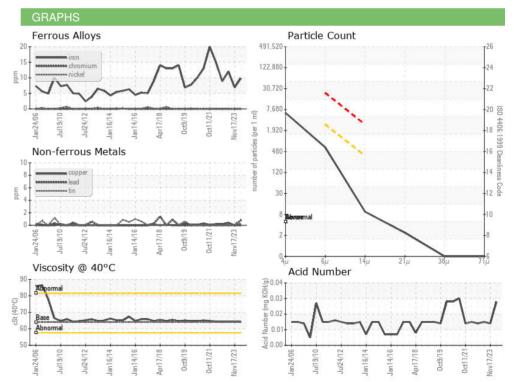





Laboratory Sample No.

Lab Number : 06194002 Unique Number : 11056125

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : USP0012855 Received : 29 May 2024

Diagnosed

**Tested** : 30 May 2024 : 31 May 2024 - Doug Bogart

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

**Bottom** 

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

LINEAGE LOGISTICS HCS, LLC

432 SOUTH PARK WEST TWIN FALLS, ID

US 83301 Contact: KUNJAN SHAH kushah@lineagelogistics.com

T: (857)277-4317

Report Id: LINTWI [WUSCAR] 06194002 (Generated: 05/31/2024 10:06:22) Rev: 1

Contact/Location: KUNJAN SHAH - LINTWI