

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id MYCOM S-2/3 MFG (S/N 2012207/1615349)

Rotary Compressor

Fluid CHEVRON CAPELLA OIL WF 68 (110 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| SAMPLE INFORM | IATION | method | limit/base | current | history1 | history2 |
|----------------------------------|--------|--------------|------------|---------------------|-------------|-------------|
| Sample Number | | Client Info | | USP0012857 | USP247121 | USP247110 |
| Sample Date | | Client Info | | 16 May 2024 | 08 Nov 2023 | 22 May 2023 |
| Machine Age | hrs | Client Info | | 111412 | 111258 | 111120 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >70 | 3 | 1 | 2 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Silver | ppm | ASTM D5185m | | <1 | 0 | 1 |
| Aluminum | ppm | ASTM D5185m | . ? | <1 | 0 | 1 |
| Lead | | ASTM D5185m | >4 | <1 | 0 | 0 |
| | ppm | | | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | | - | | |
| Tin | ppm | ASTM D5185m | >3 | <1 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 0 | <1 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | | 2 | 3 | 0 |
| Phosphorus | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Zinc | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Sulfur | ppm | ASTM D5185m | | 31 | 15 | 39 |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >45 | <1 | 0 | 0 |
| Sodium | ppm | ASTM D5185m | | 1 | 0 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 1 | 0 | 0 |
| Water | % | ASTM D6304 | >0.6 | 0.001 | 0.002 | 0.001 |
| ppm Water | ppm | ASTM D6304 | | 4 | 21 | 0.00 |
| FLUID CLEANLIN | ESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 1062 | 1371 | 1235 |
| Particles >6µm | | ASTM D7647 | >2500 | 196 | 461 | 342 |
| Particles >14µm | | ASTM D7647 | >320 | 12 | 13 | 3 |
| Particles >21µm | | ASTM D7647 | >80 | 3 | 1 | 0 |
| Particles >38µm | | ASTM D7647 | >20 | 0 | 0 | 0 |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 0 | 0 |
| | | 100 4400 (-) | >/18/15 | | 18/16/11 | 17/16/9 |
| Oil Cleanliness | | ISO 4406 (c) | >/10/13 | 17/15/11 | 10/10/11 | 17/10/9 |
| Oil Cleanliness FLUID DEGRADA | | method | limit/base | 17/15/11 current | history1 | history2 |


Contact/Location: KUNJAN SHAH - LINTWI Page 1 of 2





OIL ANALYSIS REPORT
















| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|-----------|------------|--|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.6 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| FLUID PROPERT | IES | method | limit/base | current | history1 | history2 |
| Visc @ 40°C | cSt | ASTM D445 | 64.0 | 63.4 | 63.6 | 63.9 |
| SAMPLE IMAGE | S | method | limit/base | current | history1 | history2 |
| Color | | | | A Martin Constant Martin Constant Mart | | |

Bottom

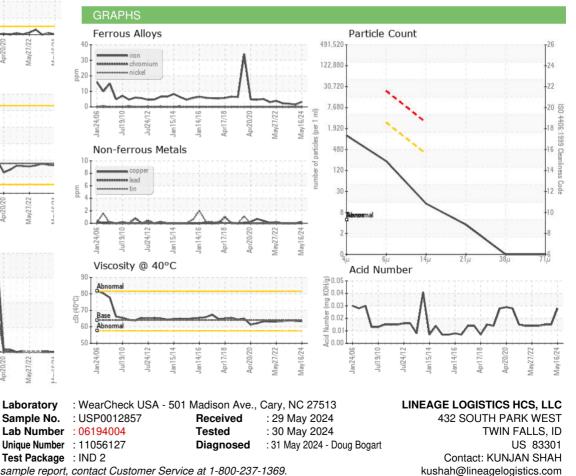

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: LINTWI [WUSCAR] 06194004 (Generated: 05/31/2024 10:06:34) Rev: 1

Contact/Location: KUNJAN SHAH - LINTWI

F:

T: (857)277-4317