

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# FES NH3 - 01 (S/N AB10049)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012845		
Sample Date		Client Info		29 May 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	4		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>3	<1		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	0		
Tin	ppm	ASTM D5185m	>4	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	50	0		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.01	0.003		
ppm Water	ppm	ASTM D6304	>100	28		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		778		
Particles >6µm		ASTM D7647	>2500	75		
Particles >14μm		ASTM D7647	>320	5		
Particles >21µm		ASTM D7647	>80	1		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>/18/15	17/13/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma 1/011/-	ACTM DOZ4	0.005	0.014		


Acid Number (AN)

0.014

mg KOH/g ASTM D974 0.005



## **OIL ANALYSIS REPORT**

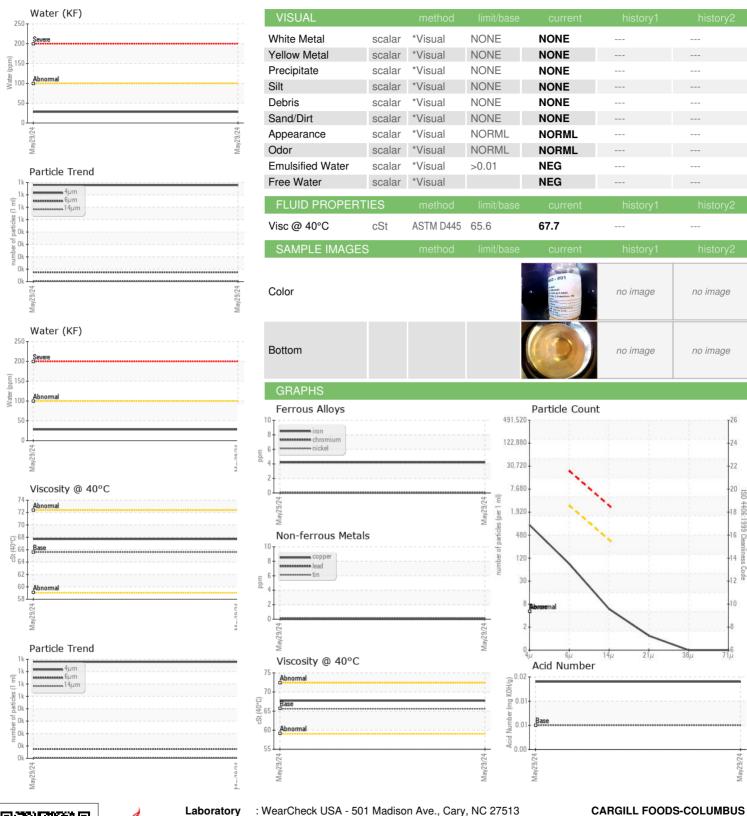



Certificate 12367

Laboratory Sample No.

Lab Number : 06194025

Test Package : IND 2

: USP0012845 Unique Number : 11056148

Received : 29 May 2024 **Tested** : 30 May 2024

Diagnosed : 31 May 2024 - Doug Bogart COLUMBUS, NE US 68601 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: