


OIL ANALYSIS REPORT

Sample Rating Trend

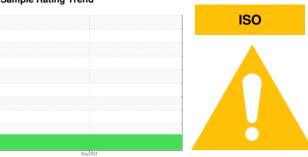

Machine Id

RCB-03 (S/N XC0493)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

Viscosity confirmed. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012820		
Sample Date		Client Info		15 May 2024		
Machine Age	hrs	Client Info		37220		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	2		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>3	<1		
Lead	ppm	ASTM D5185m	>2	<1		
Copper	ppm	ASTM D5185m	>8	0		
Tin	ppm	ASTM D5185m	>4	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	50	10		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.01	0.002		
ppm Water	ppm	ASTM D6304	>100	16		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	22026		
Particles >6µm		ASTM D7647	>2500	9 3917		
Particles >14µm		ASTM D7647	>320	107		
Particles >21µm		ASTM D7647	>80	20		
Particles >38µm		ASTM D7647	>20	1		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>22/19/14</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014		



OIL ANALYSIS REPORT

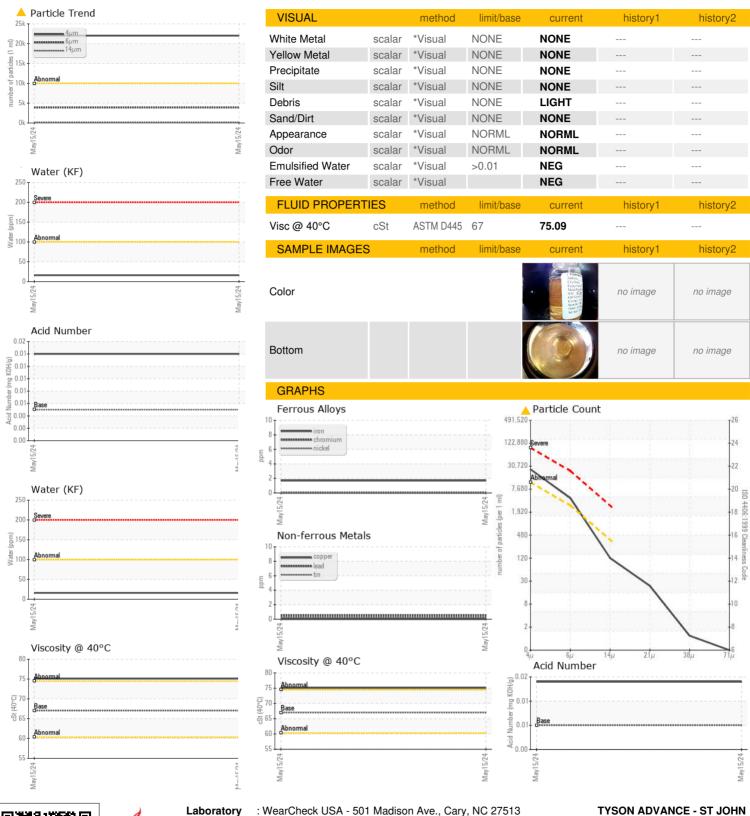



Certificate 12367

Laboratory Sample No.

Test Package : IND 2

Lab Number : 06194032

: USP0012820 Unique Number : 11056155

Received **Tested**

: 29 May 2024 : 03 Jun 2024 Diagnosed

ADVANCE PIERRE FOODS, 70 ST JOHN ST PORTLAND, ME

: 05 Jun 2024 - Doug Bogart US 04102 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: TYSPORSAI [WUSCAR] 06194032 (Generated: 06/06/2024 07:43:55) Rev: 1

Contact/Location: Service Manager - TYSPORSAI

T:

F: