

## **OIL ANALYSIS REPORT**

## Area CTL74 CTL 74 SCRAP CHOPPER MAIN B/S Gearbox

#### Recommendation

Resample at the next service interval to monitor.

ESSO SPARTAN EP 220 (20 GAL)

#### Wear

Fluid


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

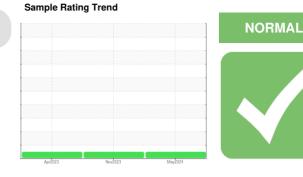





SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0042103	RP0038596	RP0030552
Sample Date		Client Info		28 May 2024	02 Nov 2023	17 Apr 2023
Machine Age	mths	Client Info		2	2	2
Oil Age	mths	Client Info		2	2	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		21	12	12
Iron	ppm	ASTM D5185m	>200	10	7	10
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		1	0	0
Aluminum	ppm	ASTM D5185m	>25	1	2	0
Lead	ppm	ASTM D5185m	>100	1	0	0
Copper	ppm	ASTM D5185m	>200	4	<1	<1
Tin	ppm	ASTM D5185m	>25	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	.5	8	9	0
Barium	ppm	ASTM D5185m		0	19	0
Molybdenum	ppm	ASTM D5185m	0	1	<1	1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	0	5	6	6
Calcium	ppm	ASTM D5185m	1.7	1	11	26
Phosphorus	ppm	ASTM D5185m	250	176	210	159
Zinc	ppm	ASTM D5185m	.3	11	16	33
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	3	2	2
Sodium	ppm	ASTM D5185m		0	0	1
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.2	0.005	0.009	0.008
ppm Water	ppm	ASTM D6304	>2000	56	93.2	84.3
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.75	0.42	0.44	0.24



# **OIL ANALYSIS REPORT**

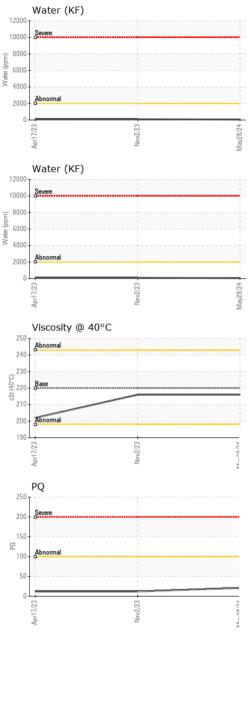

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	216	216	202
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color				a.		
Bottom						

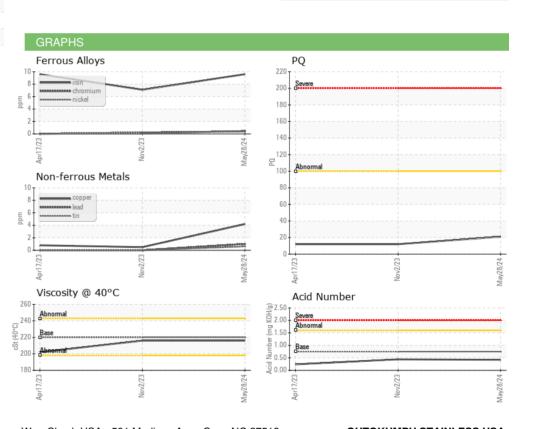

**OUTOKUMPU STAINLESS USA** Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 : RP0042103 Received Sample No. : 29 May 2024 HWY 43 N Lab Number : 06194143 Tested : 30 May 2024 CALVERT, AL Unique Number : 11056266 Diagnosed : 31 May 2024 - Angela Borella US 36513 Test Package : IND 2 (Additional Tests: PQ) Contact: MARIO JOHNSON Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. Mario.johnson@outokumpu.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (251)321-4105 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: x:

Submitted By: DALE ROBINSON

Page 2 of 2