


OIL ANALYSIS REPORT

NOT GIVEN **BOGE 5175772 - CRW GRAPHICS**

Component Compressor



Recommendation


Contamination


Fluid Condition

		May2024					
DIAGNOSIS	SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Recommendation	Sample Number		Client Info		UFD0001685		
Resample at the next service interval to monitor.	Sample Date		Client Info		29 May 2024		
Wear	Machine Age	hrs	Client Info		3126		
All component wear rates are normal. Contamination There is no indication of any contamination in the oil.	Oil Age	hrs	Client Info		3126		
	Oil Changed		Client Info		Not Changd		
	Sample Status				NORMAL		
	WEAR METALS		method	limit/base	current	history1	history2
Fluid Condition The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Iron	ppm	ASTM D5185m	>50	<1		
	Chromium	ppm	ASTM D5185m	>10	<1		
	Nickel	ppm	ASTM D5185m		<1		
	Titanium	ppm	ASTM D5185m		<1		
	Silver	ppm	ASTM D5185m		1		
	Aluminum	ppm	ASTM D5185m	>25	1		
	Lead	ppm	ASTM D5185m	>25	<1		
	Copper	ppm	ASTM D5185m	>50	<1		
	Tin	ppm	ASTM D5185m		<1		
	Vanadium	ppm	ASTM D5185m		<1		
	Cadmium	ppm	ASTM D5185m		<1		
	ADDITIVES		method	limit/base	current	history1	history2
	Boron	ppm	ASTM D5185m	5	0		
	Barium	ppm	ASTM D5185m	5	0		
	Molybdenum	ppm	ASTM D5185m	5	<1		
	Manganese	ppm	ASTM D5185m		<1		
	Magnesium	ppm	ASTM D5185m	5	<1		
	Calcium	ppm	ASTM D5185m	12	0		
	Phosphorus	ppm	ASTM D5185m	12	2		
	Zinc	ppm	ASTM D5185m	12	0		
	Sulfur	ppm	ASTM D5185m	1000	0		
	CONTAMINANTS		method	limit/base	current	history1	history2
	Silicon	ppm	ASTM D5185m	>25	5		
	Sodium	ppm	ASTM D5185m		4		
	Potassium	ppm	ASTM D5185m	>20	1		
	Water	%	ASTM D6304	>0.1	NEG		
	FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	0.17		
	VISUAL		method	limit/base	current	history1	history2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
Report Id: UCFLUMOR [WUSCAR] 06194204 (Generated: 05/31/2024	Free Water	scalar	*Visual)	NEG	Serv <u>ic</u> e Manage	r - <u>UC</u> FLUMOR Page 1 of 2





OIL ANALYSIS REPORT

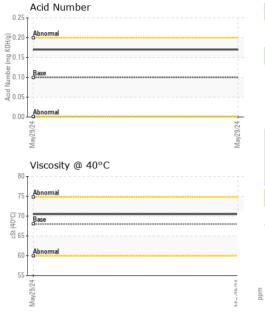

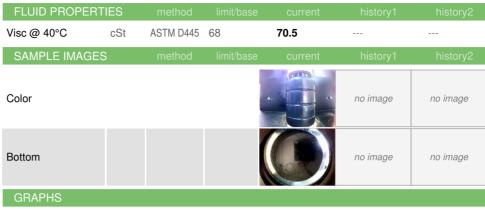

Ferrous Alloys






Viscosity @ 40°C



Acid Number







Lab Number : 06194204

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : UFD0001685

Unique Number : 11056327

Received **Tested** Diagnosed

: 29 May 2024 : 31 May 2024

: 31 May 2024 - Jonathan Hester

36 MOUNTAIN VIEW RD MORGANTOWN, PA US 19543

FLUID-AIRE DYNAMICS

Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - UCFLUMOR

T:

F: